PRC
APERTURE
CARD

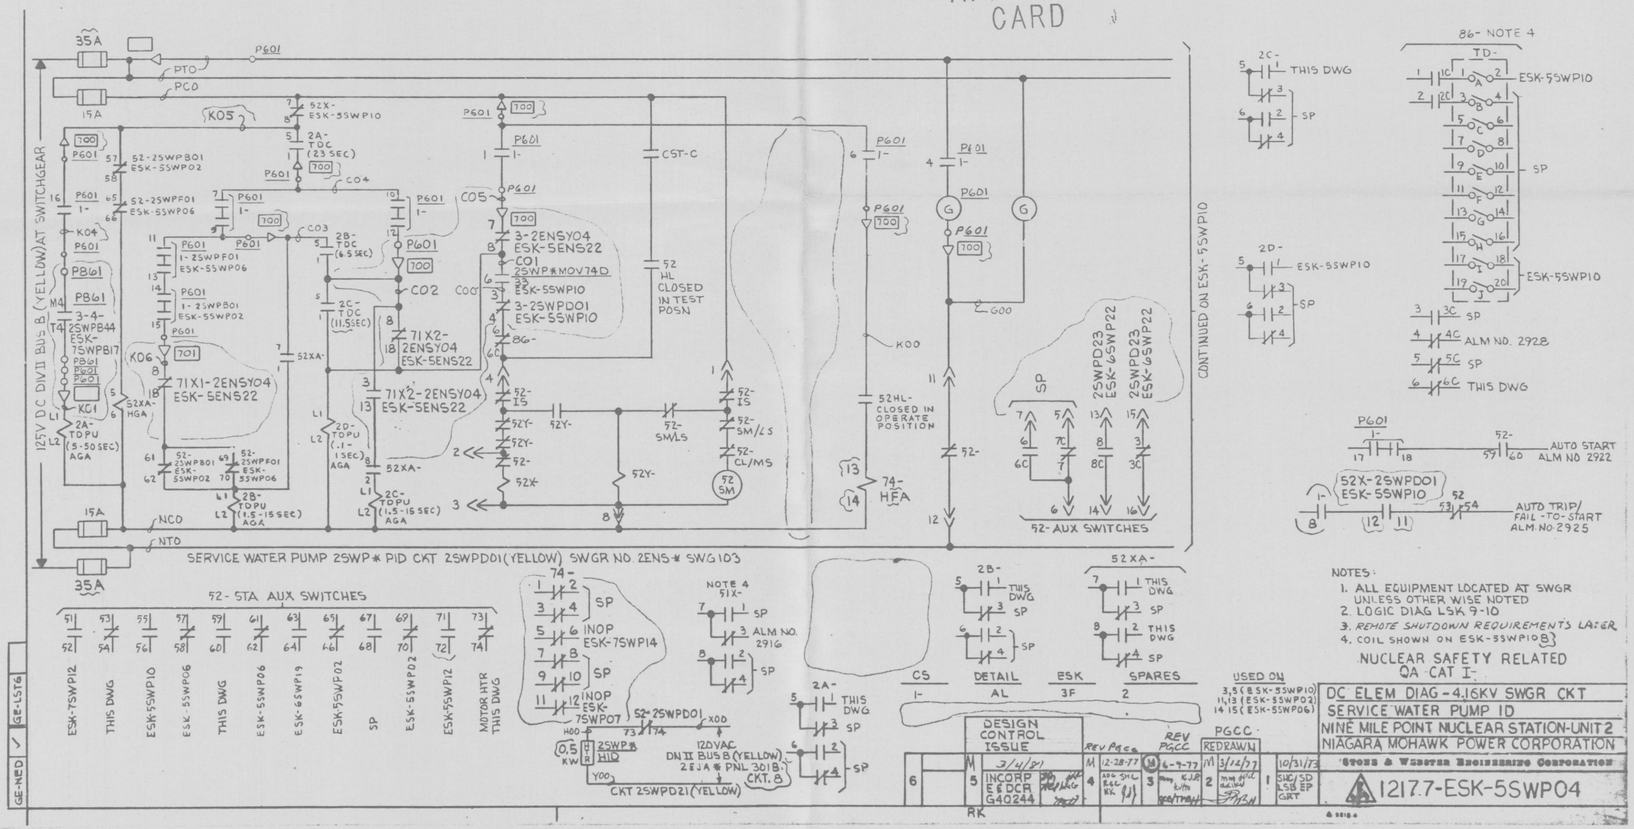

NOTES:
1. ALL EQUIPMENT LOCATED AT SWGR UNLESS OTHERWISE NOTED
2. LOGIC DIAG LSK 9-10
3. REMOTE SHUTDOWN REQUIREMENTS LATER
4. COIL SHOWN ON ESK-5SWP10 B3

NUCLEAR SAFETY RELATED
QA CAT I

CS	DETAIL	ESK	SPARES
1	AL	3F	2

USED ON
3,5 (ESK-5SWP10)
11,13 (ESK-5SWP02)
14 15 (ESK-5SWP06)

DC ELEM DIAG-4.16KV SWGR CKT
SERVICE WATER PUMP 1D
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

DESIGN CONTROL ISSUE

REV	DATE	PGCC	REDRAWN
6			
5	3/4/81		
4	12-28-77	4-7-77	3/14/77
3			
2			
1			10/31/73

INCORP E&DCR G40244

STONE & WEBSTER ENGINEERING CORPORATION

1217.7-ESK-5SWP04

GE-NED | GE-LSTG

D