PRC APERTURE CARD

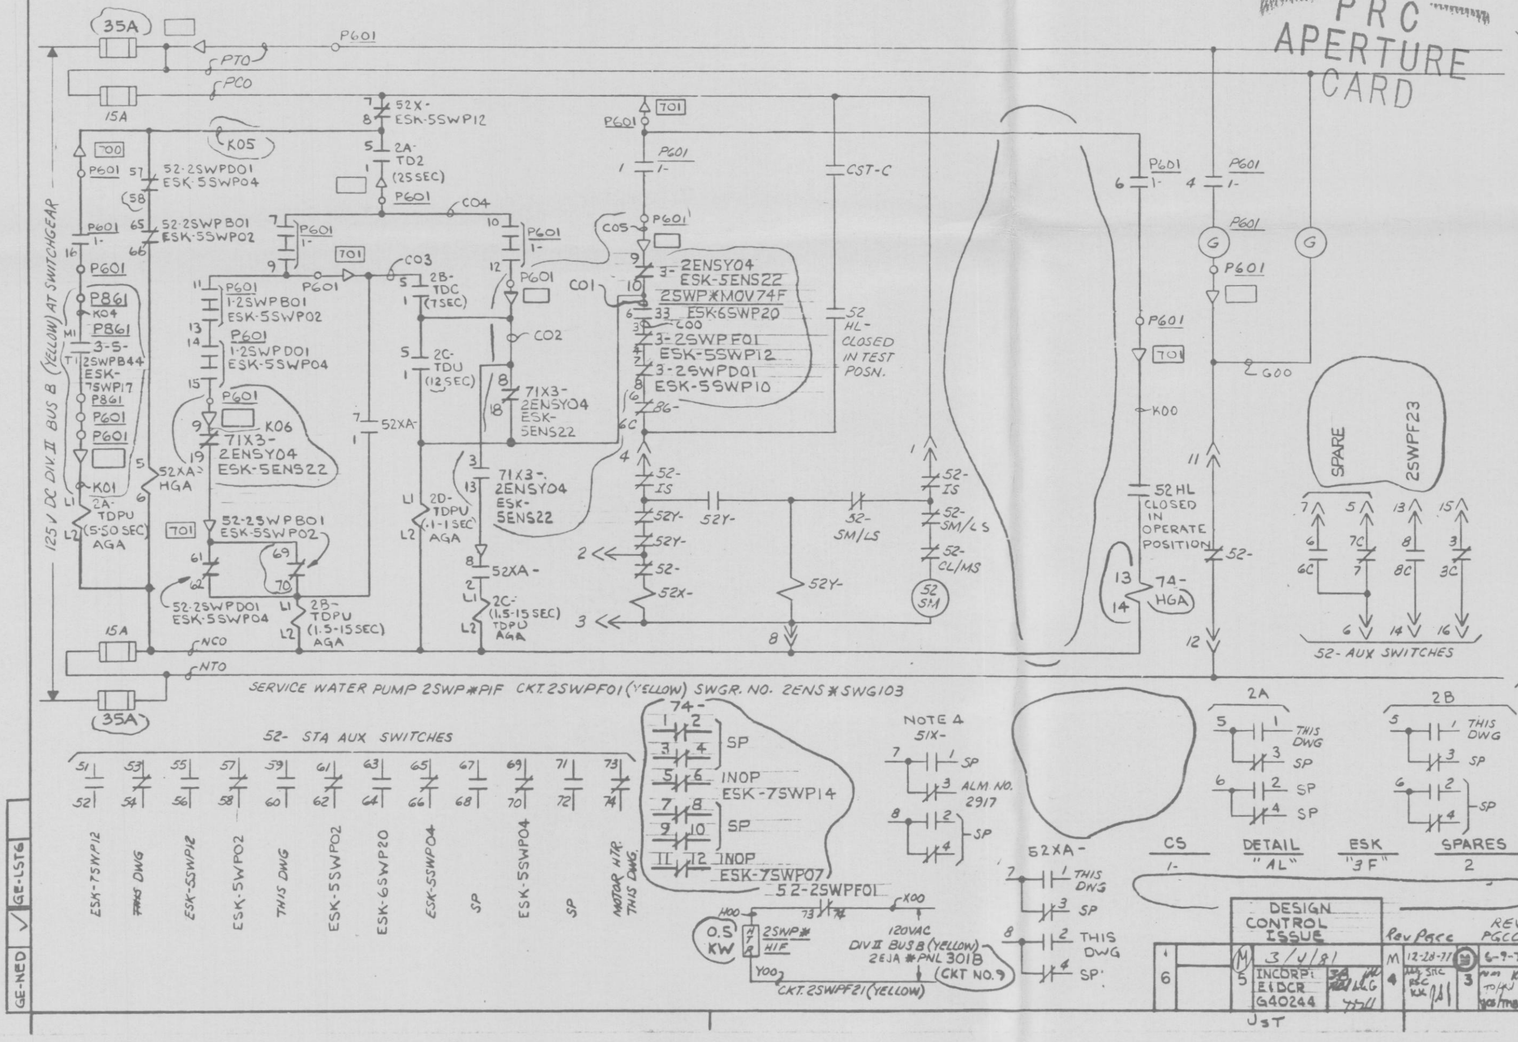

NOTES:
1. ALL EQUIPMENT LOCATED AT SWGR UNLESS OTHERWISE NOTED
2. LOGIC DIAG. LSK 9-10C)
3. REMOTE SHUT DOWN REQUIREMENTS LATER
4. COIL SHOWN ON ESK-5SWP12

NUCLEAR SAFETY RELATED
QA CAT I

CS	DETAIL	ESK	SPARES
1-	"AL"	"3F"	2

USED ON
3,5 (ESK-5SWP12)
11,13 (ESK-5SWP04)
14-15 (ESK-5SWP02)

REV	PGCC	REDRAWN
M 5	3/4/81 INCORP: E1DCR G40244	
M 4	12-28-77	
3	6-9-77	
2		3/2/77
M 1		10/28/73 SWG/SD LSB EP GRT

DESIGN CONTROL ISSUE

DC ELEM DIAG - 4.16KV SWGR CKT
SERVICE WATER PUMP 1F
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-5SWP06

GE-NED ✓ GE-LST6

D