
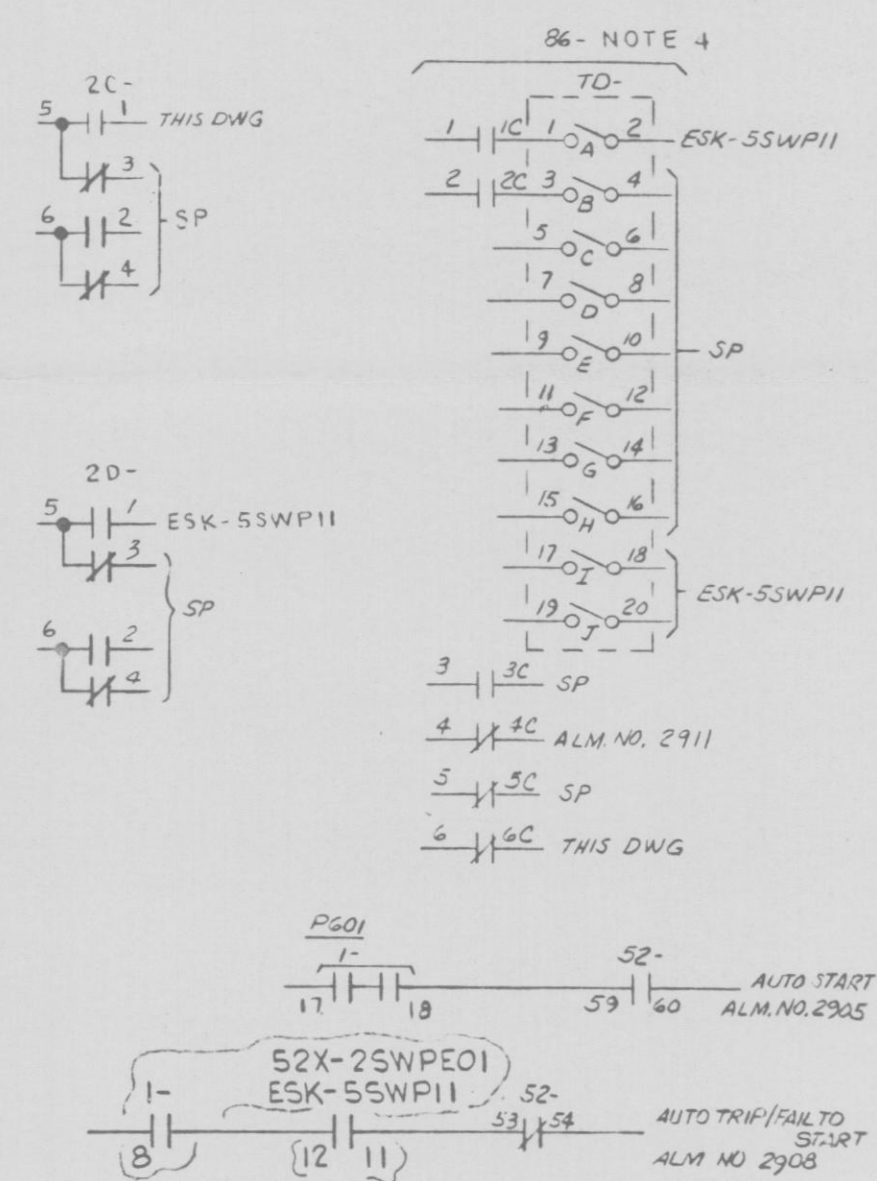


PRC APERTURE CARD

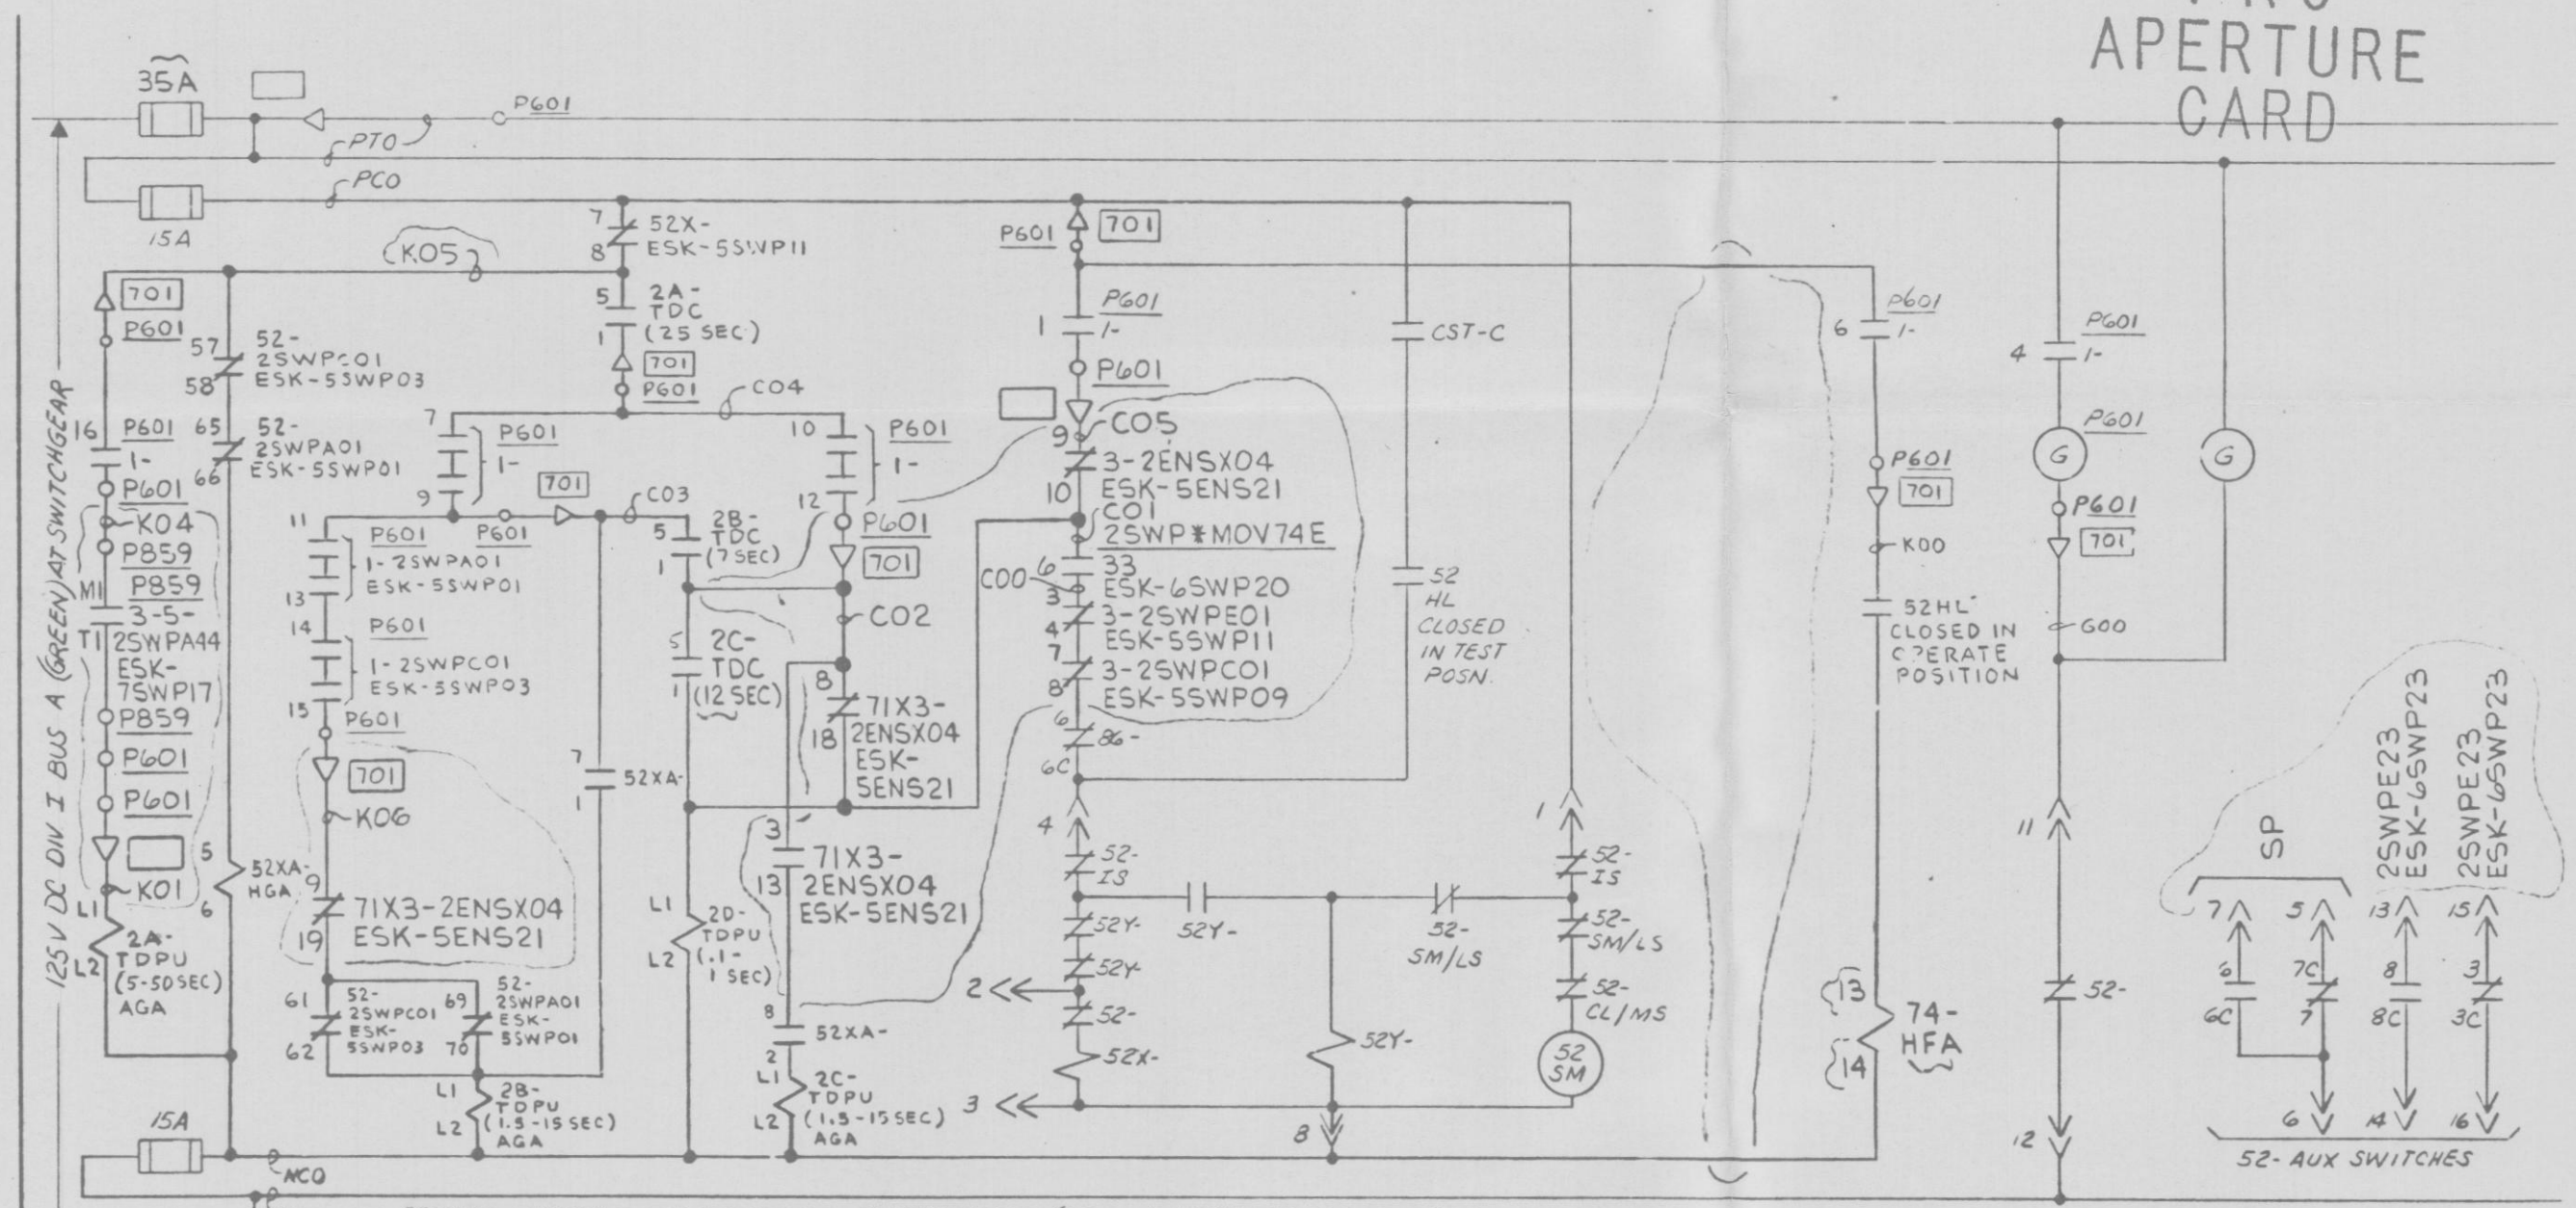


CONTINUED ON ESK-55WP11


52- STA AUX SWITCHES

51	53	55	57	59	61	63	65	67	69	71	73
52	54	56	58	60	62	64	66	68	70	72	74

ESK-7SWP11 THIS DWG
 ESK-55WP11 THIS DWG
 ESK-55WP01 THIS DWG
 ESK-55WP01 THIS DWG
 ESK-6SWP20
 ESK-55WP03
 ESK-55WP03
 ESK-55WP03
 SP
 ESK-55WP03
 SP

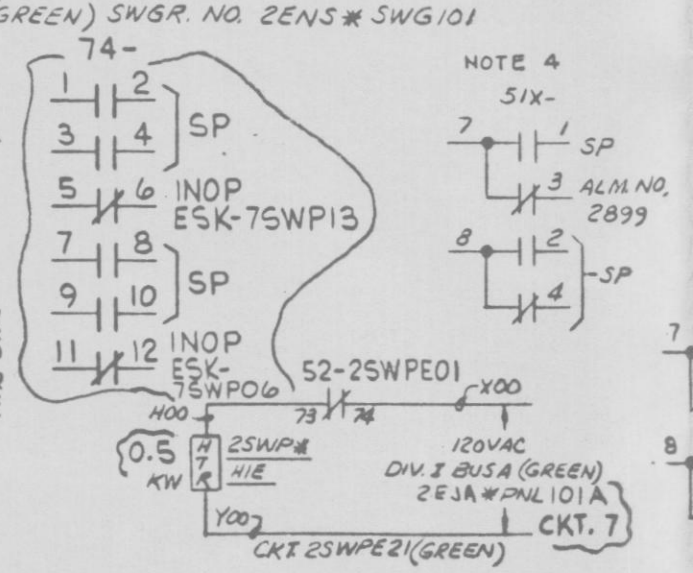

NOTE 4
 51X-
 7 SP
 3 ALM NO. 2899
 8 SP

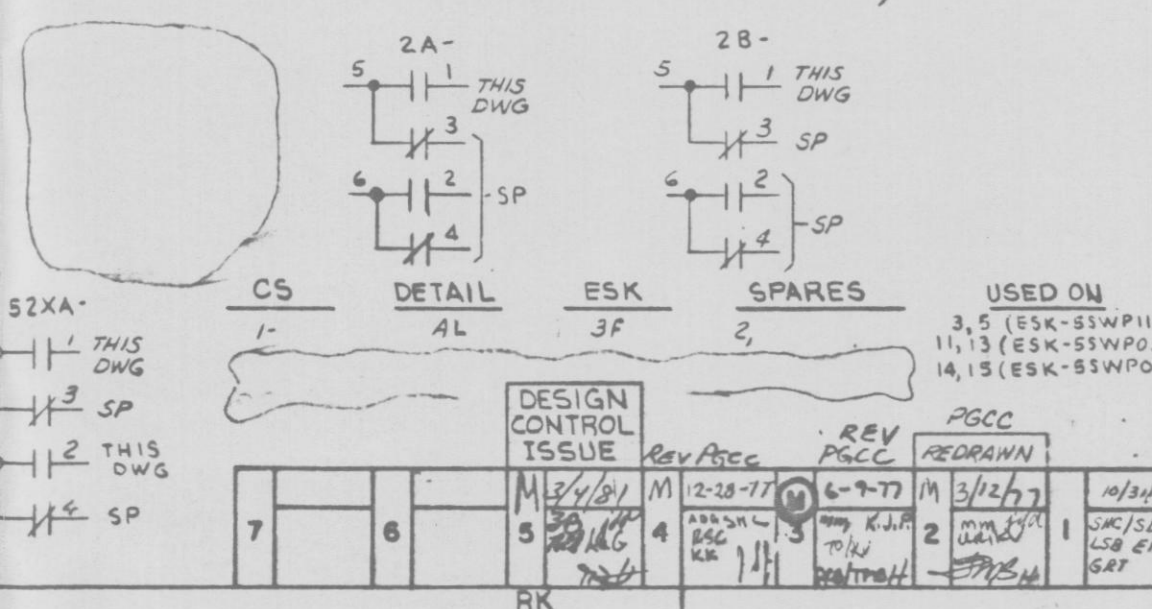

NOTES:
 1. ALL EQUIPMENT LOCATED AT SWGR UNLESS OTHERWISE NOTED
 2. LOGIC DIAG LSK 9-10C.
 3. REMOTE SHUTDOWN REQUIREMENTS LATER.
 4. COIL SHOWN ON ESK-55WP11

NUCLEAR SAFETY RELATED
 QA CAT I

USED ON	3, 5 (ESK-55WP11) 11, 13 (ESK-55WP03) 14, 15 (ESK-55WP01)
DC ELEM DIAG-4, 16 SWGR CKT	
SERVICE WATER PUMP IE	
NINE MILE POINT NUCLEAR STATION UNIT 2	
NIAGARA MOHAWK POWER CORPORATION	
STORZ & WENSTER ENGINEERING CORPORATION	
12177-ESK-55WP05	

GE-NEED ✓ GE-L5T6

D