PRC
APERTURE
CARD

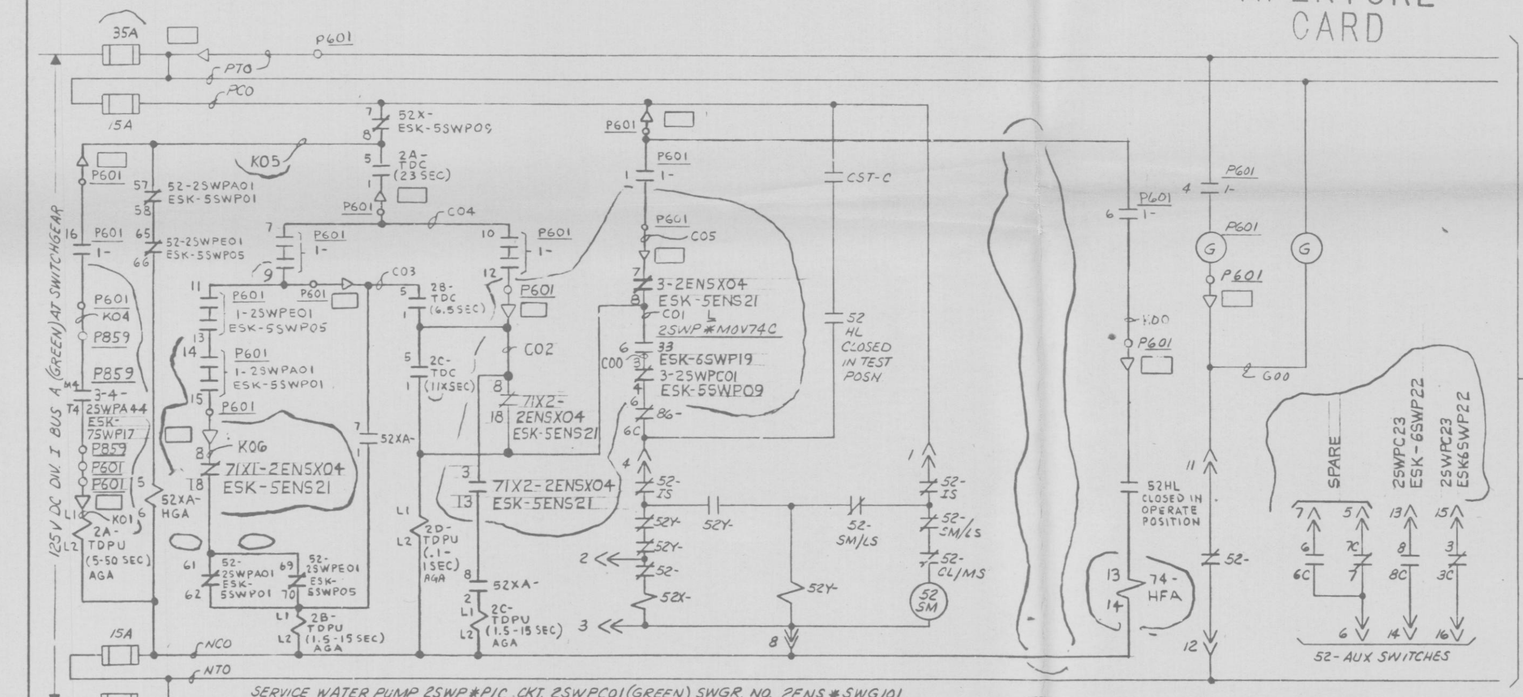

NOTES:
1. ALL EQUIPMENT LOCATED AT SWGR UNLESS OTHERWISE NOTED
2. LOGIC DIAG. LSK 9-10B
3. REMOTE SHUTDOWN REQUIREMENTS LATER
4. COIL SHOWN ON ESK-5SWP09

CS	DETAIL	ESK	SPARES
1-	AL	3F	2,

USED ON
3, 5 (ESK-5SWP09)
11, 13 (ESK-5SWP01)
14, 15 (ESK-5SWP05)

NUCLEAR SAFETY RELATED
QA CAT I

	DC ELEM DIAG 4.16 KV SWGR CKT
	SERVICE WATER PUMP 1C
	NINEMILE POINT NUCLEAR STATION-UNIT 2
	NIAGARA MOHAWK POWER CORPORATION
	STONE & WEBSTER ENGINEERING CORPORATION
GE-NED V GE-LSTG	12177-ESK-5SWP03

REV	DESIGN CONTROL ISSUE	Rev PGCC	REV PGCC	REDRAWN
M	12/4/81	12-28-77	6-9-77	3/12/77
5	3/4/82	ADD SYM. PGCC 114	KJP	mm
4				
3				
2				
1				11/31/73 SWC/SD LSB EF GET

D