

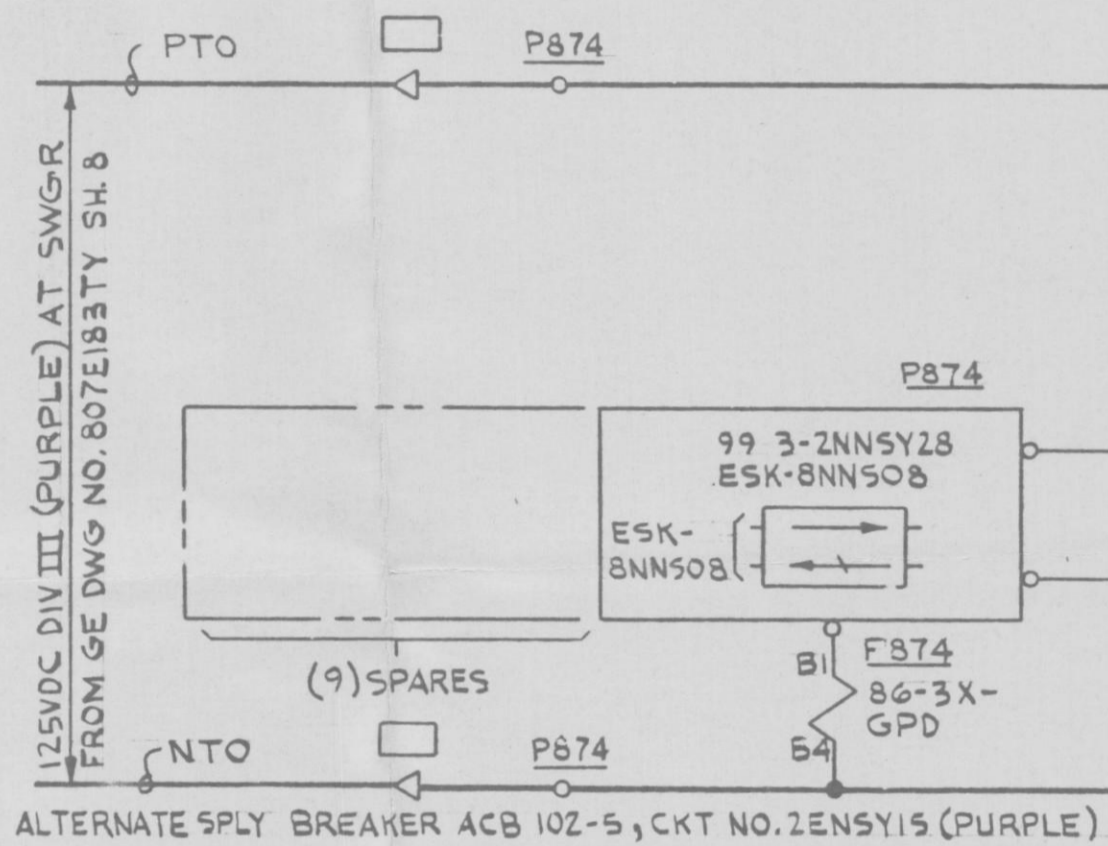


NORMAL SPLY BREAKER ACB 102-4, CKT NO. 2ENSXIS (PURPLE)

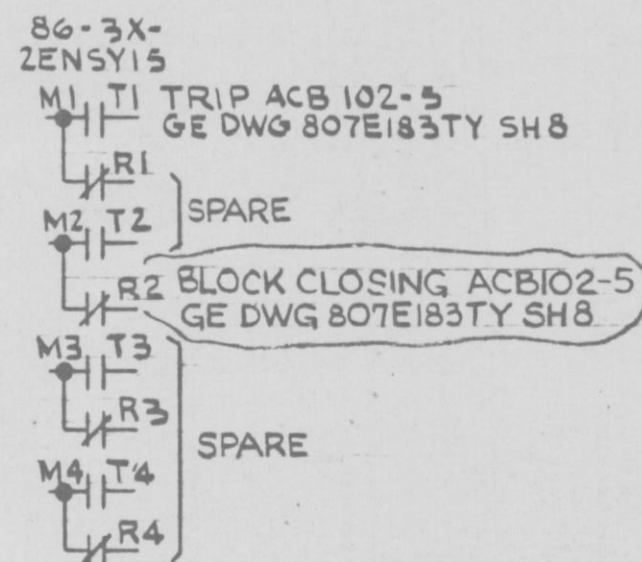

ALTERNATE SPLY BREAKER ACB 102-5, CKT NO. 2ENSYIS (PURPLE)

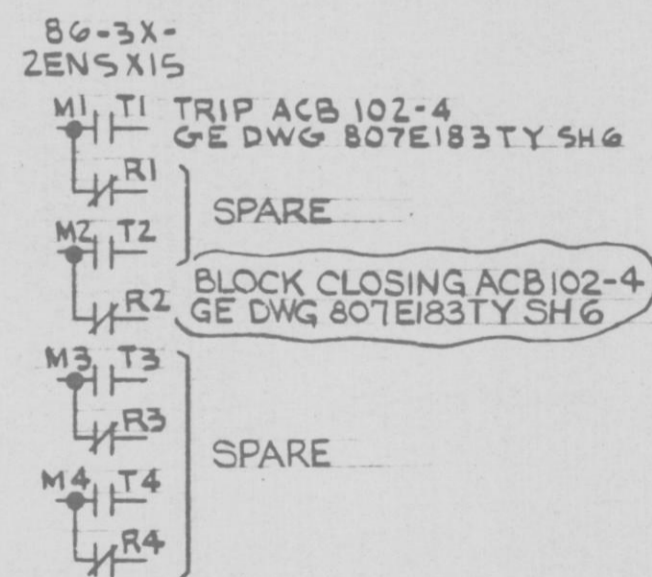

PRC
APERTURE
CARD

NUCLEAR SAFETY RELATED
QA CAT I

DC ELEM DIAG
ACB102-4 & -5 BACKUP TRIP
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-5ENS23

DESIGN
CONTROL
ISSUE

7	6	5	4	3	M	2	M
					1/3/80	3/2/80	
					APM	Jh	

GE-NEED
GE-LS1TG

D