


- NOTES:
1. ALL EQUIPMENT LOCATED AT SWGR UNLESS OTHERWISE NOTED.
  2. LOGIC DIAGRAM LSK-24-9.1.
  3. ▲ - 1 MEGOHM, 1 WATT METAL FILM RESISTOR WITH MOLDED CASE.
  4. SEAL-IN CONTACT INTERNALLY DISCONNECTED.

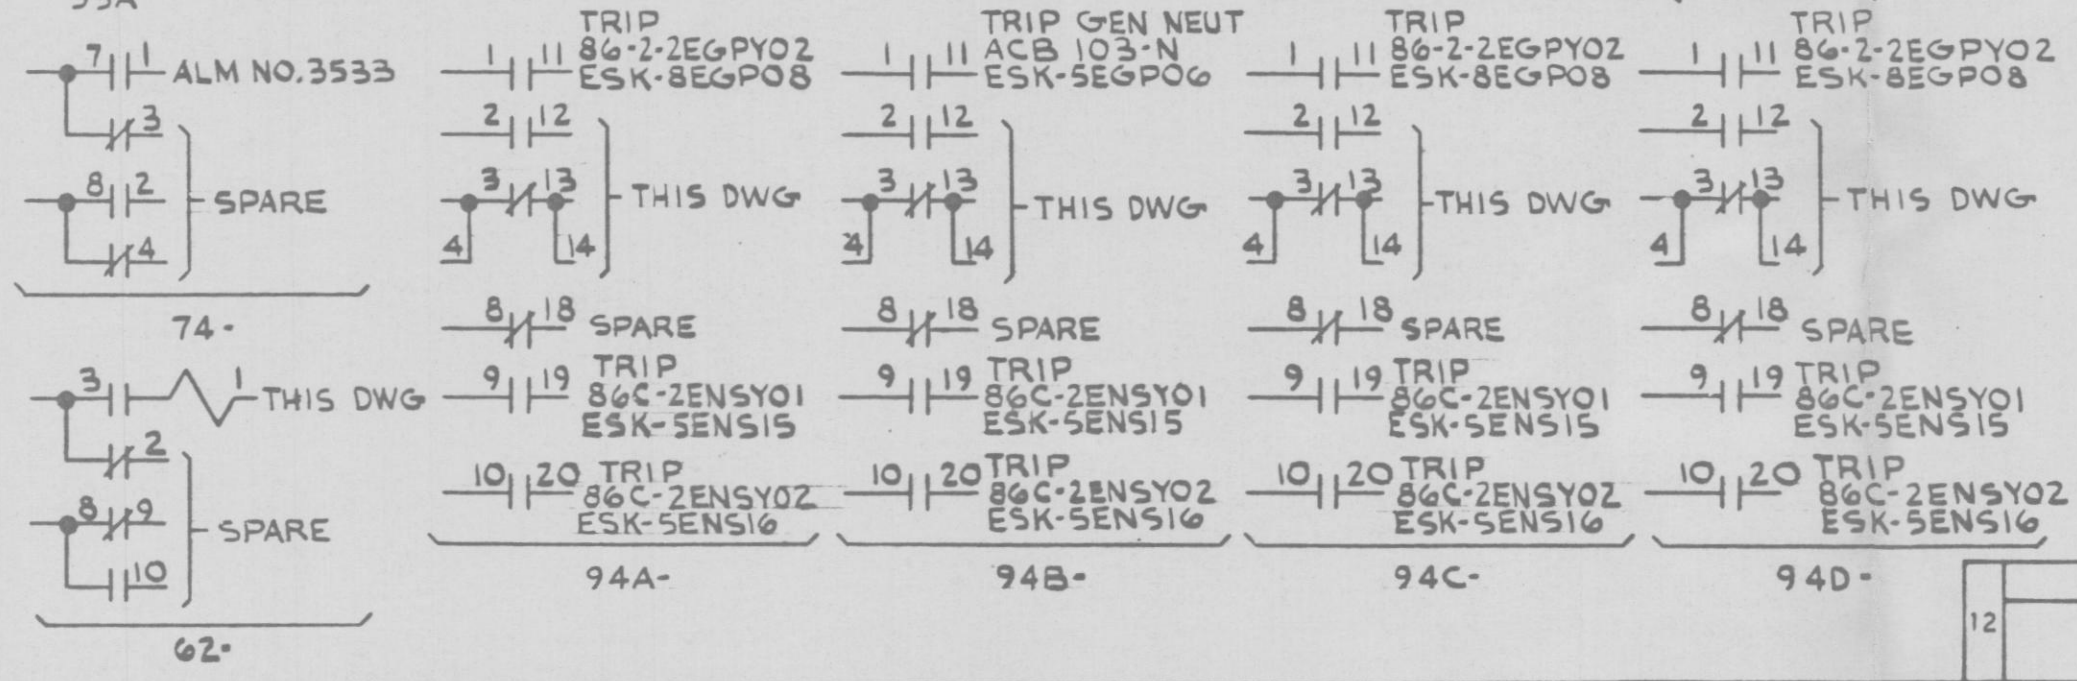

PRC  
APERTURE  
CARD

DESIGN CONTROL	ISSUE	REDRAWN
7	10.9.80	8
7	7/80	8

NUCLEAR SAFETY RELATED  
QA CAT I

DC ELEM DIAG 4160V SWGR  
2ENS\*SWG103 PROTECTION

NINE MILE POINT NUCLEAR STATION-UNIT 2  
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-5ENS17

GE MED / GE LSTG

D