



NOTES:  
 1. ALL EQUIP LOCATED AT SWITCHGEAR UNLESS OTHERWISE NOTED.  
 2. REFER LOGIC DIAGRAM LSK-24-9.5 & 9.6.  
 3. REMOTE SHUTDOWN PNL REQUIRED LATER.

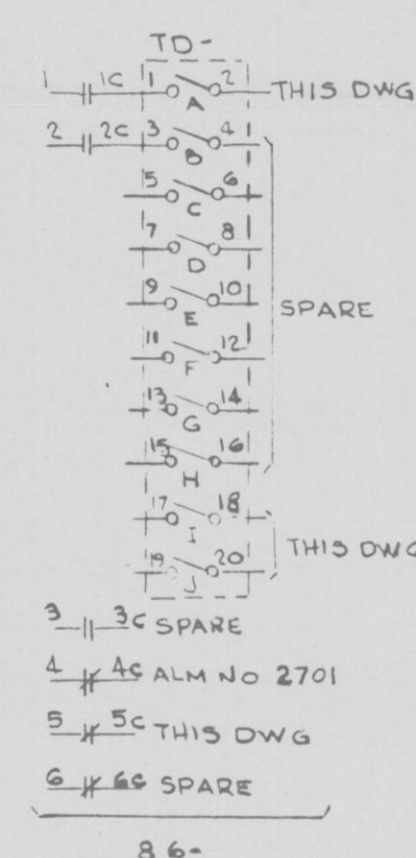

52 - STA AUX CONTACTS

51	53	55	57	59	61	63	65	67	69	71	73
52	54	56	58	60	62	64	66	68	70	72	74

COMPUTER ESK-SENS02  
 ACB103-14  
 ESK-SENS03

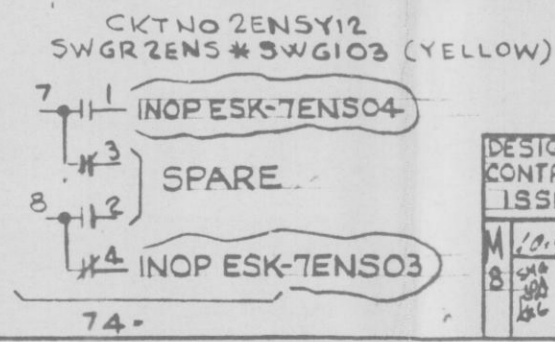

DESIGN CONTROL ISSUE	CS	DETAIL	ESK	SPARE
M 10/9/70	1	D	3A	2,6,9,10
M 3/7/71				
M 9/19/71				
M 11/18/71				
M 4-28-77				
M 3-29-77				
M 11/18/76				
M 10-2-74				

PGCC PGCC RETDRAWN

NUCLEAR SAFETY RELATED  
 QA CAT I

DC ELEM DIAG - 4.16KV SWGR CONTROL  
 4160V EMER SWGR ACB103-8 CONTROL  
 NINE MILE POINT NUCLEAR STATION-UNIT-2  
 NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION  
 12177-ESK-5ENS03

GEN-ED ✓ GE-15TG

D