



1

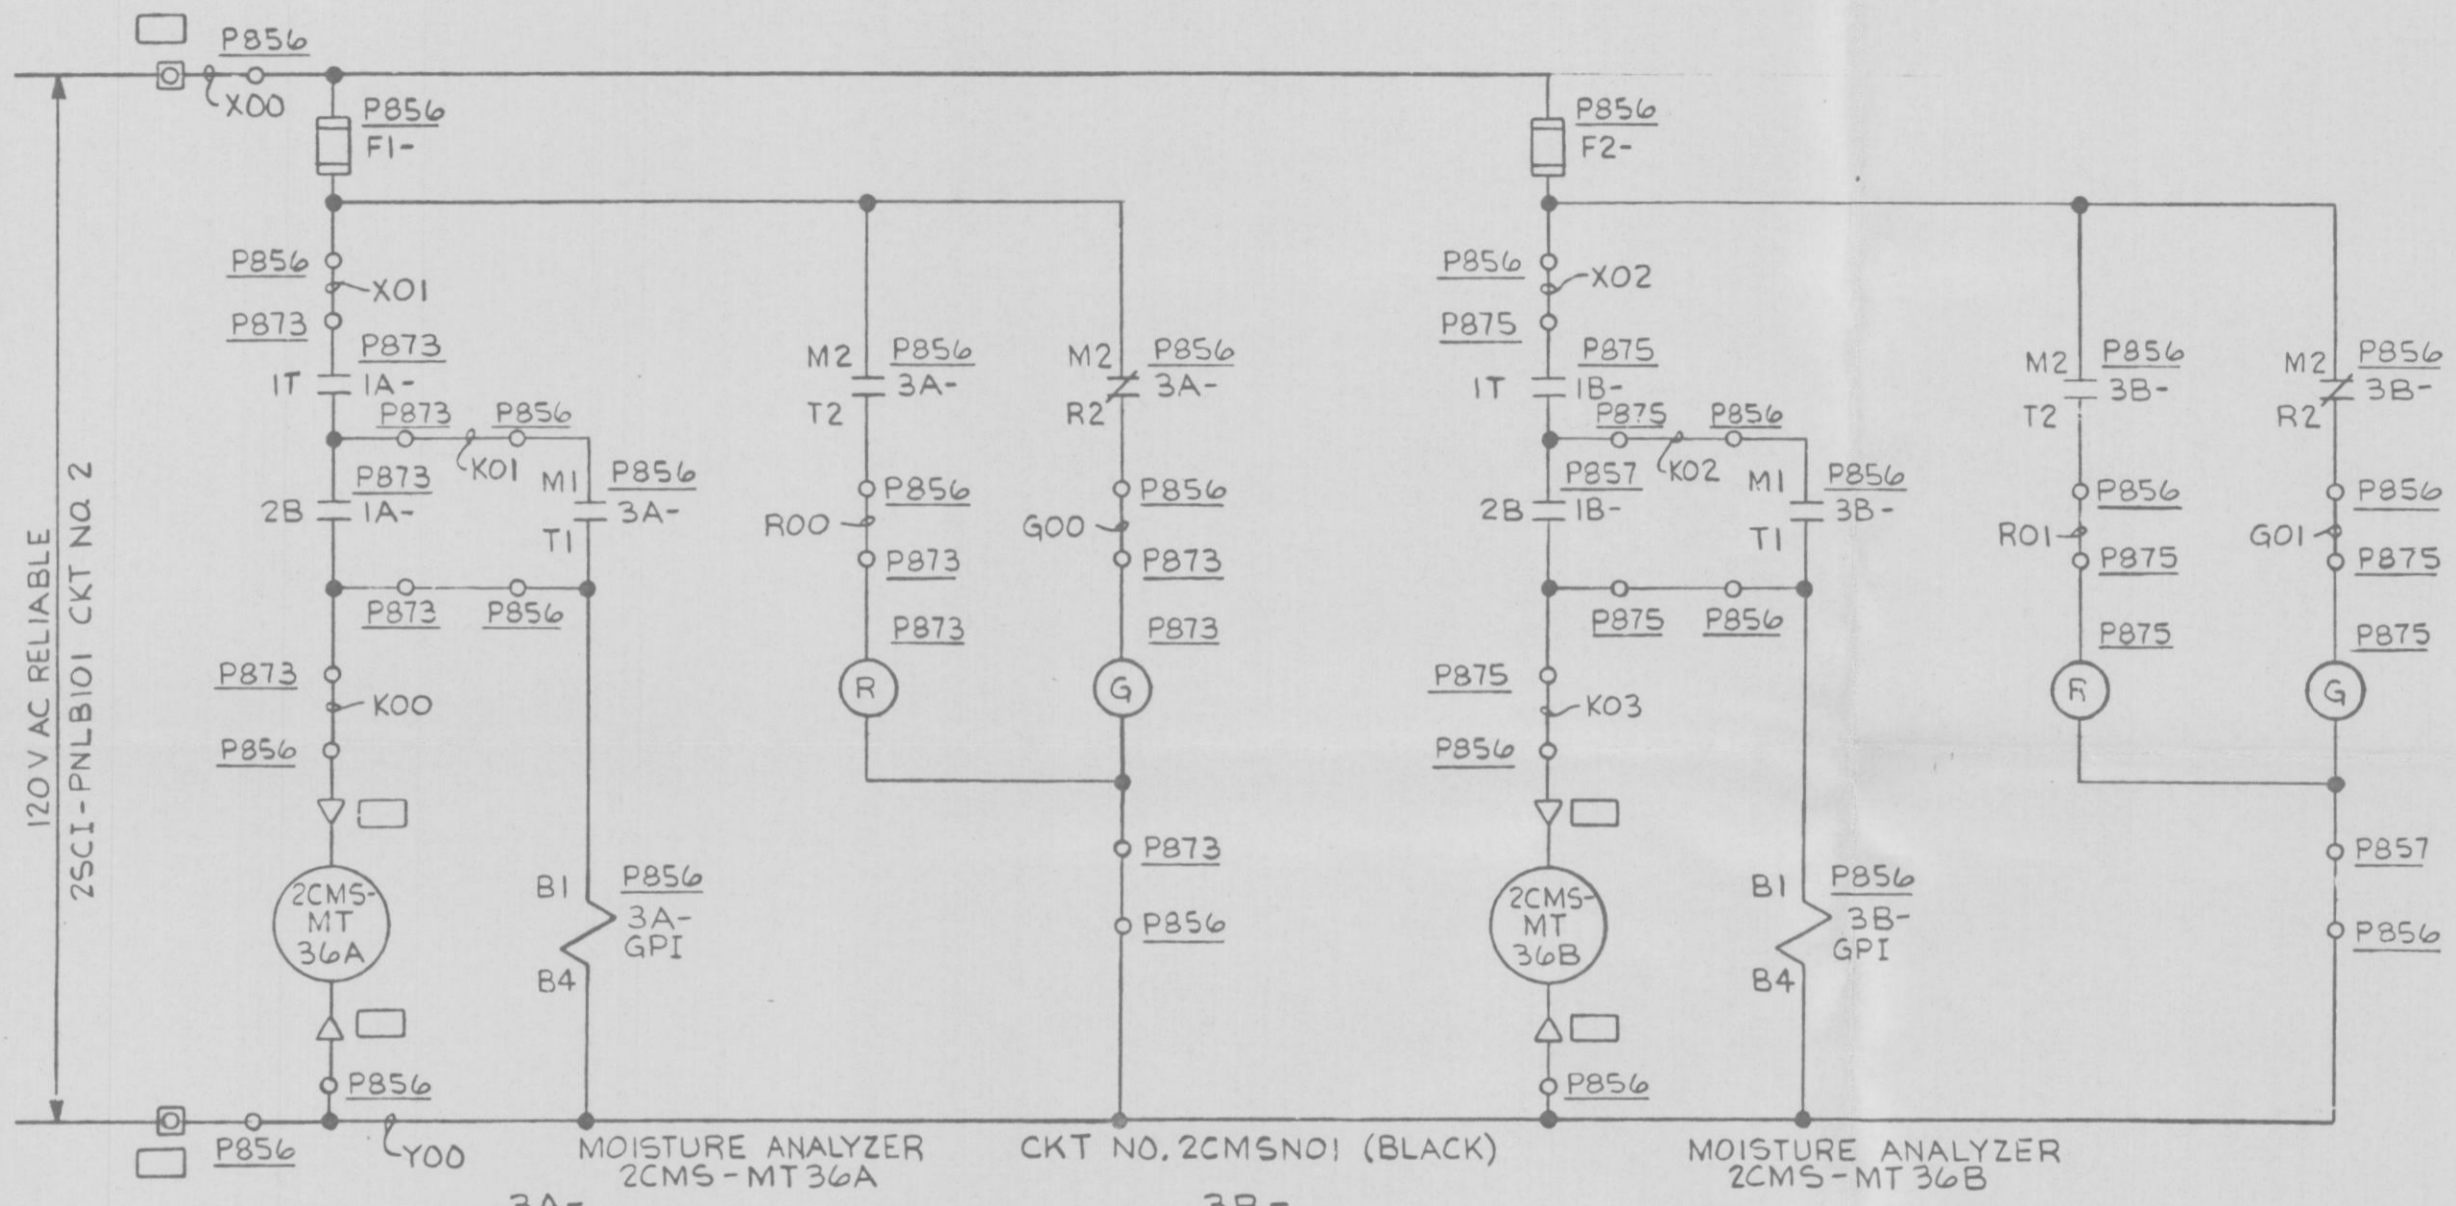

- NOTES:
 1. ALL EQUIPMENT LOCATED AS NOTED
 2. LOGIC DIAG LSK-33-2A

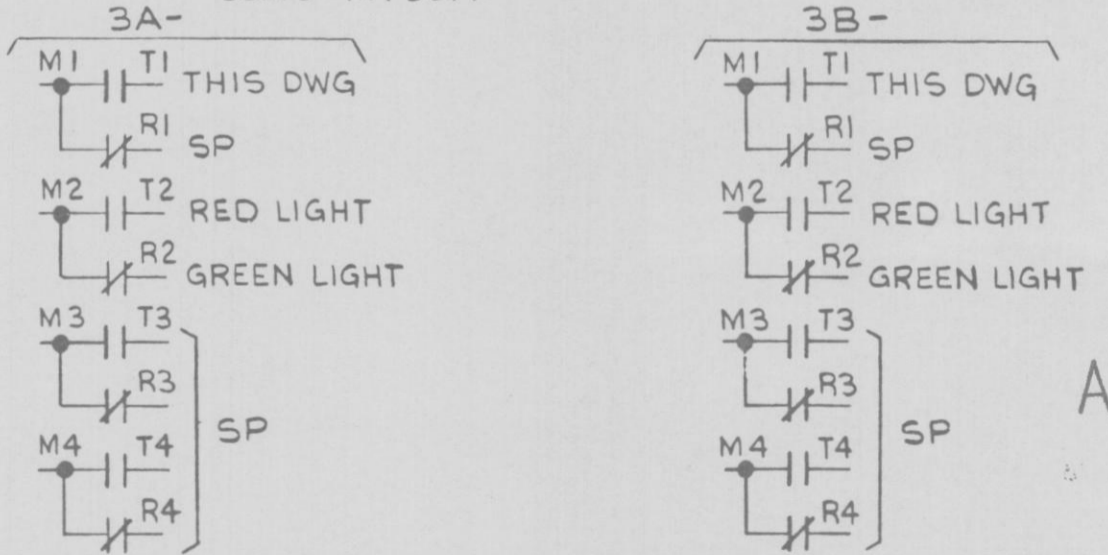

PRC
APERTURE
CARD

CS	DETAIL	ESK	SPARES	USED ON
IA-	"H"	3B	1B, 2T	==
IB-	"H"	3B	1B, 2T	==

GE LISTG
GE MED

7	6	5	4	3	2	1
---	---	---	---	---	---	---

DESIGN CONTROL ISSUE
 M/1-88-81
 RK

QA CAT II
 AC ELEM DIAG-120V AC MISC CKTS
 CONTAINMENT ATMOSPHERE MONITORING
 NINE MILE POINT NUCLEAR STATION-UNIT 2
 NIAGARA MOHAWK POWER CORPORATION
 STONE & WEBSTER ENGINEERING CORPORATION
 12177-ESK-7CMS24

D