


CONTINUED FROM ESK-7CMS10

CONTINUED ON ESK-7CMS22

DIVISION II VALVES CKT NO. 2CMSB03 (YELLOW)

PRC APERTURE CARD

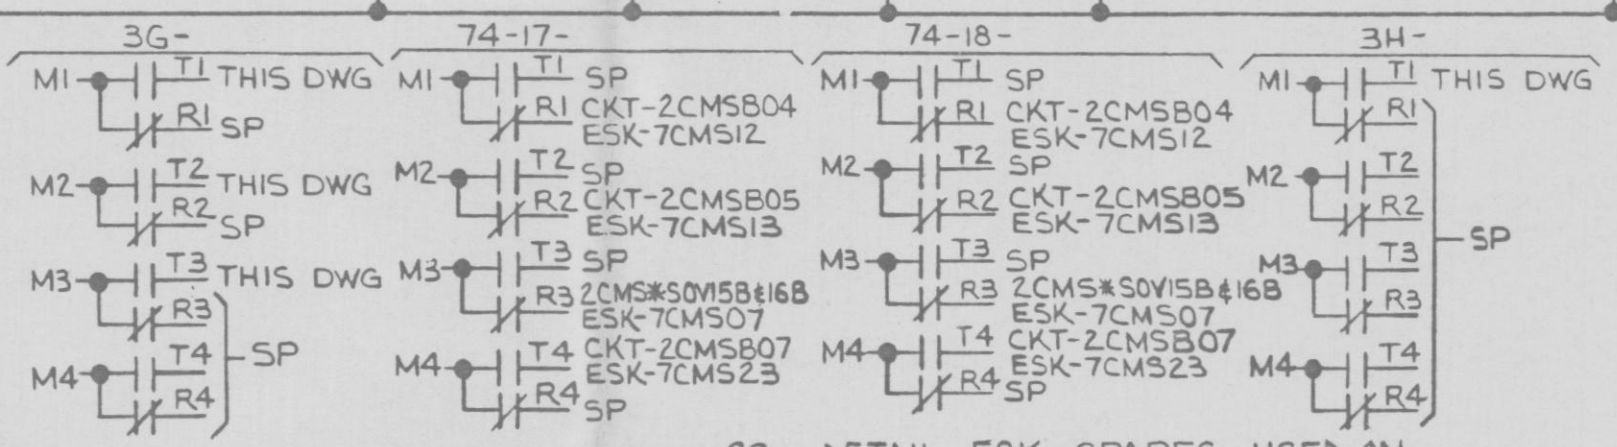

NOTES:
 1. ALL EQUIPMENT LOCATED AS NOTED.
 2. LOGIC DIAG. LSK-33-2

NUCLEAR SAFETY RELATED
 QA CAT I

AC ELEM DIAG-120VAC MISC CKT
 CONTAINMENT ATMOSPHERE MONITORING
 NINE MILE POINT NUCLEAR STATION-UNIT 2
 NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-7CMS21

DESIGN CONTROL ISSUE
 M 1-25-81
 JST

CS DETAIL ESK SPARES USED ON
 IT- "H5" 3B 1B, 2T
 IU-

7	6	5	4	3	2	1
---	---	---	---	---	---	---

LIMIT SWITCH DEVELOPMENT				
33	VALVE POSITION		FUNCTION	
	FULL OPEN	FULL CLOSED	2CMS*65B	2CMS*62B
1	—	—	RED LT	RED LT
2	—	—	GRN LT	GRN LT
3	—	—	THIS DWG	ESK-7SCI41
4	—	—	SP	SP