


DW ISOL V 2CMS*SOV32B (OUTBOARD)




DW ISOL V 2CMS*SOV33B (INBOARD)

SUPPR CHAM ISOL V 2CMS*SOV34B (INBOARD)

SUPPR CHAM ISOL V 2CMS*SOV35B (OUTBOARD)

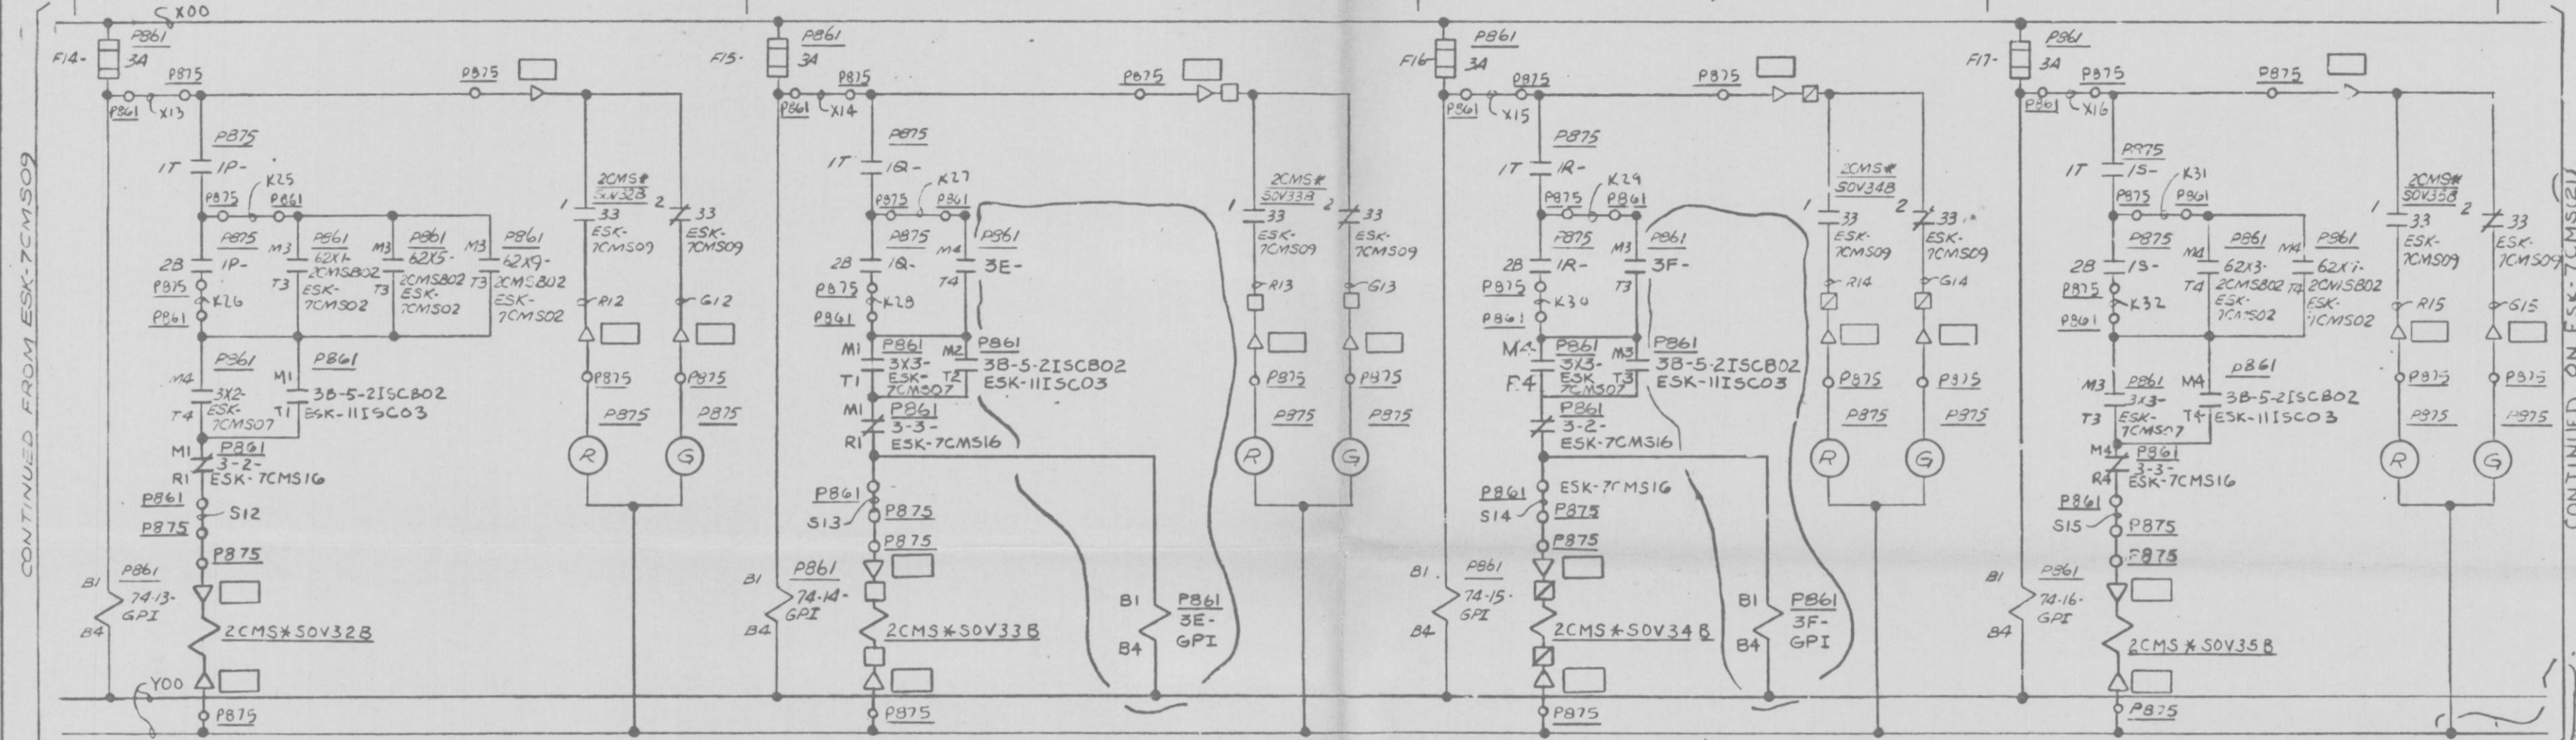

DIV II VALVES CKT-2CMSB03 (YELLOW)

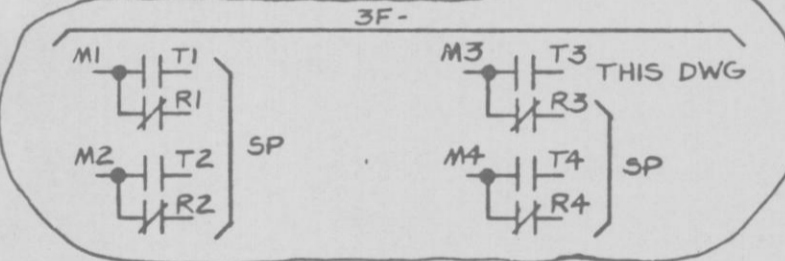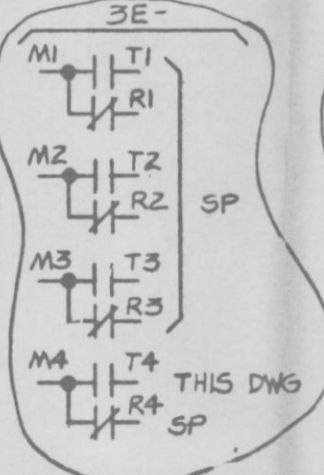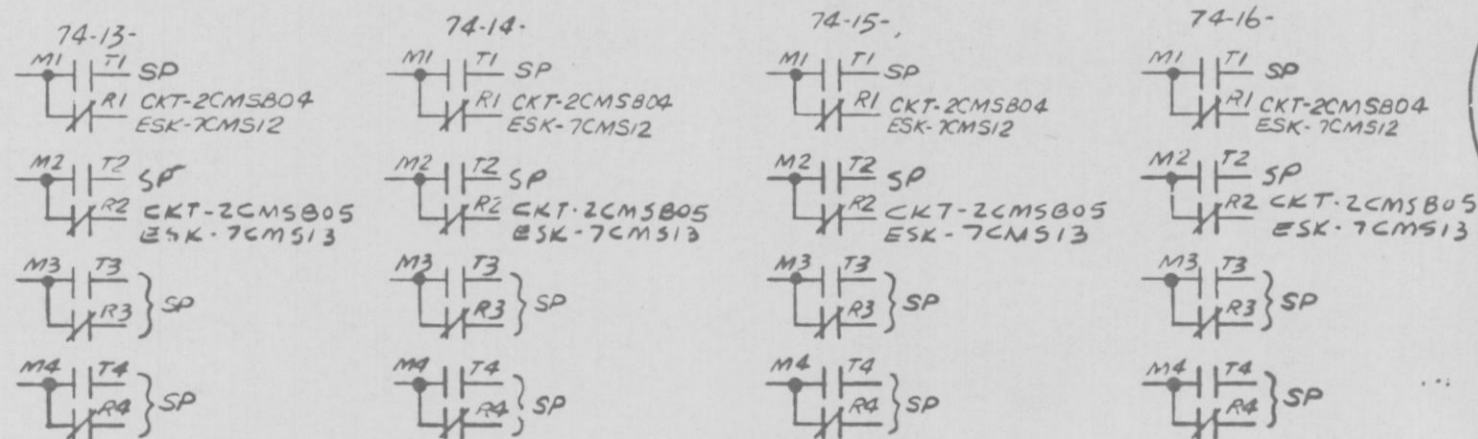

- NOTES:
1. ALL EQUIPMENT LOCATED AS NOTED.
 2. □ - INDICATES DW PEN.
 3. ▣ - INDICATES SUPPR CHAM. PEN.
 4. LOGIC DIAG LSK-33-2

PRC APERTURE CARD

NUCLEAR SAFETY RELATED
QA CAT I
AC ELEM DIAG 120V MISC CKTS
CONTAINMENT ATMOSPHERE MONITORING
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION
12177-ESK-7CMS10

DESIGN CONTROL ISSUE	REV	PCCC	PCCC
1-63d1	M	8/11/77	M
2-63d1	M	6-23-77	M
3-63d1	M	3-29-77	M
4-63d1	M	1-2-77	M
5-63d1	M	1-2-77	M
6-63d1	M	1-2-77	M
7-63d1	M	1-2-77	M

GE-NEED ✓ GE-LST6

D