
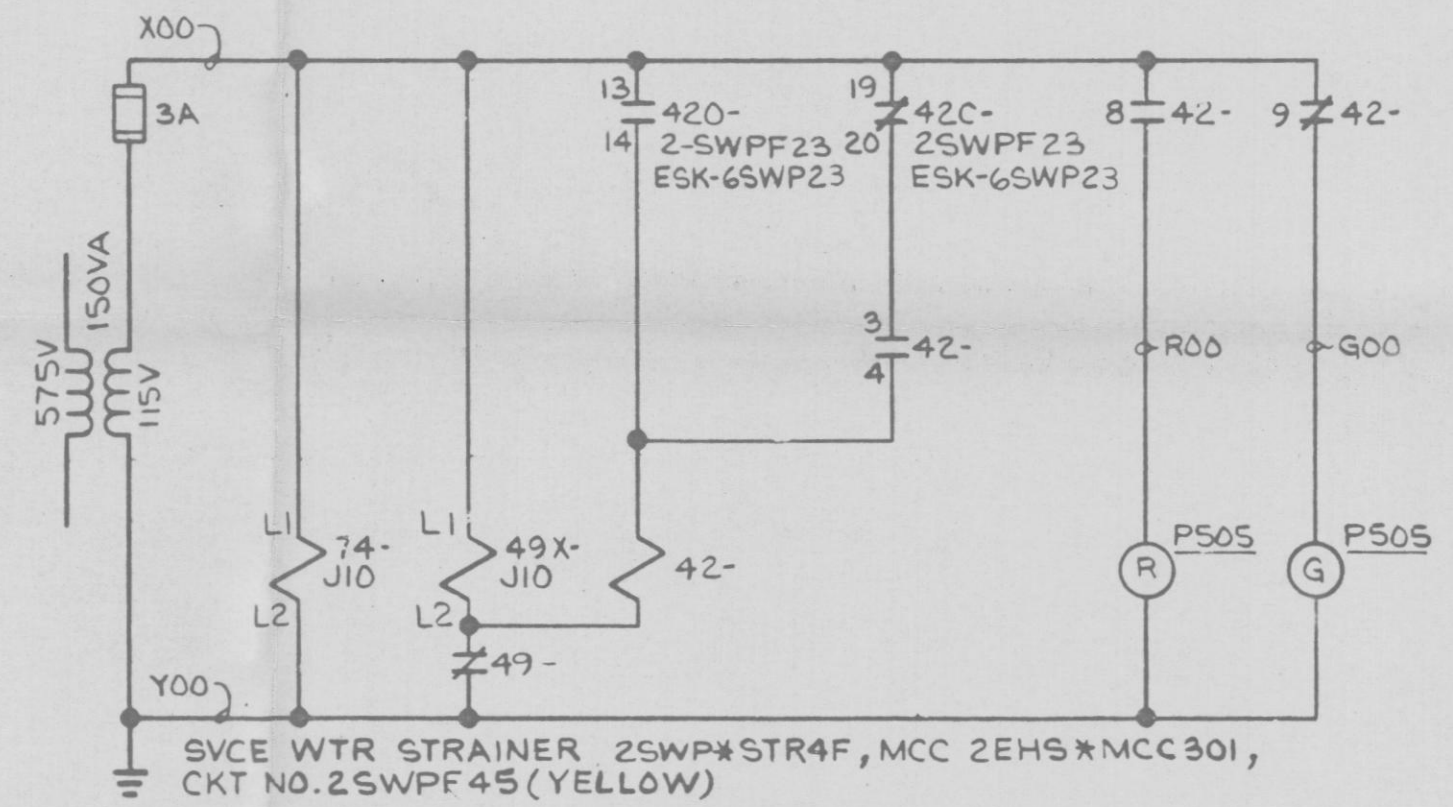


1

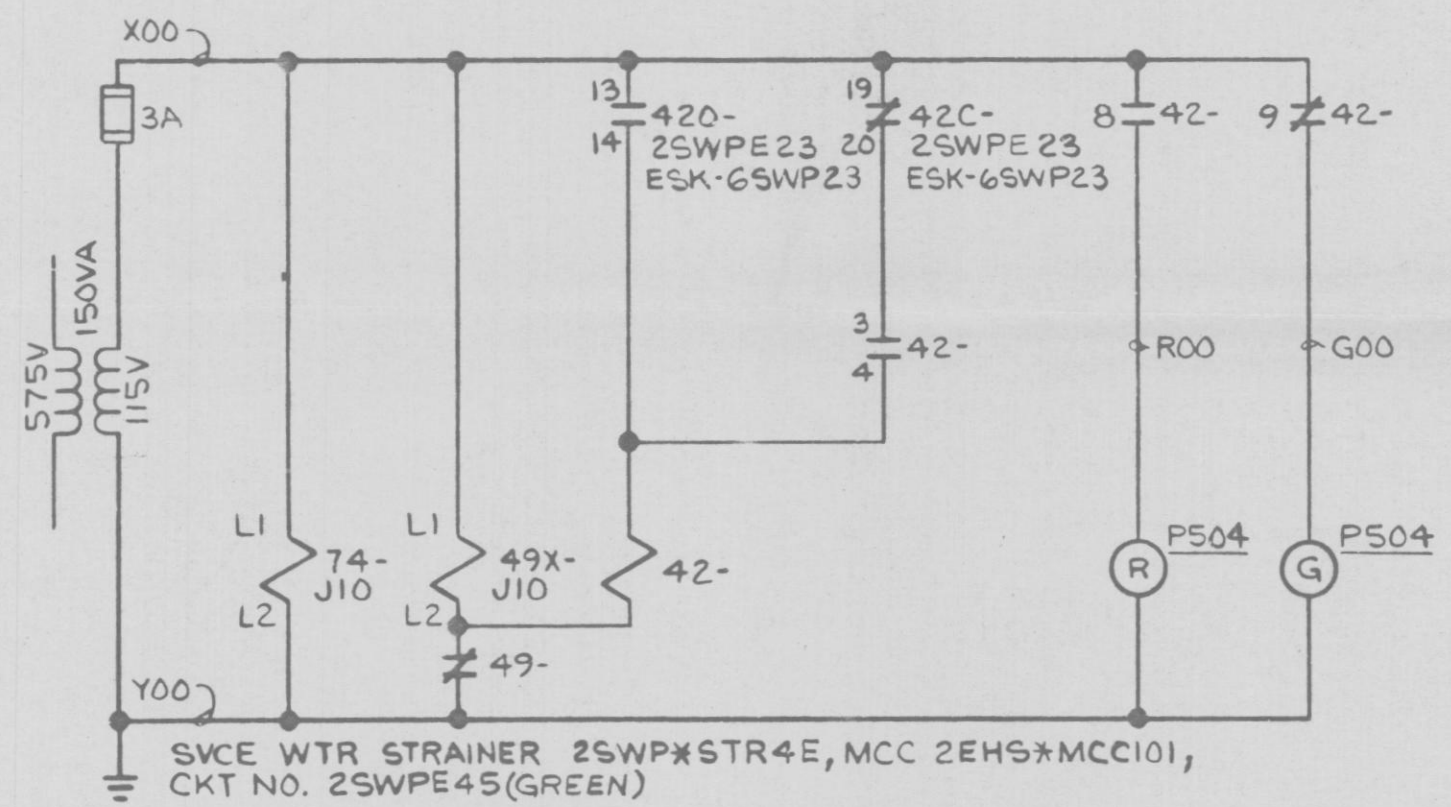

42-2SWPE45	49X-2SWPE45	74-2SWPE45
3 4	1 2 ALM NO.1539	1 2 ESK-7SWPI3 INOP
7 8 THIS DWG	3 4	3 4
9 10	5 6 SPARE	5 6 SPARE
10 11 SPARE	7 8	7 8
12 13		

42-2SWPF45	49X-2SWPF45	74-2SWPF45
3 4	1 2 ALM NO.1540	1 2 ESK-7SWPI4 INOP
7 8 THIS DWG	3 4	3 4
9 10	5 6 SPARE	5 6 SPARE
10 11 SPARE	7 8	7 8
12 13		

NOTES:  
 1. ALL EQUIPMENT LOCATED AT MCC  
 UNLESS OTHERWISE NOTED.  
 2. LOGIC DIAGRAM LSK-9-10E  
 3. P505- DENOTES 2CES-IPNL505

GE-MED  
 GE-LSTG

PRC  
 APERTURE  
 CARD

NUCLEAR SAFETY RELATED  
 QA CAT I  
 AC ELEM DIAG - 600Y MCC CKT  
 SERVICE WATER SYSTEM  
 NINE MILE POINT NUCLEAR STATION-UNIT 2  
 NIAGARA MOHAWK POWER CORPORATION  
 STONE & WEBSTER ENGINEERING CORPORATION  
 12177-ESK-6SWP40

7	6	5	4	3	2	1
---	---	---	---	---	---	---

DESIGN CONTROL ISSUE  
 M 5/4/81  
 JST

D