


PRC
APERTURE
CARD

CONTINUED FROM SH 1
POO
NOO
CKT NO. 2EGPB21

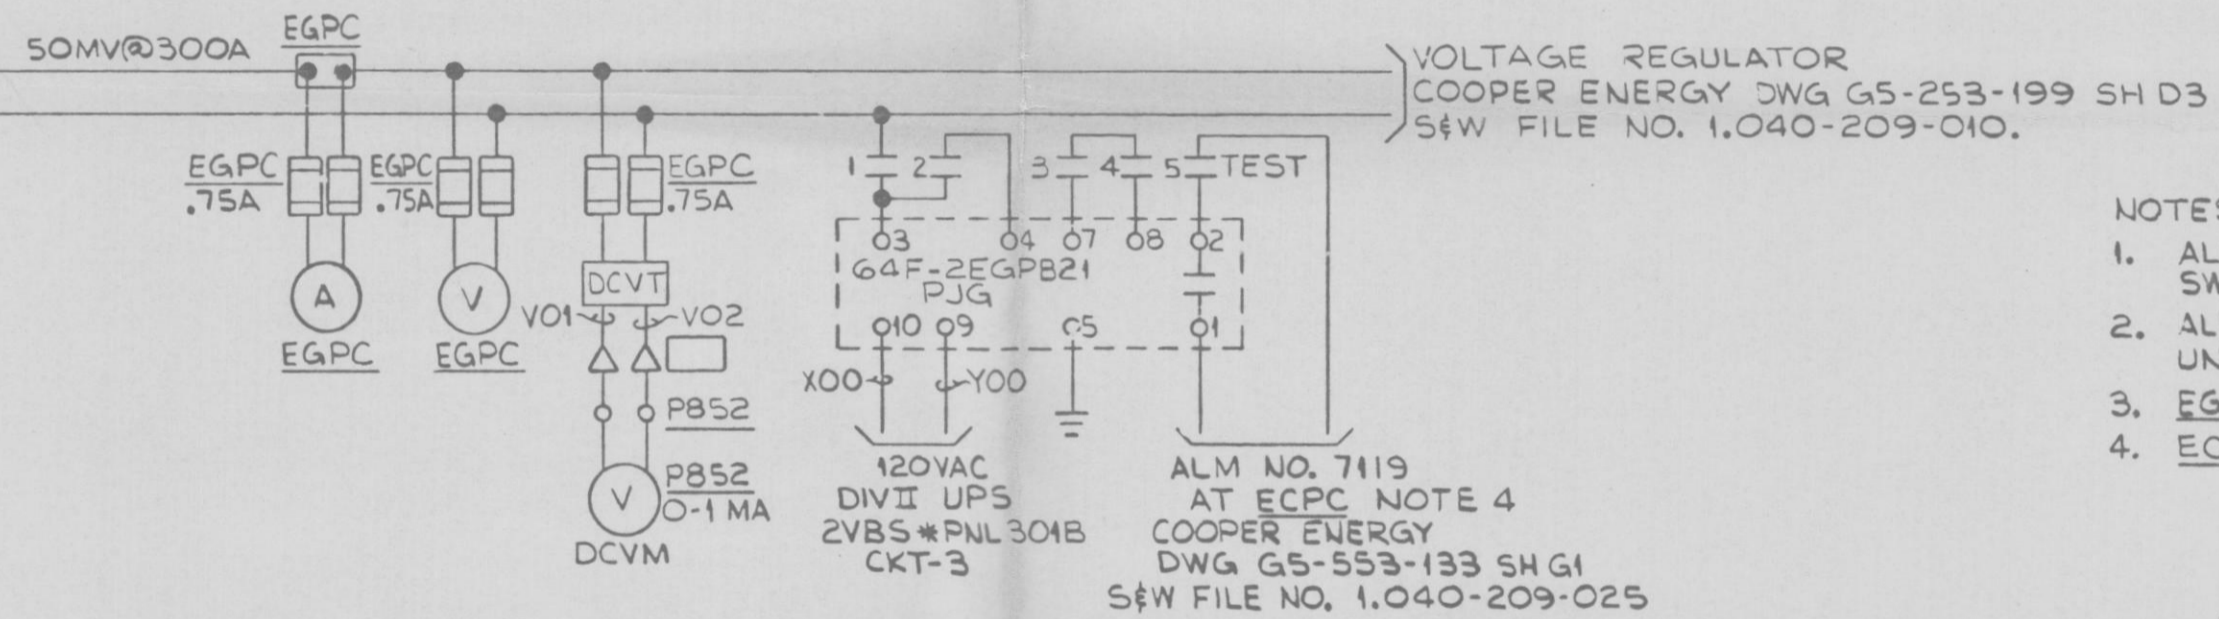

NOTES:

1. ALL EQUIPMENT LOCATED AT SWGR UNLESS OTHERWISE NOTED.
2. ALL CIRCUITS YELLOW UNLESS OTHERWISE NOTED.
3. EGPC: 2CEC*IPNL 412
4. ECPC: 2CEC*IPNL 408

TEST SWITCH GE 165B1 CH984555(-)V

CONTACT HANDLE	CONTACT END	(FV) POSITION		
		NORM	RESET	TEST
1	2	x		x
3	4		x	
5	6	x		
			x	x

CS	DETAIL	ESK	SPARE	USED ON
AS-2EGPB02	"E"	3A	-	-
	TEST SW DETAIL ON THIS DWG		6	-

12	11	10	9	8	7
----	----	----	---	---	---

NUCLEAR SAFETY RELATED
QA CAT I

AC ELEM DIAG CURRENT CKT
DIESEL GEN 2EGS*EG3 RLY & MTR
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-8EGPO3 SH 2 OF 2

D

GE LSTG
GE MED