
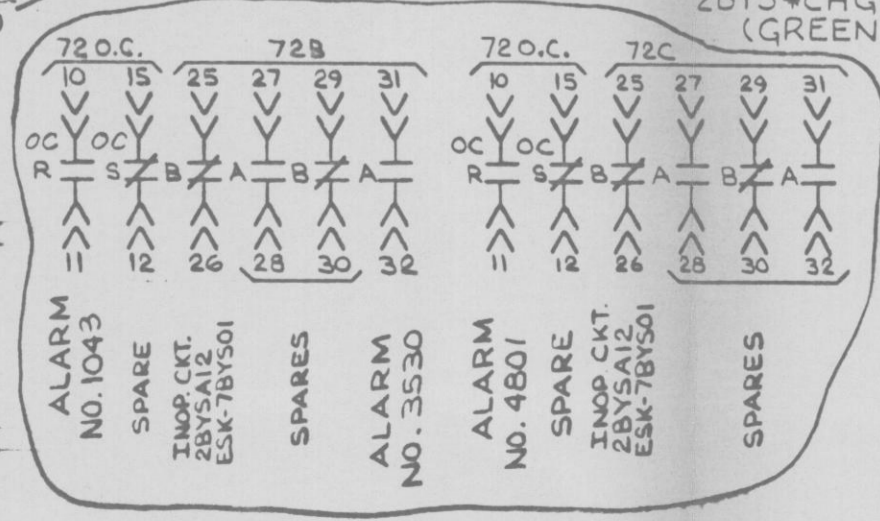


- NOTES:
1. ALL EQUIPMENT LOCATED AT SWGR UNLESS OTHERWISE NOTED.
  2. ▲-PART OF MULTICONDUCTOR SHIELDED CABLE GROUNDING AT P852

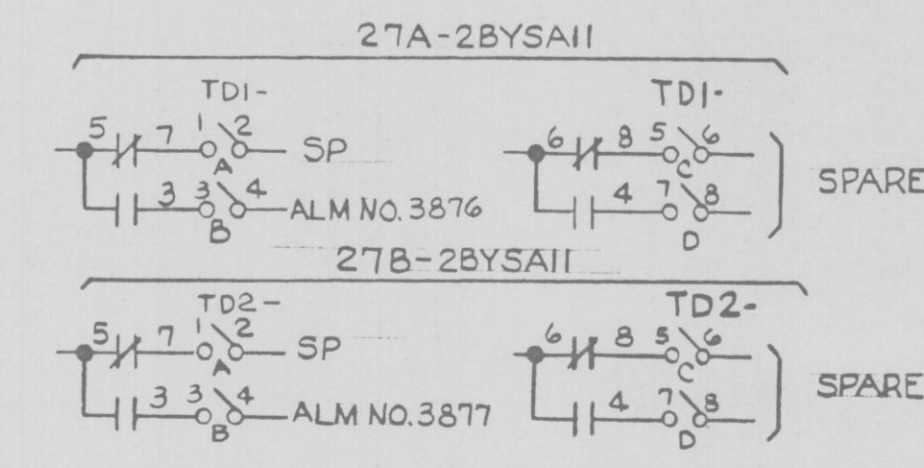

CS	DETAIL	ESK-	SPARES	USED ON
AS-	N7	3B	1B, 2B	
S-	N7	3B	1B, 2B	

NO CHANGE	DESIGN CONTROL ISSUE	REDRAWN
	5-29-82	7/1/82
ECN-003	003, 006	
007		

NUCLEAR SAFETY RELATED  
QA CAT I

DC ELEM DIAG-125VDC  
DC SWGR METERING

NINE MILE POINT NUCLEAR STATION-UNIT 2  
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-8BYS12

GE LISTG

GE MED

D