



1

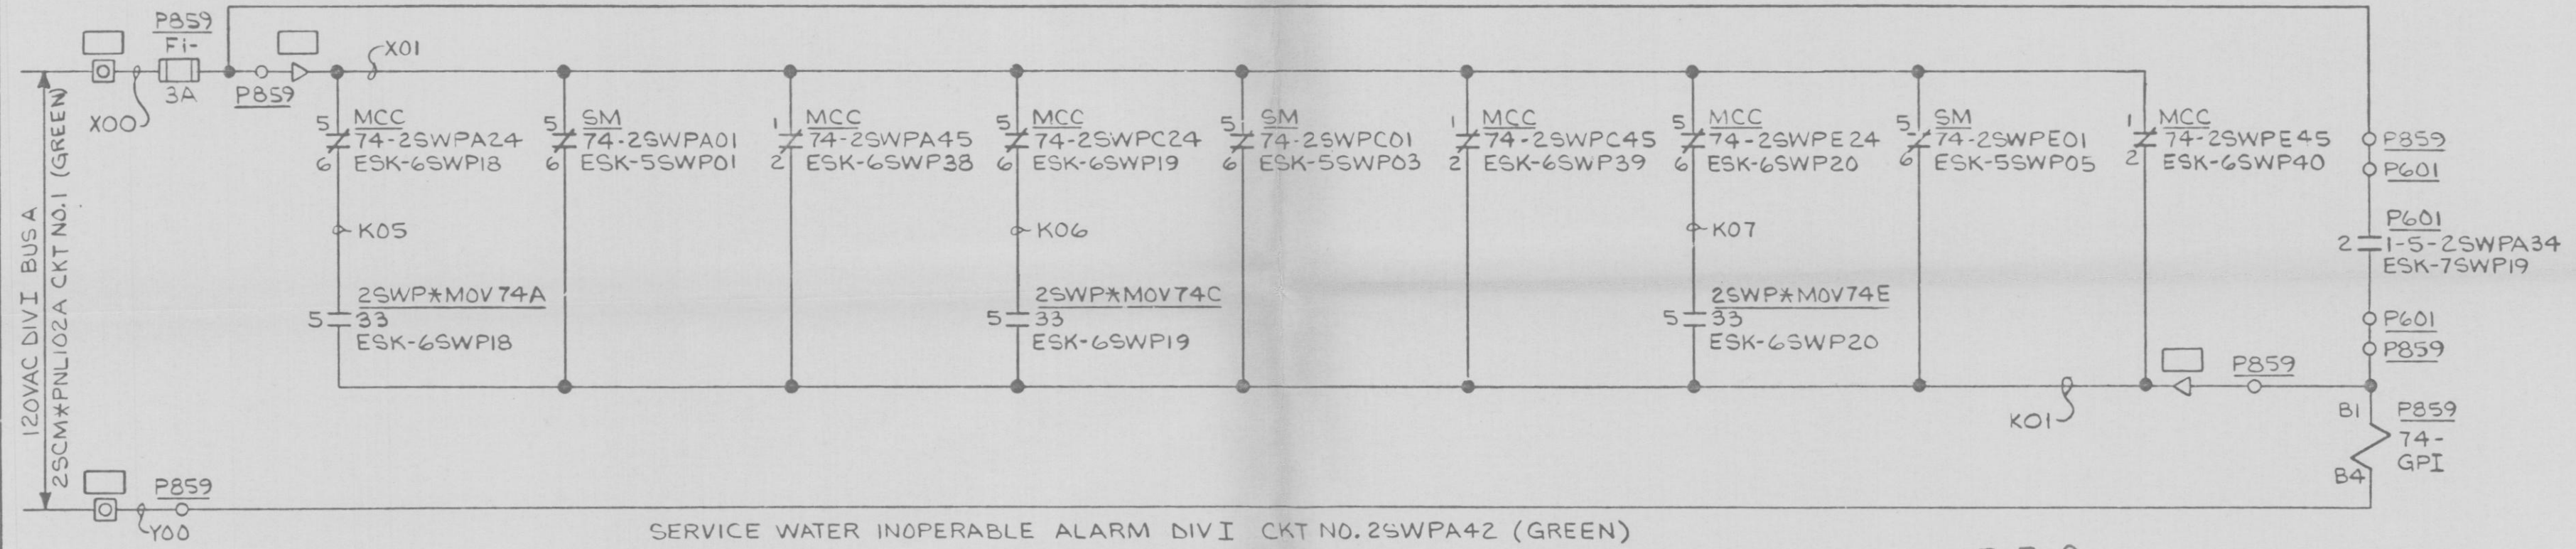

SERVICE WATER INOPERABLE ALARM DIV I CKT NO. 2SWPA42 (GREEN)

PRC
APERTURE
CARD

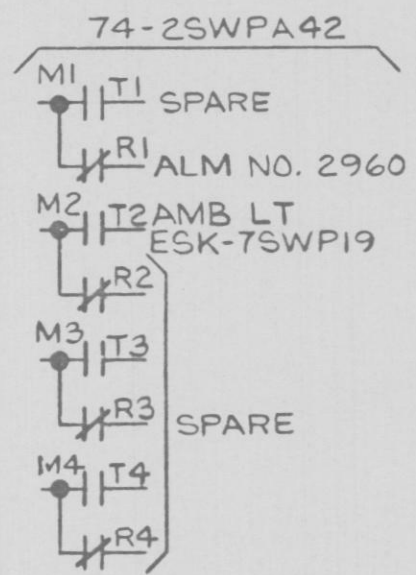

NOTE
1. LOGIC DIAGRAM LSK-9-10

NUCLEAR SAFETY RELATED
QA CAT I

REDRAWN
DESIGN
CONTROL
ISSUE

AC ELEM DIAG
SWT SYS INOP ALM DIV I
NINE MILE POINT NUCLEAR STATION - UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION

10	9	8	7	6	5	4
						12/1/81
						30
						JST



12177-ESK-7SWPI3

D

GE-MED
GE-LSTG