


REAC. BLDG. VENT SUPPLY CLR. V CKT-25WPN37 (BLACK)


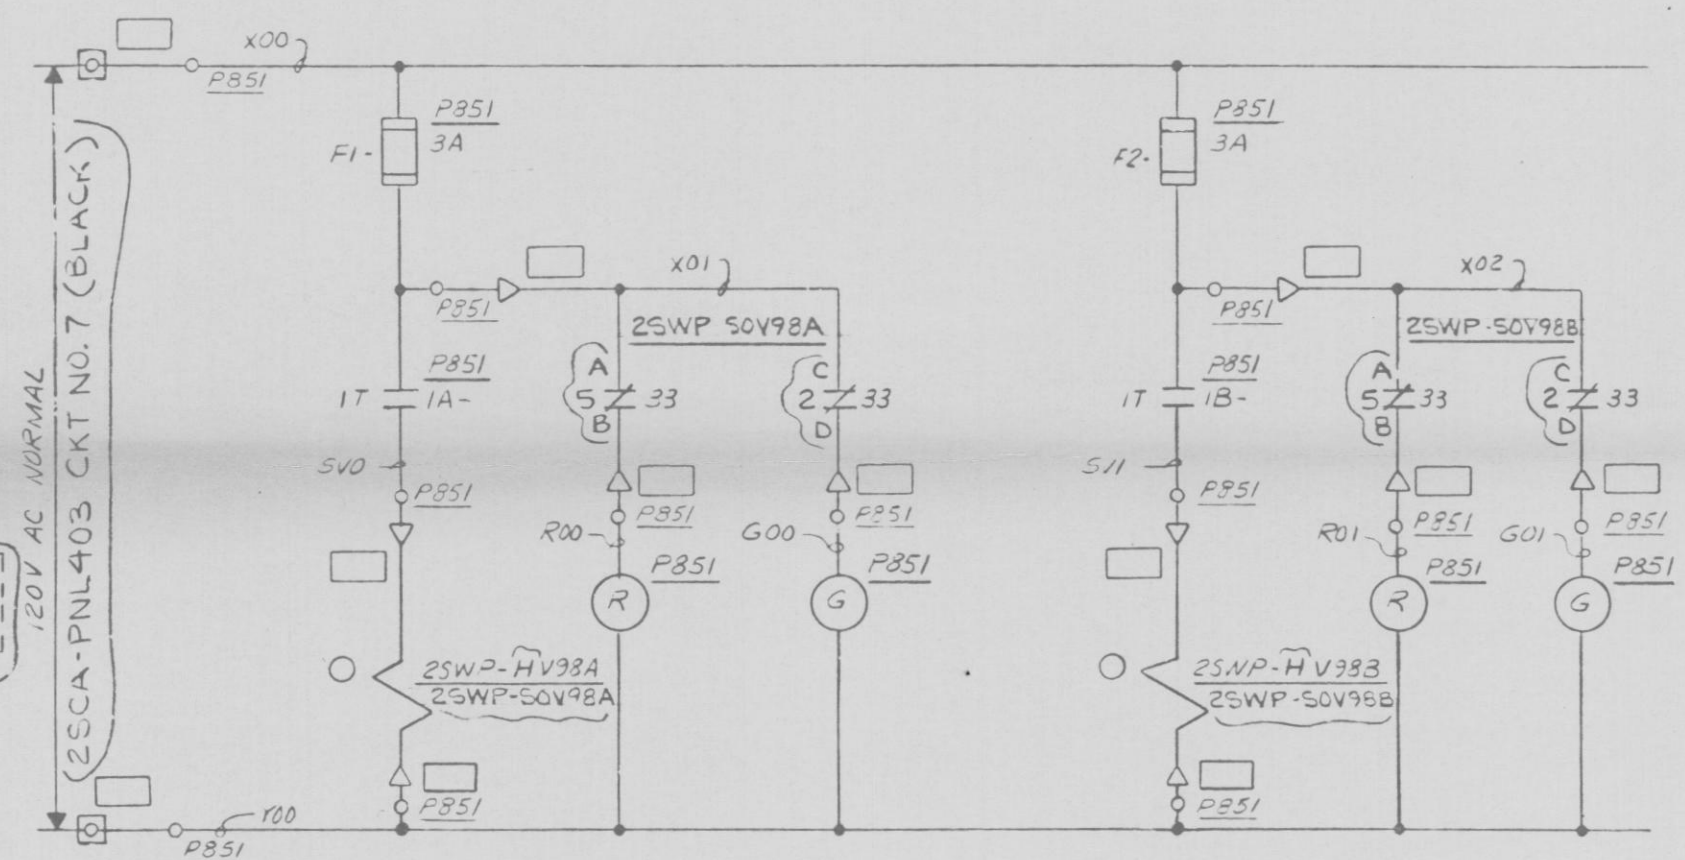


AIR REMOVAL 2ARC-PIA & PIB CLR. V CKT-25WPN38 (BLACK)

PRC APERTURE CARD

- NOTES:  
 1. LOGIC DIAGRAM LSK-9-10M  
 2. O-FAILS OPEN ON LOSS OF POWER.

		LIMIT SWITCH DEVELOPMENT					
		VALVE POSN		FUNCTION			
33		FULL OPEN	FULL CLOSE	2SWP-HV568	2SWP-HV569	2SWP-HV98A	2SWP-HV98B
OPEN END	1	A	B			SPARE	SPARE
	2	C	D			GRN LT	GRN LT
	3	E	F			SPARE	SPARE
	4	G	H			SPARE	SPARE
CLOSE END	5	A	B			RED LT	RED LT
	6	C	D			SPARE	SPARE
	7	E	F			SPARE	SPARE
	8	G	H			SPARE	SPARE

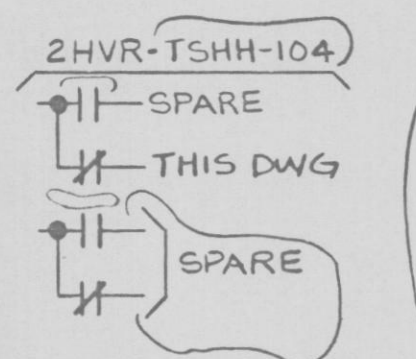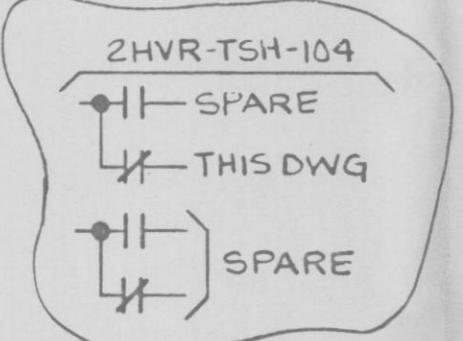

CS	DETAIL	ESK	SPARES	USED ON
1A-25WPN38	G	3B	2T	
1B-25WPN38	G	3B	2T	

DESIGN CONTROL ISSUE	REV	PGCC	PGCL
3/6/77	M	6-8-77	M
3/30/77	M	FC	I
3/30/77	M	FC	I

QA CAT II  
 AC ELEM DIAG MISC AC CKTS  
 SERVICE WATER COOLER VALVES  
 NINE MILE POINT NUCLEAR STATION-UNIT 2  
 NIAGARA MOHAWK POWER CORPORATION  
 STONE & WEBSTER ENGINEERING CORPORATION  
 12177-ESK-7SWP09

D