


1

HIGH PRESSURE CORE SPRAY MINIMUM FLOW  
BYPASS TO SUPPRESSION POOL 2CSH\*MOV105  
(E22-FO12)  
VALVE OPEN WHEN HPCS PUMP DISCH PRESS IS  
NOT LOW. CLOSED FOR ALL OTHER MODES

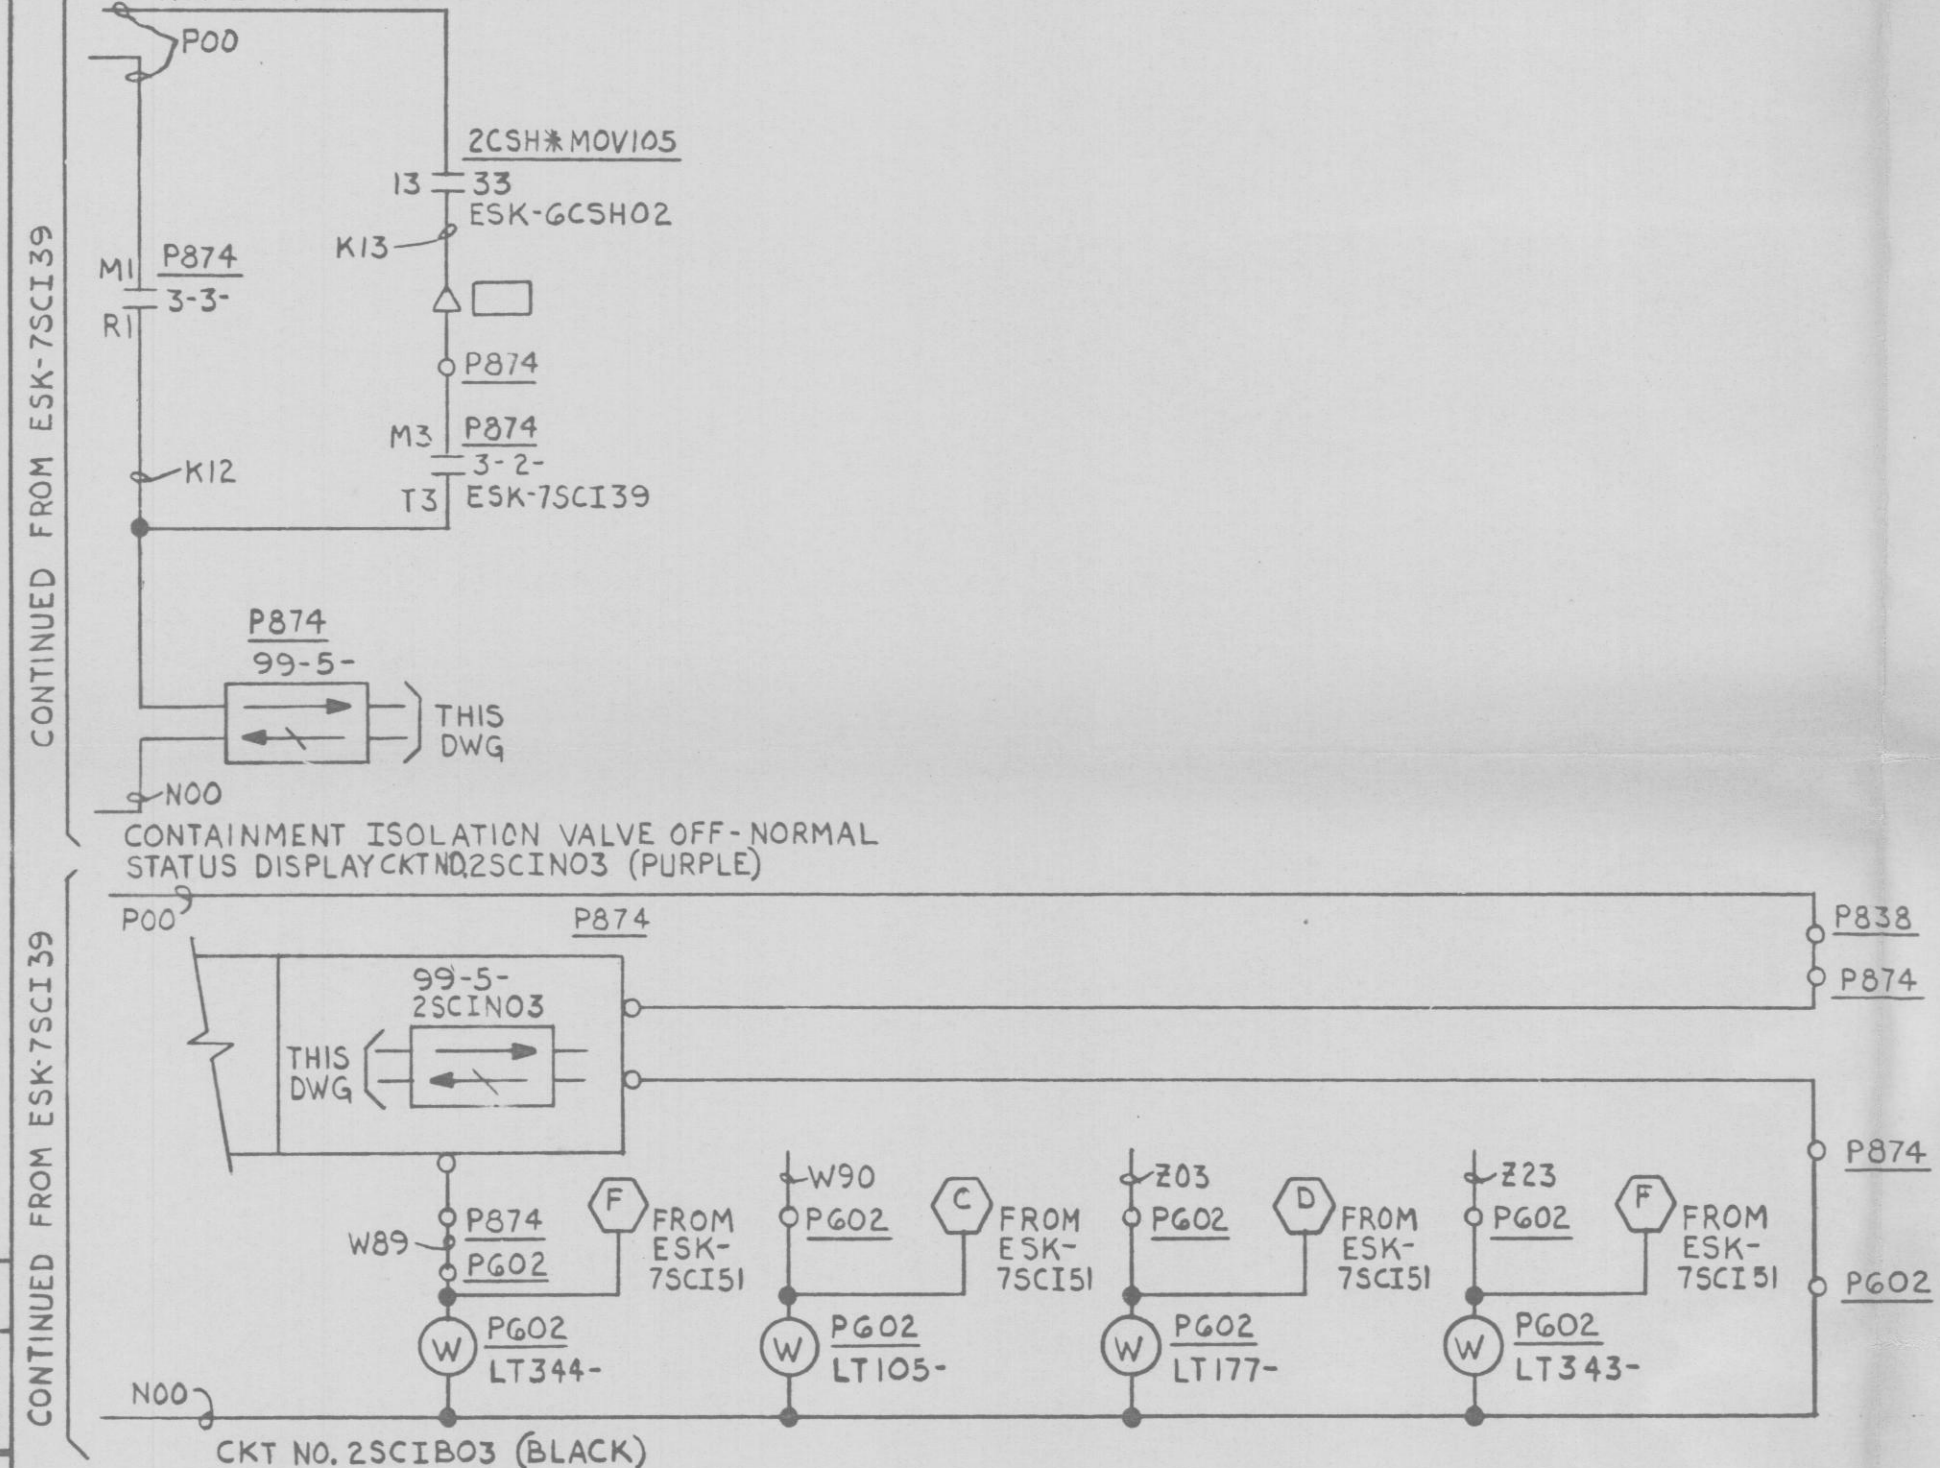

PRC  
APERTURE  
CARD

NUCLEAR SAFETY RELATED  
QA CAT I, II

DC ELEM DIAG - MISC DC CIRCUITS  
OFF-NORMAL STATUS DISPLAY  
NINE MILE POINT NUCLEAR STATION-UNIT 2  
NIAGARA MOHAWK POWER CORPORATION  
STONE & WEBSTER ENGINEERING CORPORATION

DESIGN  
CONTROL  
ISSUE

1/3/81



12177-ESK-7SCI45

7	6	5	4	3	2	1
---	---	---	---	---	---	---

D

GE-15TG  
GE-NED