



CONTINUED FROM ESK-7SCI37

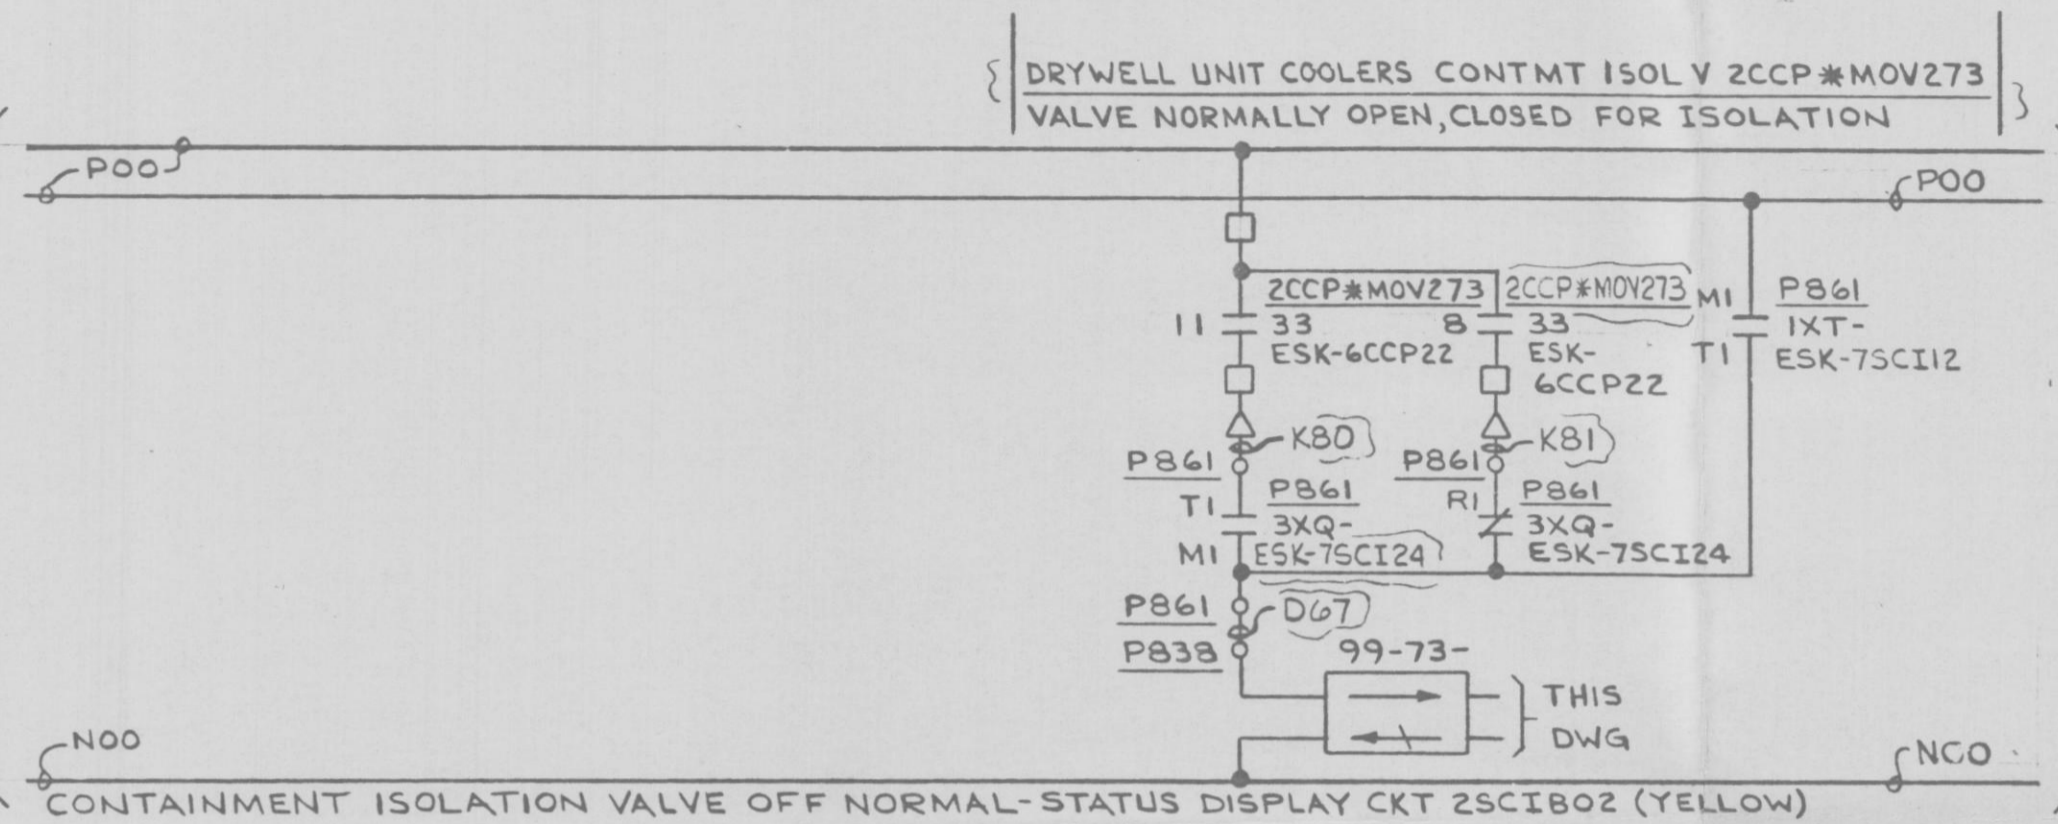

CONTINUED FROM ESK-7SCI37

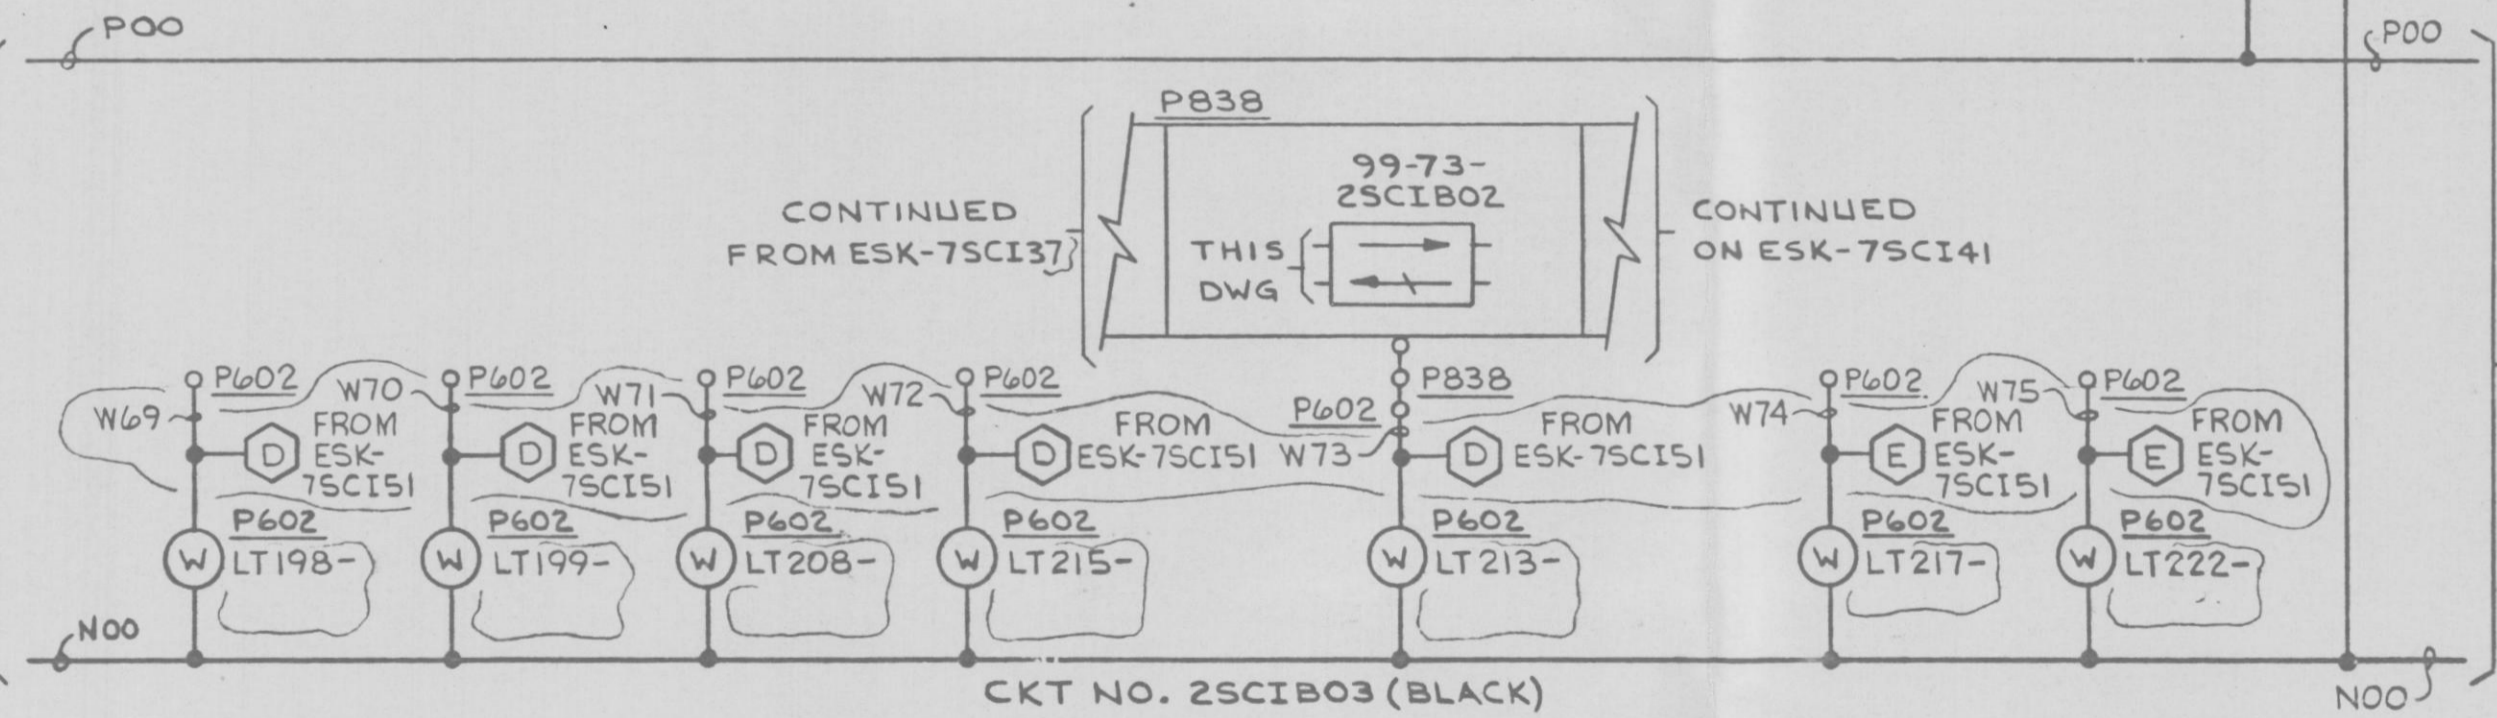

NOTES:  
I. □ - INDICATES DRYWELL PENETRATION.

NUCLEAR SAFETY RELATED  
QA CAT I, II

DC ELEM DIAG - MISC DC CKTS  
OFF NORMAL STATUS DISPLAY  
NINE MILE POINT NUCLEAR STATION-UNIT 2  
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION  
12177-ESK-7SCI38

DESIGN CONTROL ISSUE	REDRAWN
3	1-12-79
RK	APM

8	7	6	5	4	3	2	1
---	---	---	---	---	---	---	---

D