


PRC
APERTURE
CARD

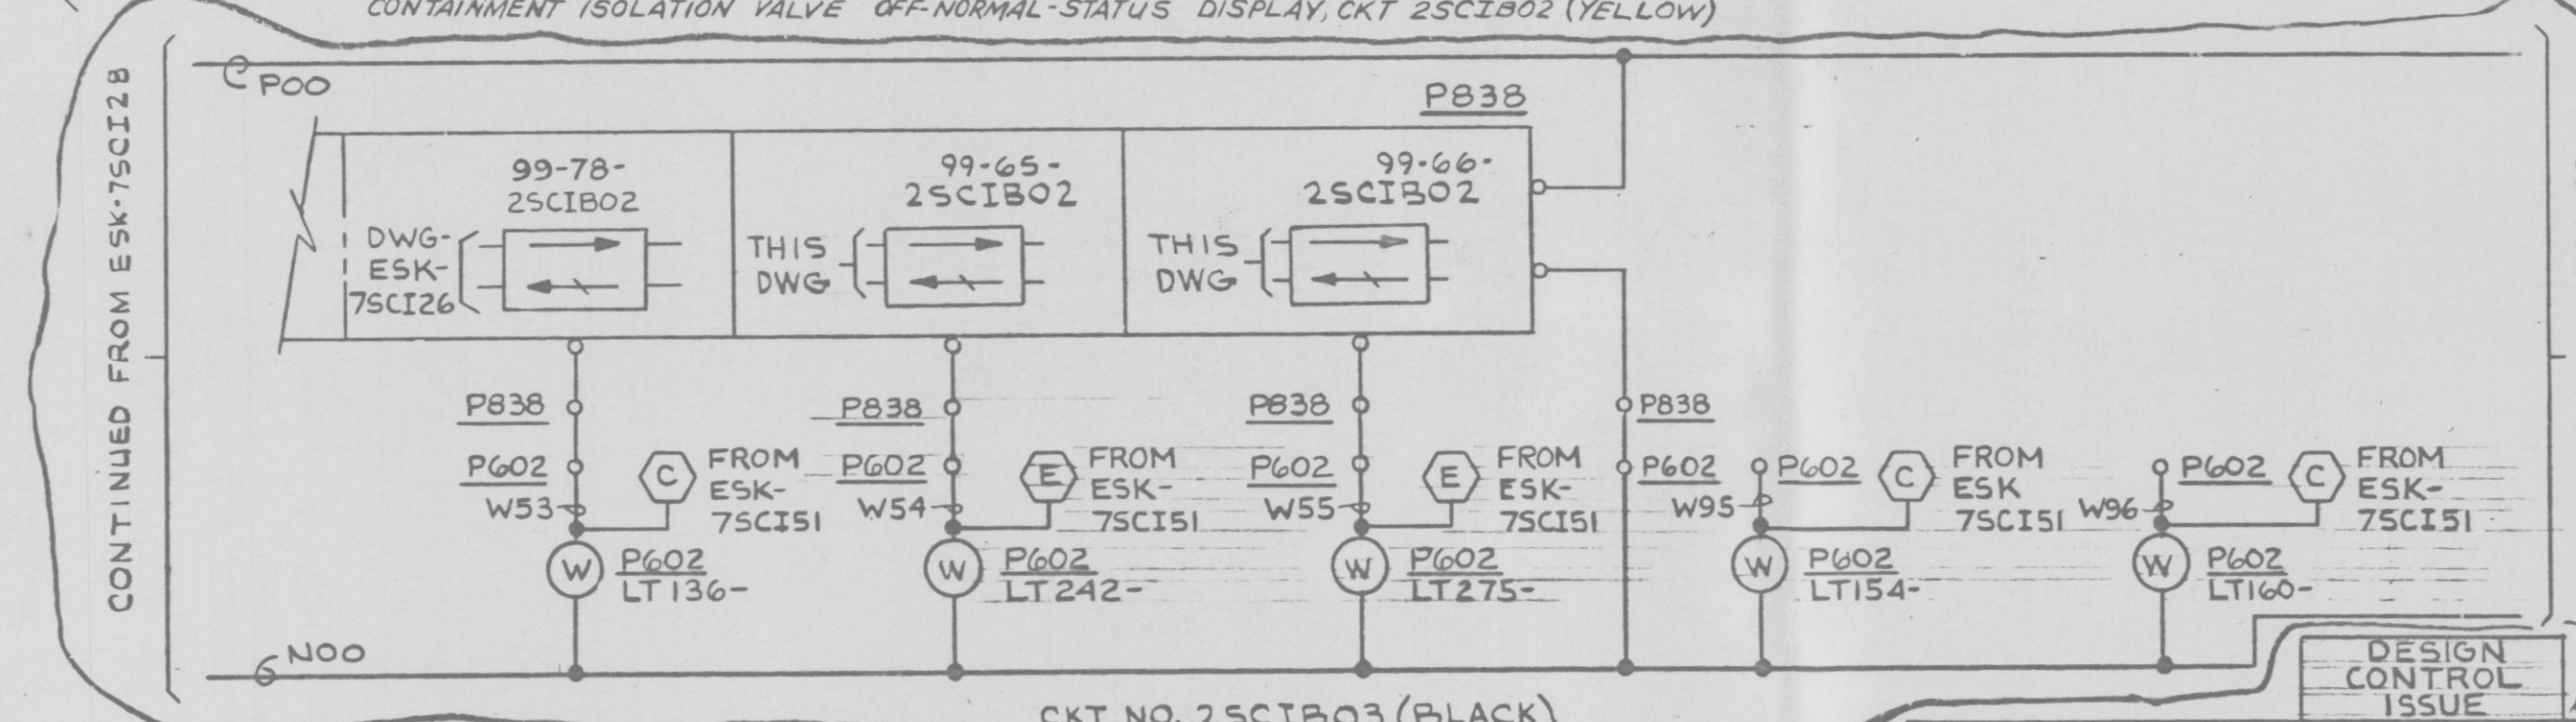

- NOTES:
- - INDICATES DRYWELL PENETRATION
 - ▣ - SUPPRESSION CHAMBER PENETRATION

NUCLEAR SAFETY RELATED
QA CAT I, II
DC ELEM DIAG-MISC DC CIRCUITS
OFF-NORMAL-STATUS DISPLAY
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

DESIGN CONTROL ISSUE		REV POES PGCC	
1	4/30/81	2	1-2-78
2	INCORP	3	6-9-77
3	IE & DCR		
4	940390		

6	5	4	3	2	1
---	---	---	---	---	---

STONE & WEBSTER ENGINEERING CORPORATION
12177-ESK-7SCI30

GE-MED
GE-LST6

D