



1


INSTR AIR CNTMT ISOL V 2IAS\*50V166,167 & 169  
VALVES CLOSED FOR ISOLATION AND LOW-LOW INSTR AIR PRESS

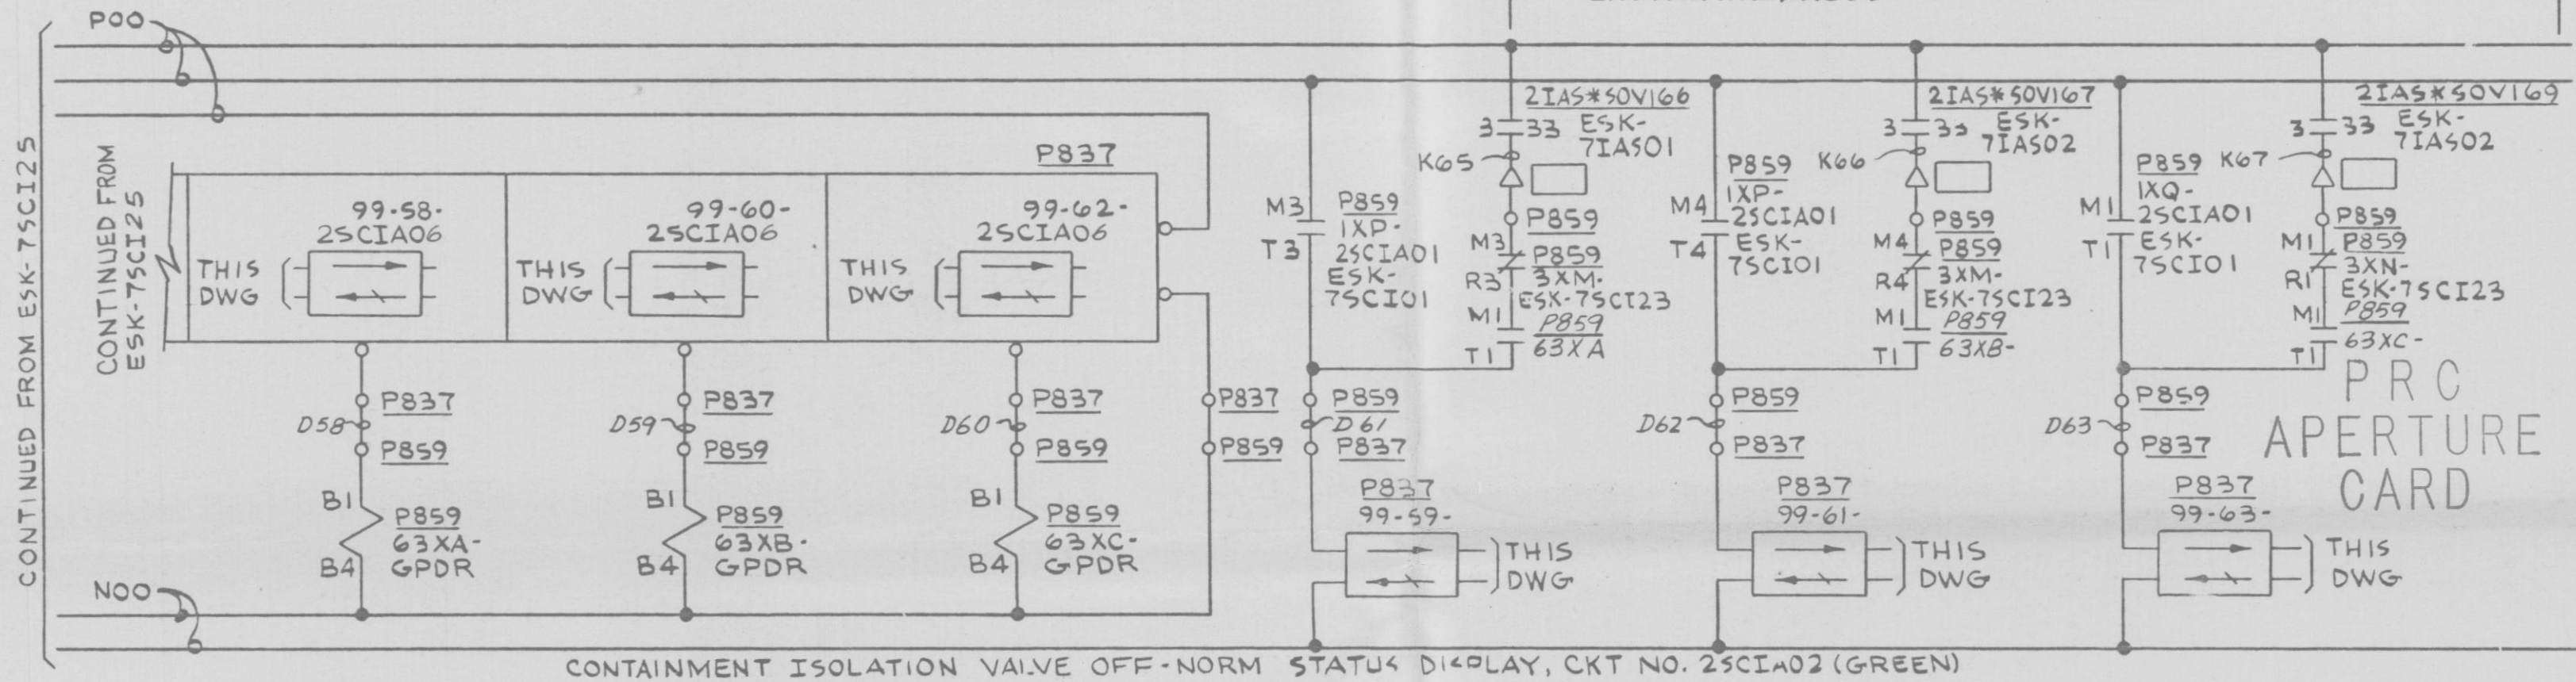


CONTAINMENT ISOLATION VALVE OFF-NORM STATUS DISPLAY, CKT NO. 25CIA02 (GREEN)

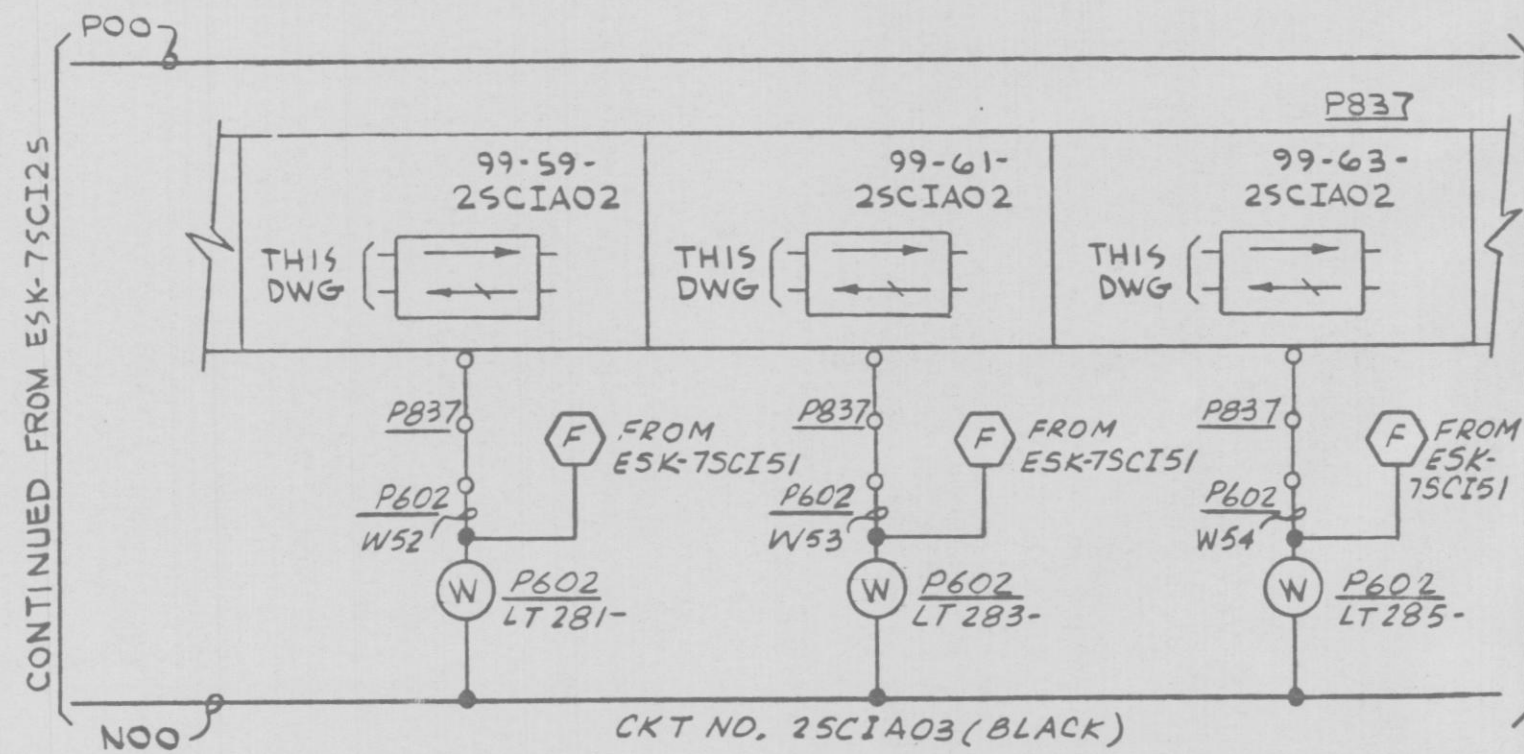

CKT NO. 25CIA03 (BLACK)

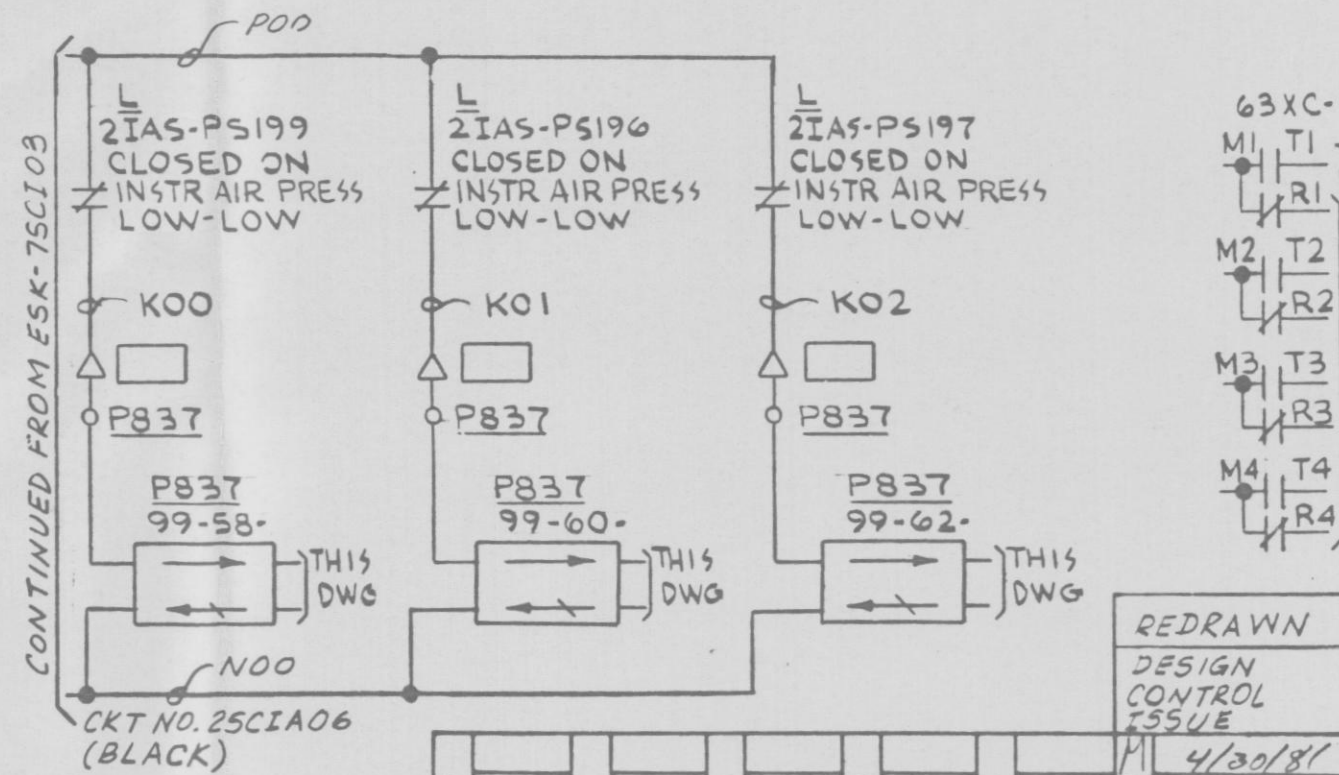

CKT NO. 25CIA06 (BLACK)

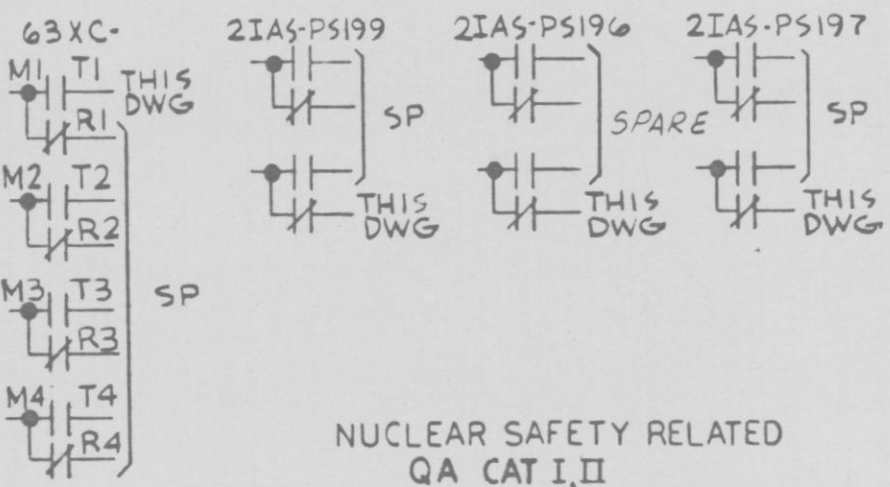

NUCLEAR SAFETY RELATED  
QA CAT I, II

DC ELEM DIAG-MISC DC CKTS  
OFF-NORMAL STATUS DISPLAY  
NINE MILE POINT NUCLEAR STATION-UNIT 2  
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-7SCI27

REDRAWN  
DESIGN  
CONTROL  
ISSUE  
4/30/81  
3 INCORP  
E12CA  
G 40390

APM/DM

▲ 12177

D

GE MED ✓ GE-LSIG

CONTINUED FROM ESK-7SCI25

CONTINUED FROM ESK-7SCI25

CONTINUED FROM ESK-7SCI25

CONTINUED ON ESK-7SCI29

CONTINUED FROM ESK-7SCI03

CONTINUED ON ESK-7SCI29

63XA- THIS DWG

63XB- THIS DWG

63XC- THIS DWG