

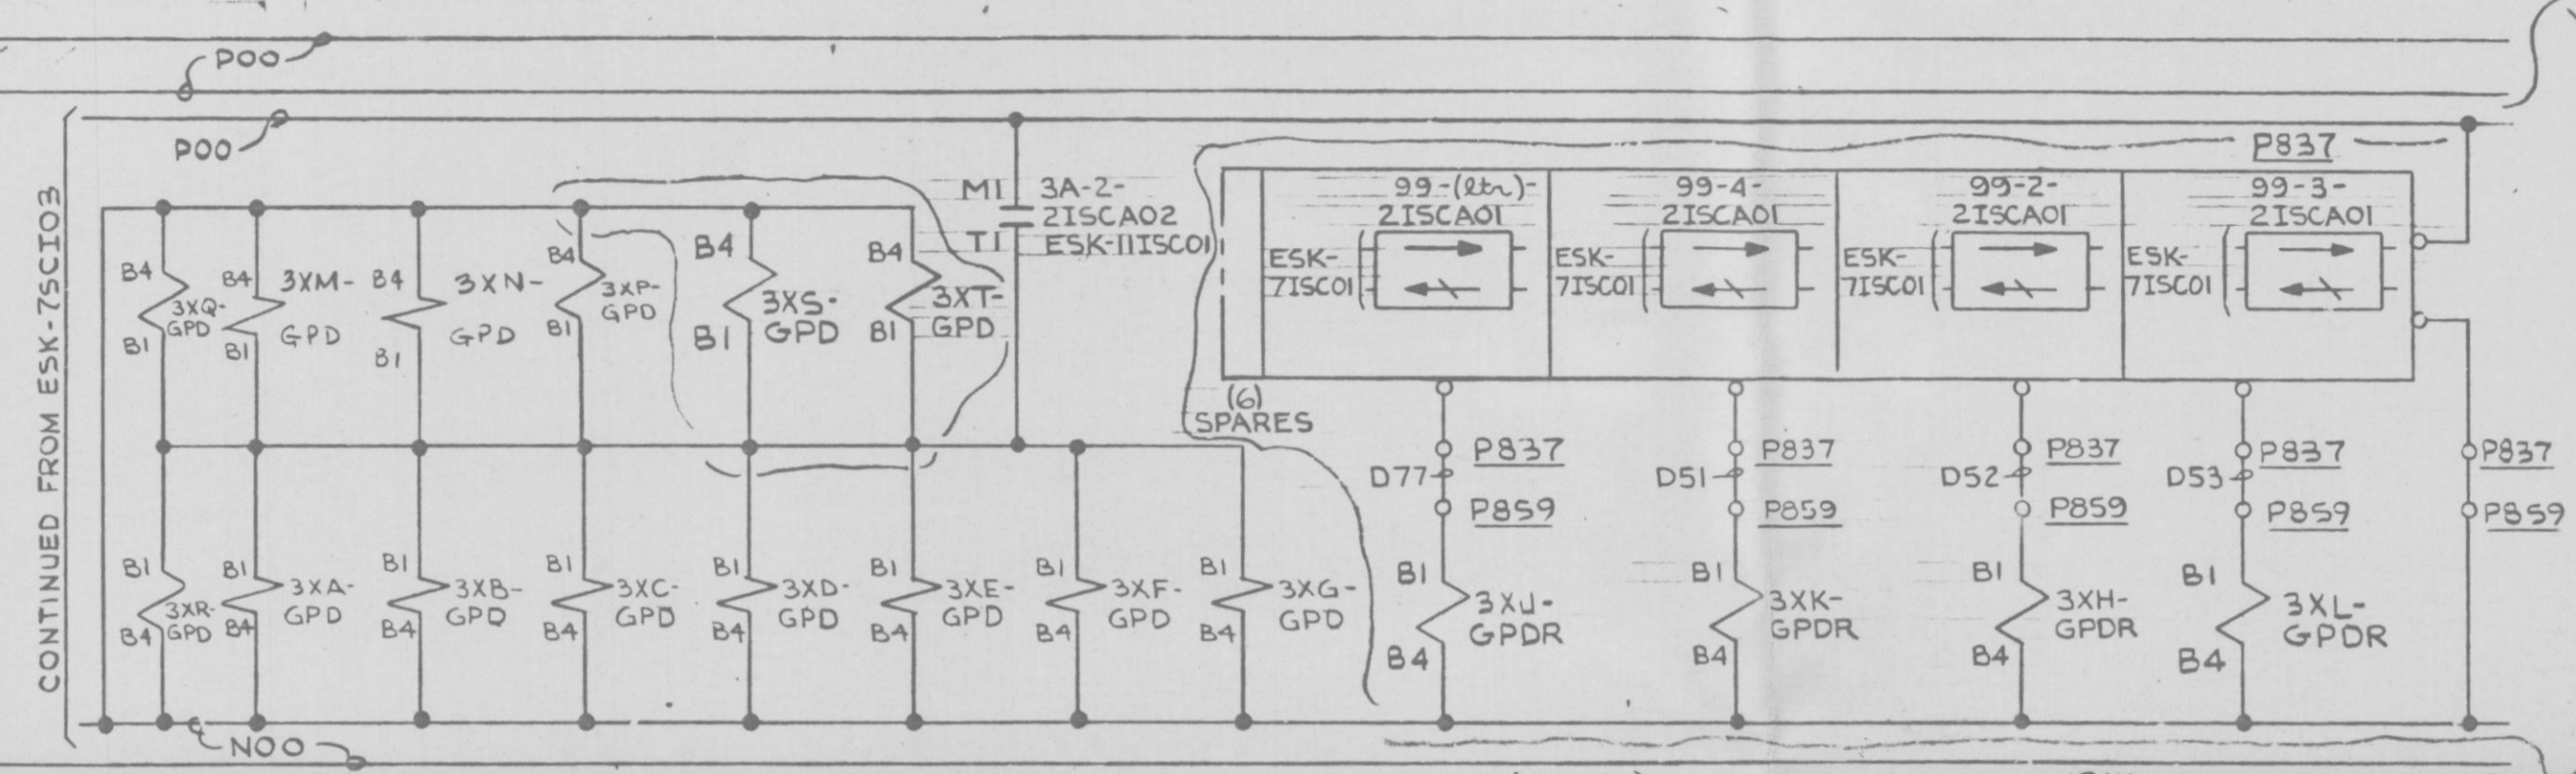
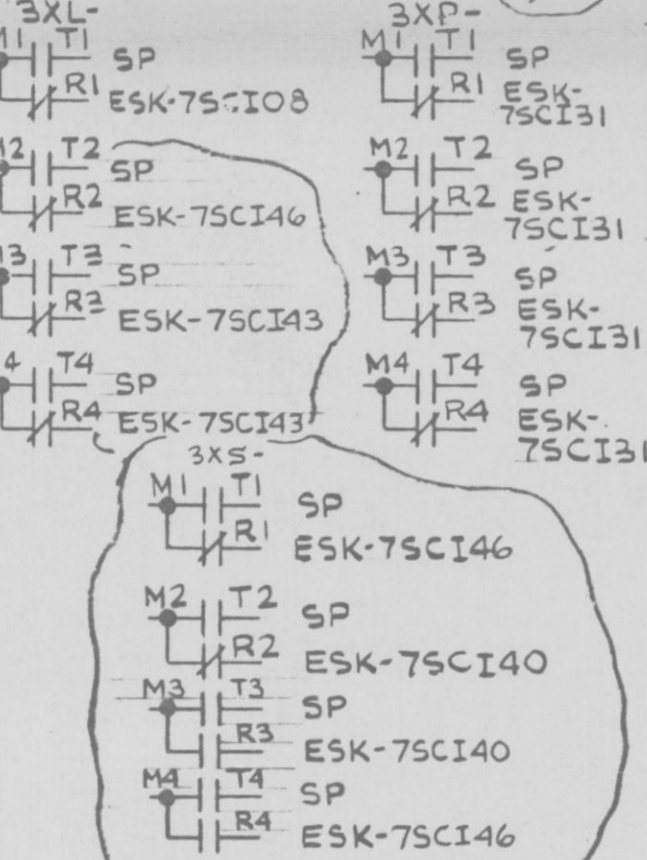
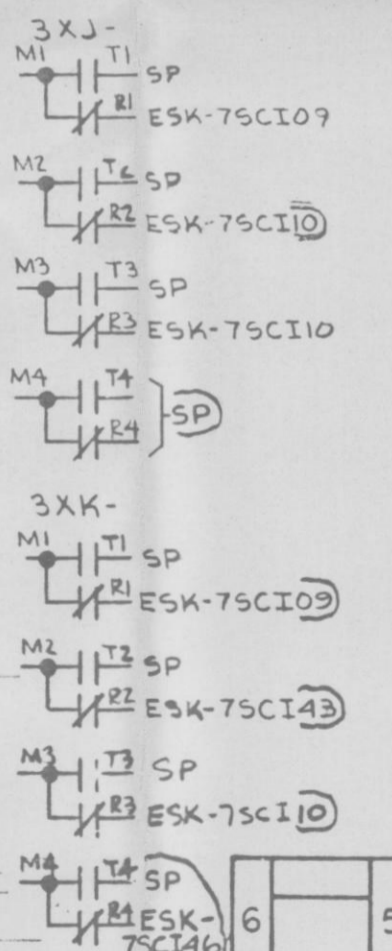
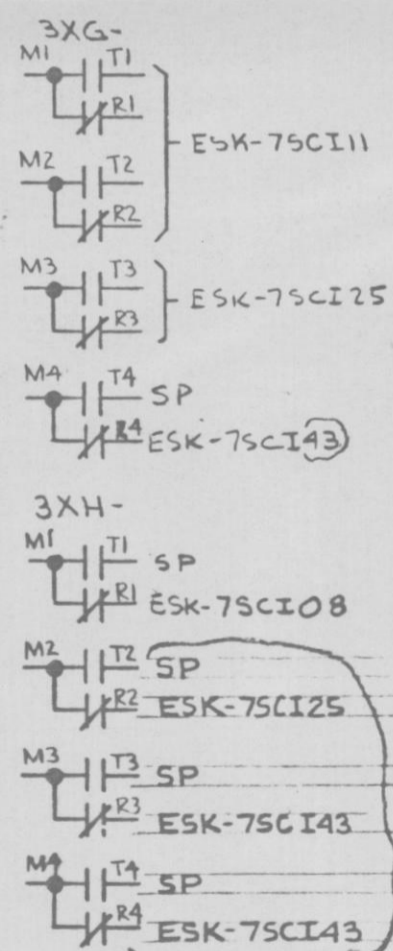
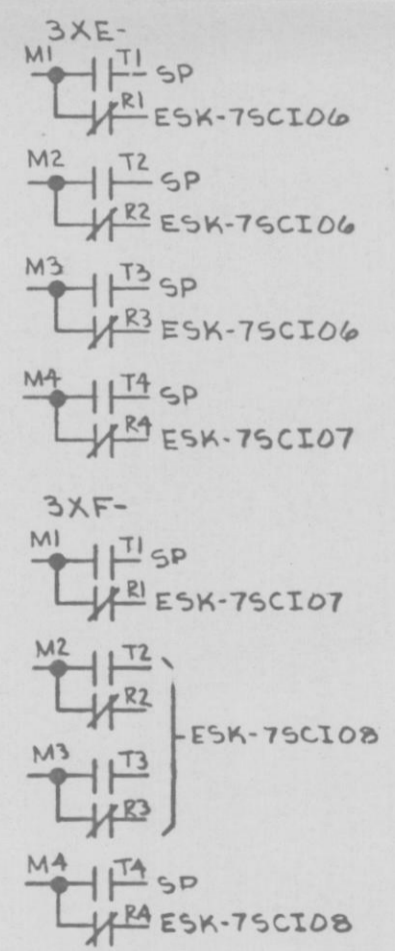
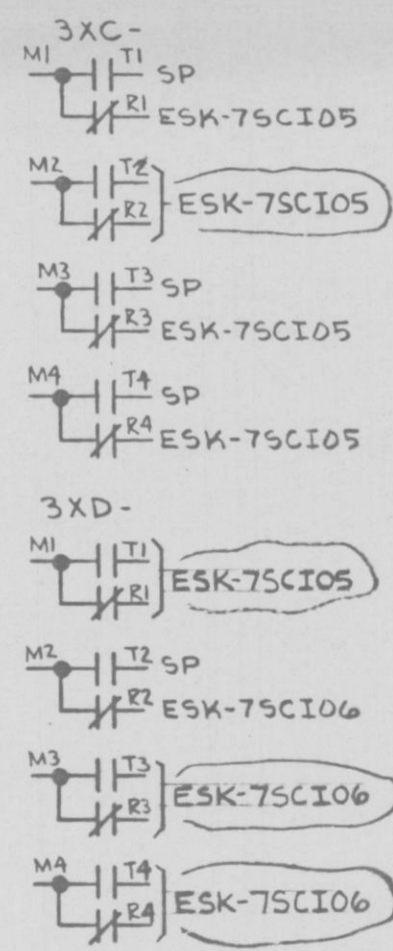


CONTINUED FROM ESK-75CIIII

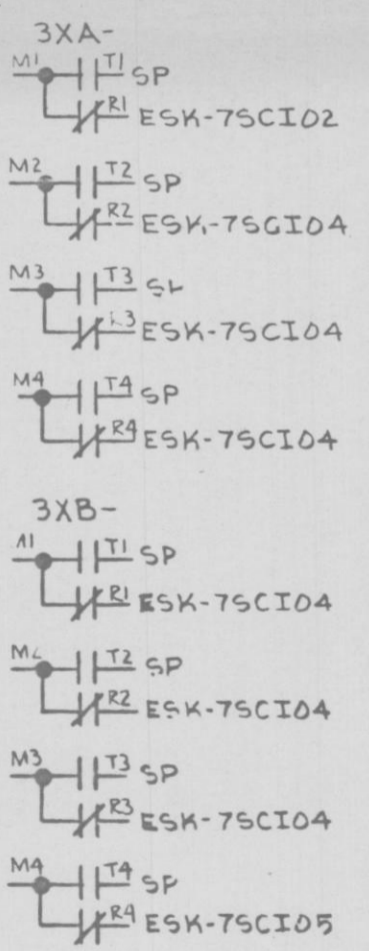

CONTAINMENT ISOL VALVE OFF NORMAL STATUS DISPLAY, CKT 25CIA02 (GREEN)

CONTINUED ON ESK-75C125

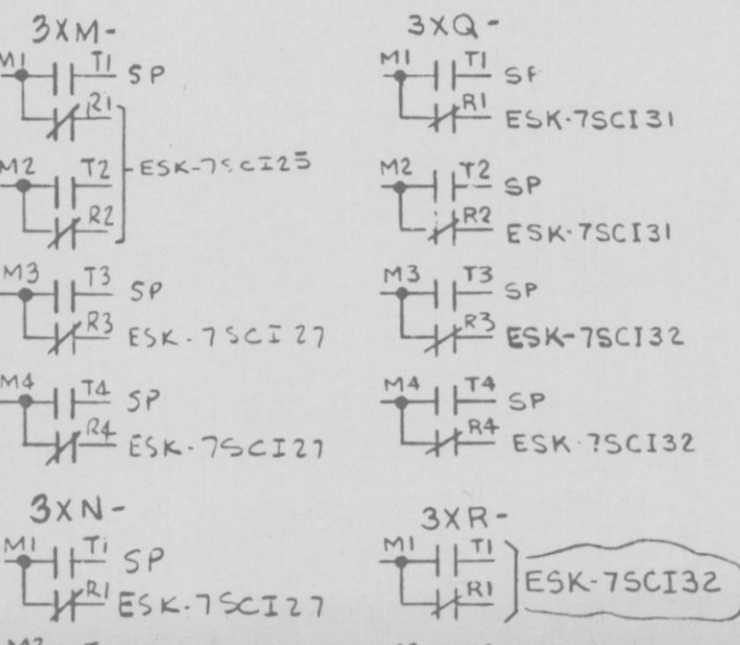

**PRC APERTURE CARD**

NOTE:  
1. ALL EQUIPMENT LOCATED AT P859 UNLESS OTHERWISE NOTED.

NUCLEAR SAFETY RELATED  
QA CAT I

DC ELEM DIAG-MISC DC CIRCUITS  
OFF-NORMAL-STATUS DISPLAY  
NINE MILE POINT NUCLEAR STATION-UNIT 2  
NIAGARA MOHAWK POWER CORPORATION

Stone & Webster Engineering Corporation  
12177-ESK-75C123

DESIGN CONTROL ISSUE	REV	PGCC	PGCC
3	4/30/77	1	6-9-77
INCORP EFD CR 640210		2	

6 5 4

GE-NEE ✓ GE-1516

D