
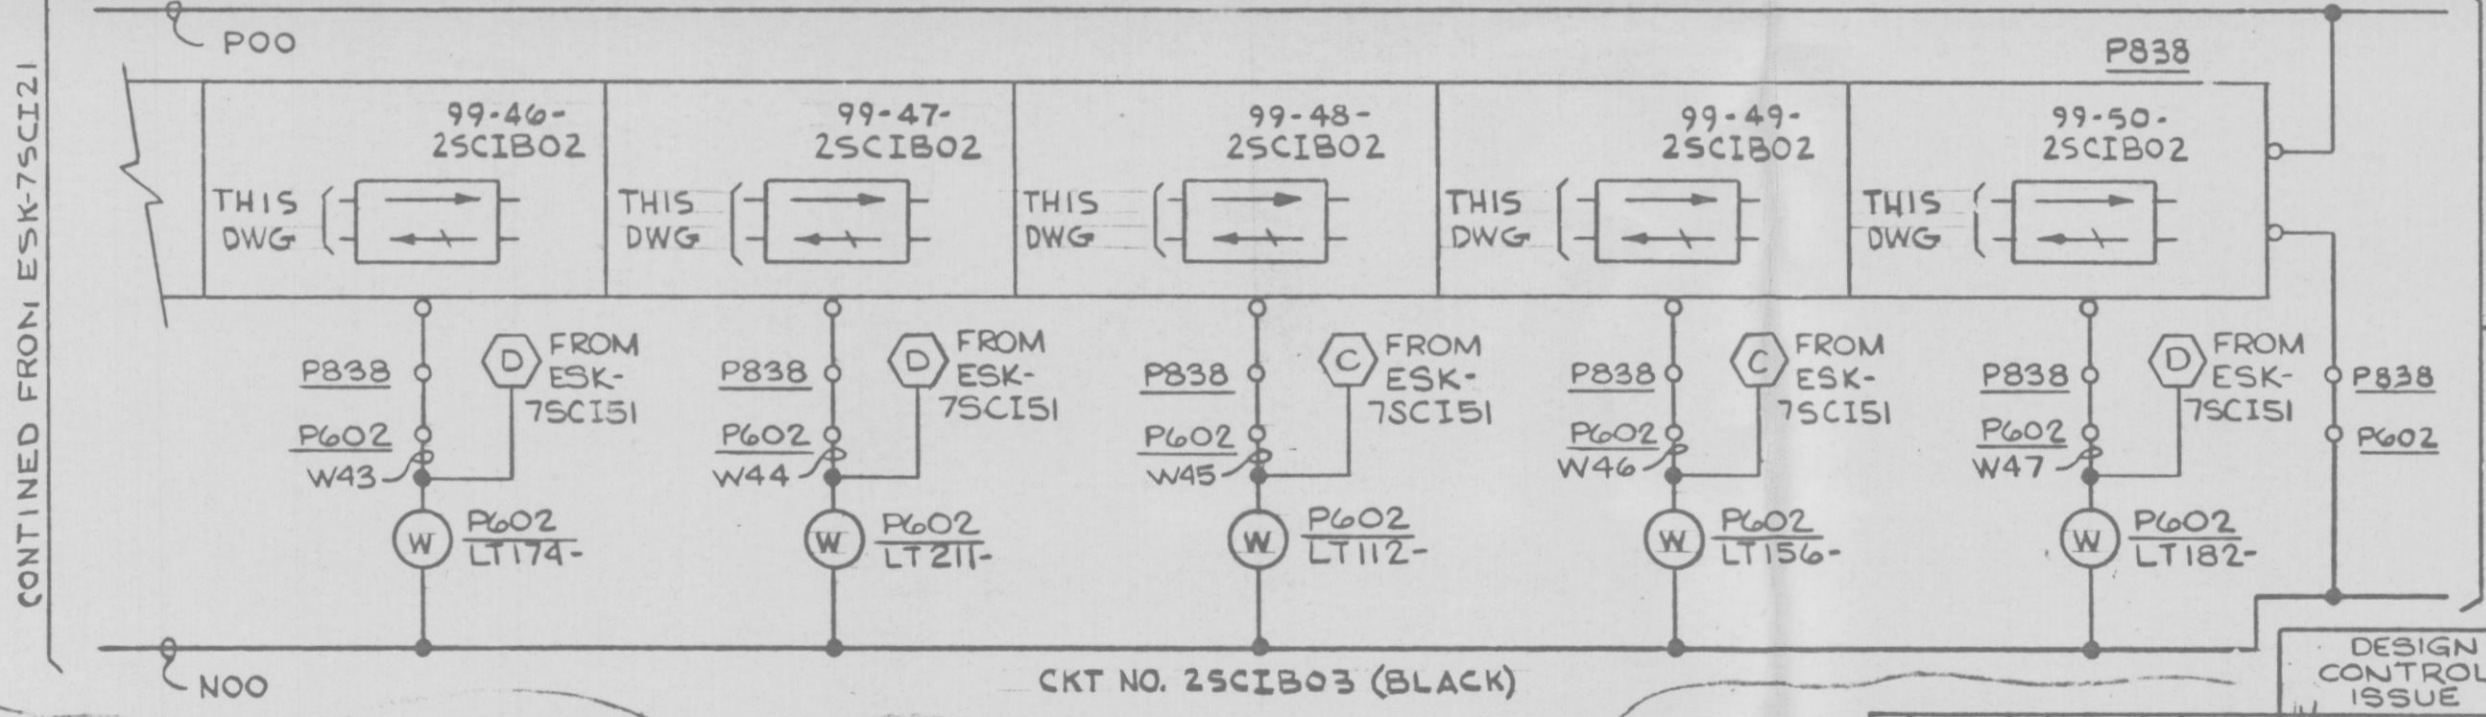


RCIC TURBINE STEAM LEAD ISOL VALVE 2ICS*MOV128(E51-F063)
 VALVE NORMALLY OPEN CLOSSES FOR ISOLATION
 RBCLW TO RECIRC PUMP B COOLERS INBD ISOL V 2CCP*MOV94B
 VALVE NORMALLY OPEN CLOSSES FOR ISOLATION
 CONTAINMENT SPRAY VALVE 2RHS*MOV25B(E12-F017B)
 VALVE NORMALLY CLOSED CLOSING FOR ISOLATION
 RHR "B" SUPPRESSION POOL SPRAY VALVE 2RHS*MOV33B(E12-F027B)
 VALVE NORMALLY CLOSED CLOSING FOR ISOLATION
 SHUTDOWN CLG INJECTION BYPASS VALVE 2RHS*MOV67B(E12-F099B)
 VALVE NORMALLY CLOSED CLOSING FOR ISOLATION

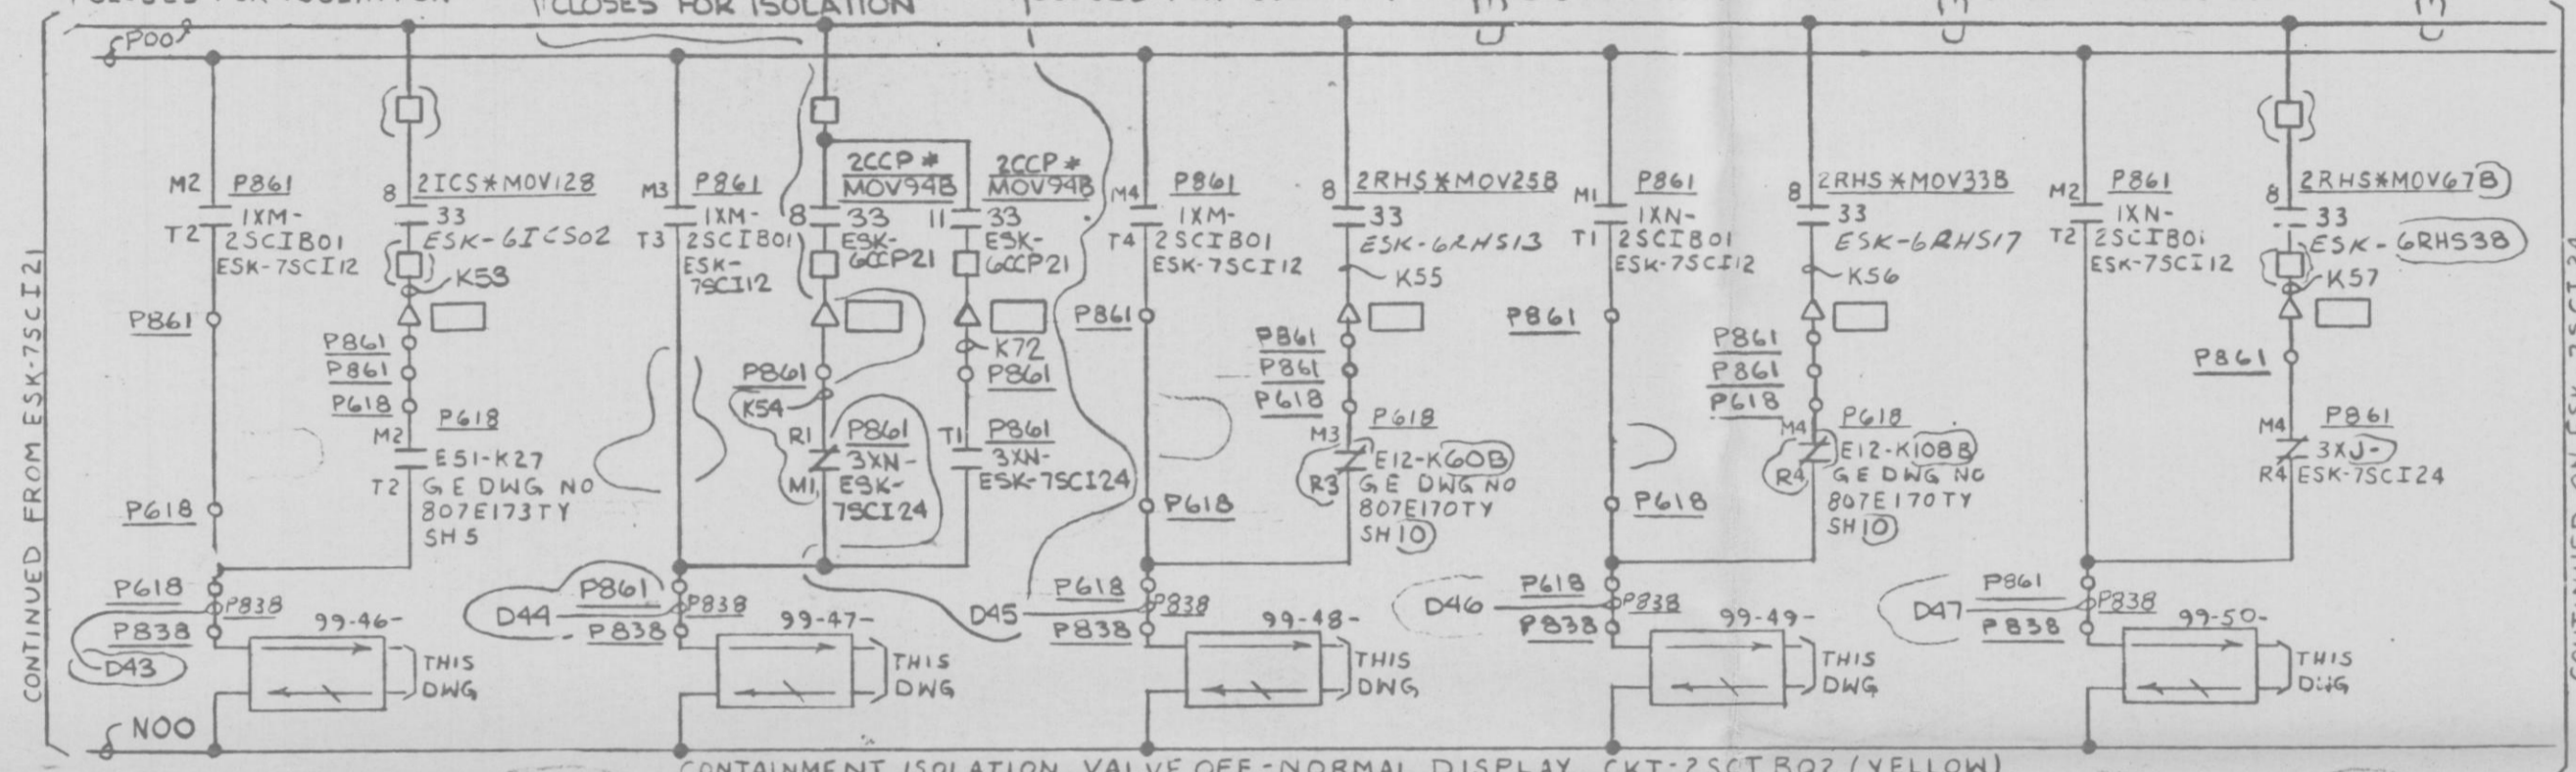

NOTES:
 □ INDICATES DRYWELL PENETRATION

PRC APERTURE CARD

NUCLEAR SAFETY RELATED
 QA CAT I, II
 DC ELEM DIAG-MISC DC CIRCUITS
 OFF-NORMAL STATUS DISPLAY
 NINE MILE POINT NUCLEAR STATION-UNIT 2
 NIAGARA MOHAWK POWER CORPORATION
 STONE & WEBSTER ENGINEERING CORPORATION
 12177-ESK-7SCI22

DESIGN CONTROL ISSUE

6	5	4	3
			4/30/81
			INCORP 840390 240349
			APM/EP

GE-NEE GE-L516