


CONTINUED FROM  
ESK-7SCI10

CONT'D ON ESK-7SCI23

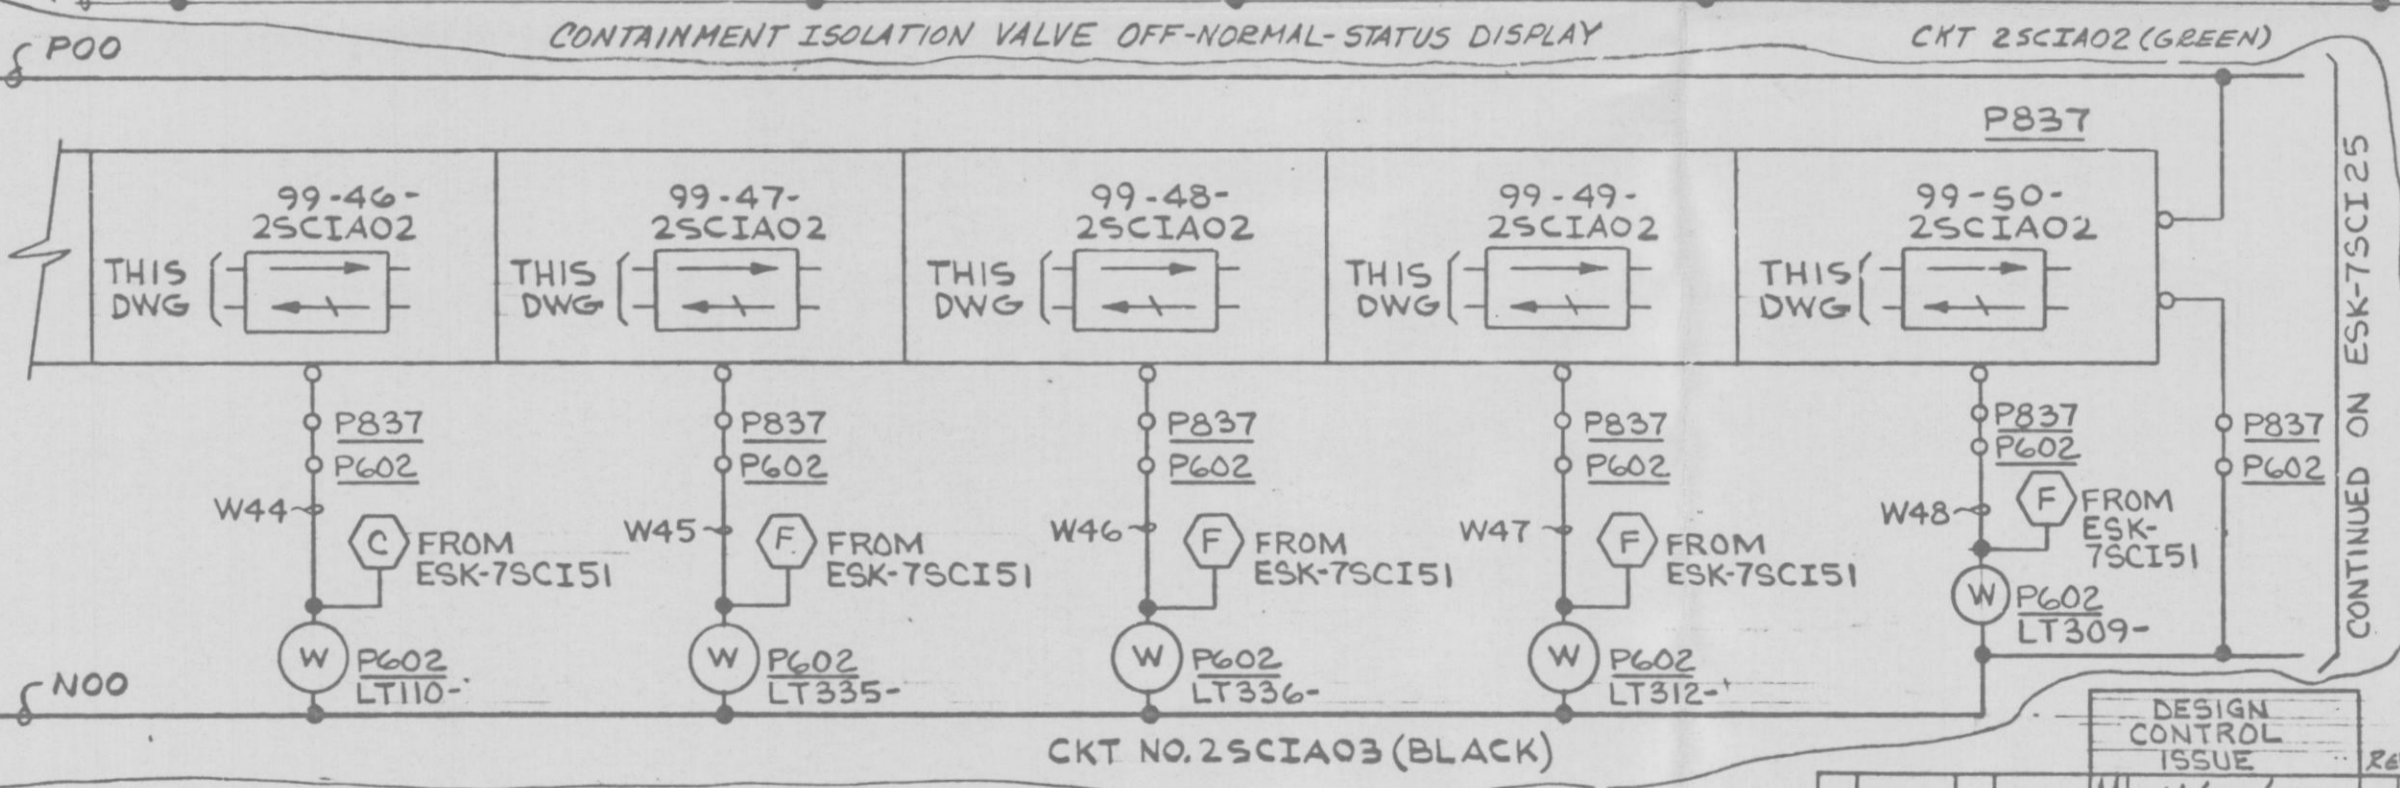

PRC  
APERTURE  
CARD

GE-NED  
GE-LSTG

NUCLEAR SAFETY RELATED  
QA CAT I, II

DC ELEM DIAG-MISC DC CIRCUITS  
OFF-NORMAL-STATUS DISPLAY  
NINE MILE POINT NUCLEAR STATION-UNIT 2  
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-7SCIII

DESIGN CONTROL ISSUE		REV PGCC		GEN REV		PGCC	
NO	DATE	REV	PGCC	REV	PGCC	REV	PGCC
6							
5							
4	4/30/91	3	2277	1	6-7-77	1	7-29-76
INCORP ESDCR G 40390		M 3		M 2		M 1	
APM/g		M 3		M 2		M 1	