



GE-NEED GE-LST6

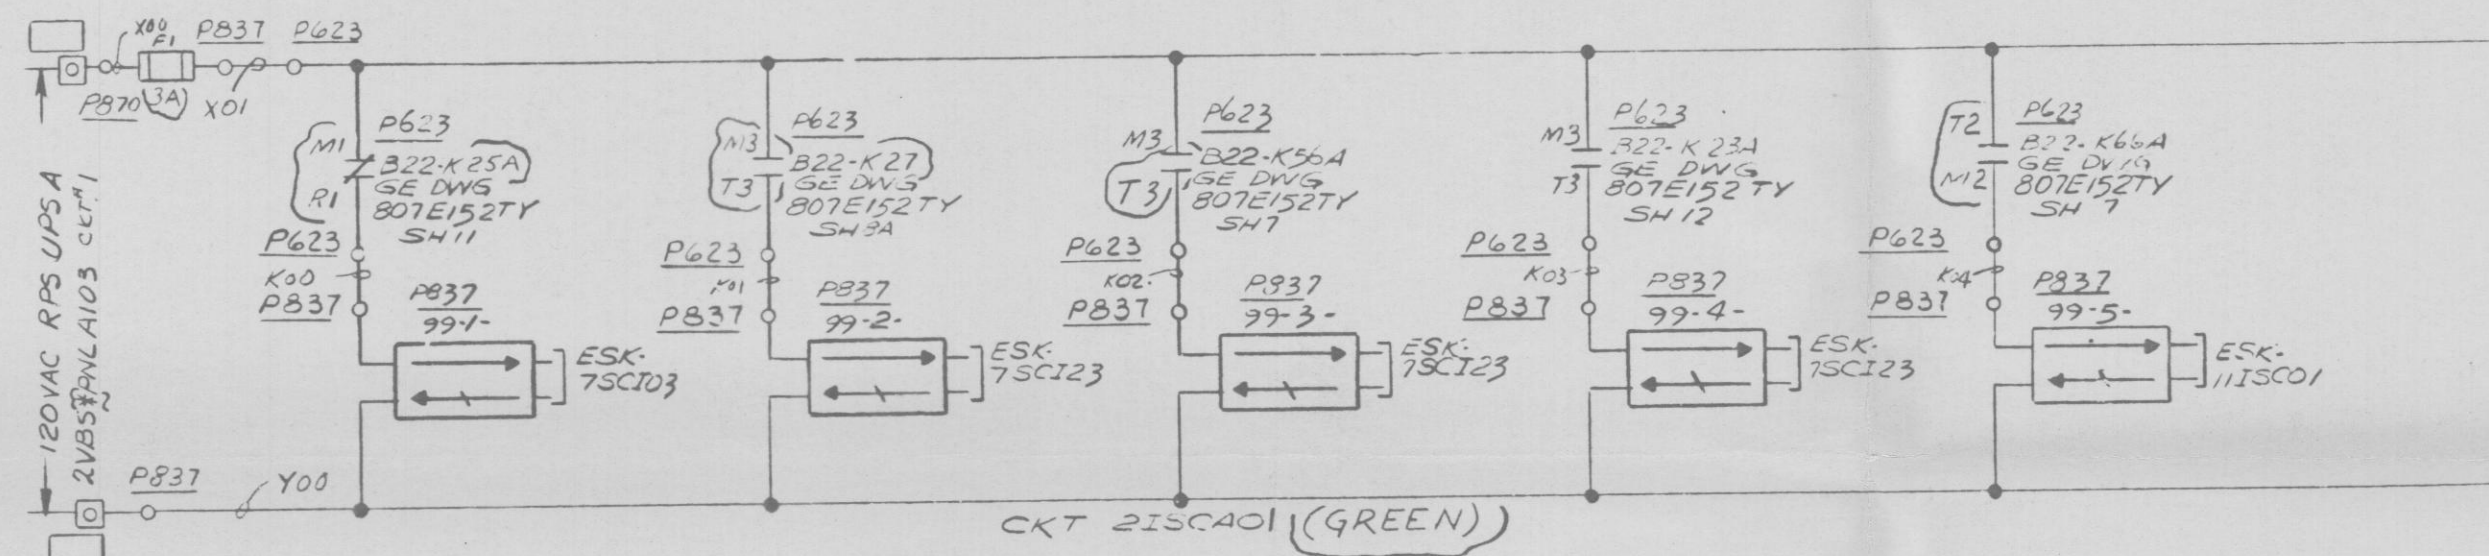

CKT 2ISCA01 (GREEN)

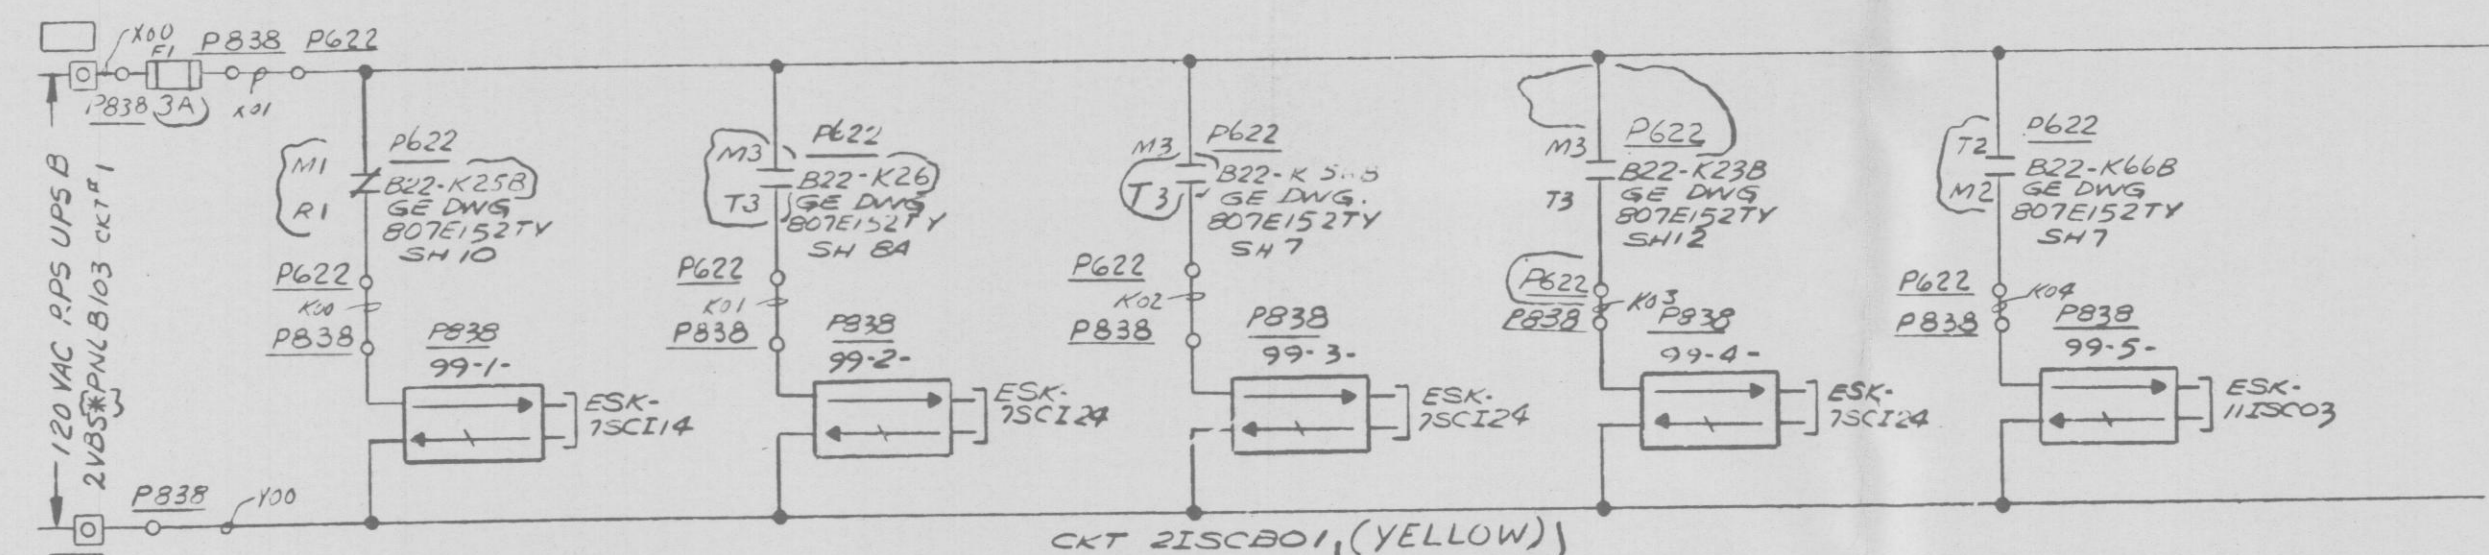

CKT 2ISCB01 (YELLOW)

NOTES:
 1. CIRCUIT 2ISCA01 IS D1 (GREEN)
 CIRCUIT 2ISCB01 IS D2 (YELLOW)
 THIS IS NOT ECCS DIV I & DIV II
 BUT RPS DIV I & DIV II
 RESPECTIVELY.
 2. REFER TO LOGIC 27-19

PRC
 APERTURE
 CARD

NUCLEAR SAFETY RELATED
 QA CAT I (II)

AC ELEMENTARY DIAGRAM
 CONTAINMENT ISOLATION LOGIC
 NINE MILE POINT NUCLEAR STATION-UNIT 2
 NIAGARA MOHAWK POWER CORPORATION
 STONE & WEBSTER ENGINEERING CORPORATION

6	5	4	3
---	---	---	---

DESIGN CONTROL ISSUE	DATE	BY
1	3/4/81	PC/MS
2	5/10/81	KK

PC/MS
 KK
 1/1/81

12177-ESK-7ISCO1

D