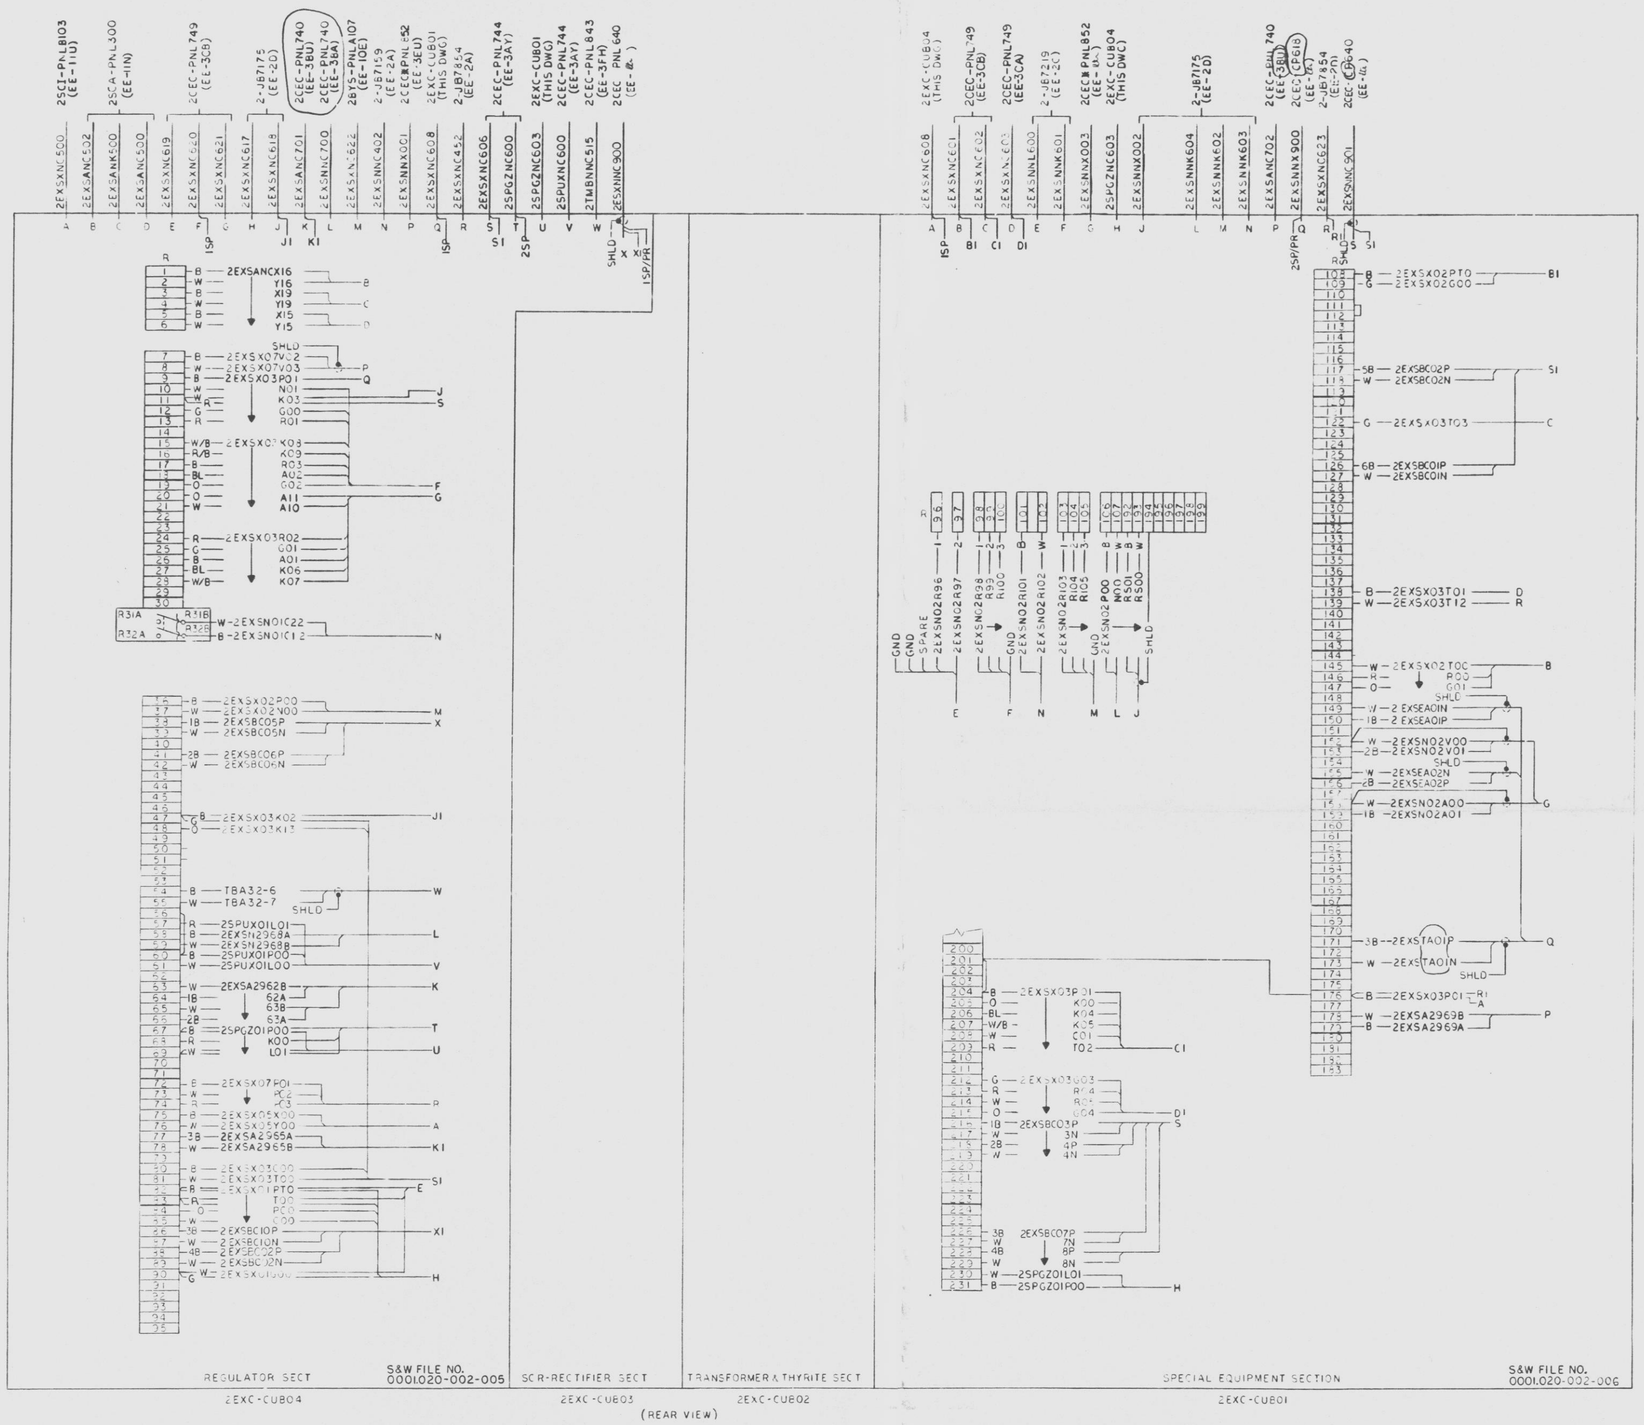

NOTES:
1. WIRING TO R1 R6 SHOULD BE BUNDLED SEPERATELY FROM OTHER WIRES AND RUN IN AT TOP AT LEAST 2 FROM OTHER WIRING.
2. ALL JUMPERS ARE TO BE I/C NO. 12 AWG MARK NO. n.n-59.
3. ELECTRICAL WIRE AND CABLE NOTES STD-ME-1-7-3 AND STD-ME-1-8-2

REFERENCES:
1. GE-44C305663
S&W FILE-0001.020-002-029
2. GE-44C306445, SH1 THRU SH19
S&W FILE-0001.020-002-007 THRU 028,030,031,034,035, 040,041,042
3. GE-44C306446, SH1 THRU SH9, SH11 THRU SH16, SH4A & SH7A
S&W FILE-0001.020-002-043 THRU 057, 062 & 063

CKT NO.	ESK NO.
2EXSN01	8SPU01
2EXSN02	8EXS09, 10 & 11
2EXSX01	8EXS02
2EXSX02	8EXS03
2EXSX03	8EXS04, 05, 06 & 07
2EXSX05	8EXS08
2EXSX07	8SPG03
2SPGZ01	8SPG03
2SPUX01	8SPG05
	8SPU05
ALM NO. 2962, 2963, 2969 & 2965	10IHA499
2968	10IHA403

TI APERTURE CARD

QA CAT II

D

APPROVED Km Khanna
LICENSED PROFESSIONAL ENGINEER. NO. 55786
STATE OF NEW YORK
ALTERATION EXCEPT BY A LICENSED PROFESSIONAL ENGINEER IS ILLEGAL

THE INFORMATION ON THIS DRAWING MAY NOT BE COPIED OR USED FOR OTHER THAN THE CONSTRUCTION, MAINTENANCE OR REPAIR OF THE PLANT FACILITY DESCRIBED IN THE TITLE BLOCK.

WIRING DIAGRAM
GENERATOR EXCITATION CUBICLE

NINE MILE POINT NUCLEAR STATION — UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION
BOSTON, MASS.

CH

DRAWING NUMBER 12177-EE-2E-3

AREAS	LEVELS	WORK PKG
2		340

Designed by T. BOHNER
Des. Chk'd by C. HENDERSON
Drawn by V. BERTINO
Chk'd by T. BOHNER

Engineer: A. GWAL
Des. Eng: P. HUHA

ISSUE	DESCRIPTION	CHKD	CORR	APPR	DATE
3	SEE RECORD OF DWG CHANGES BCE-2E-3				
2	SEE RECORD OF DWG CHANGES BCE-2E-2				
1	ORIGINAL ISSUE				