


GE NED  
GE LSTG

1	2	3	4	5	6
DESIGN	CONTROL	ISSUE			
DC ELEM DIAG 125V	RCIC AIR COMPRESSOR	NINE MILE POINT NUCLEAR STATION-UNIT 2	NIAGARA MOHAWK POWER CORPORATION	STONE & WEBSTER ENGINEERING CORPORATION	12177-ESK-11IC512

RCIC GLAND SEAL SYSTEM AIR COMPRESSOR 2IGS \* C1 )  
G.E. NO. (E51-C1) MCC 2DMS \* MCCAI CRT NO. 2IGSN23  
(GREEN)

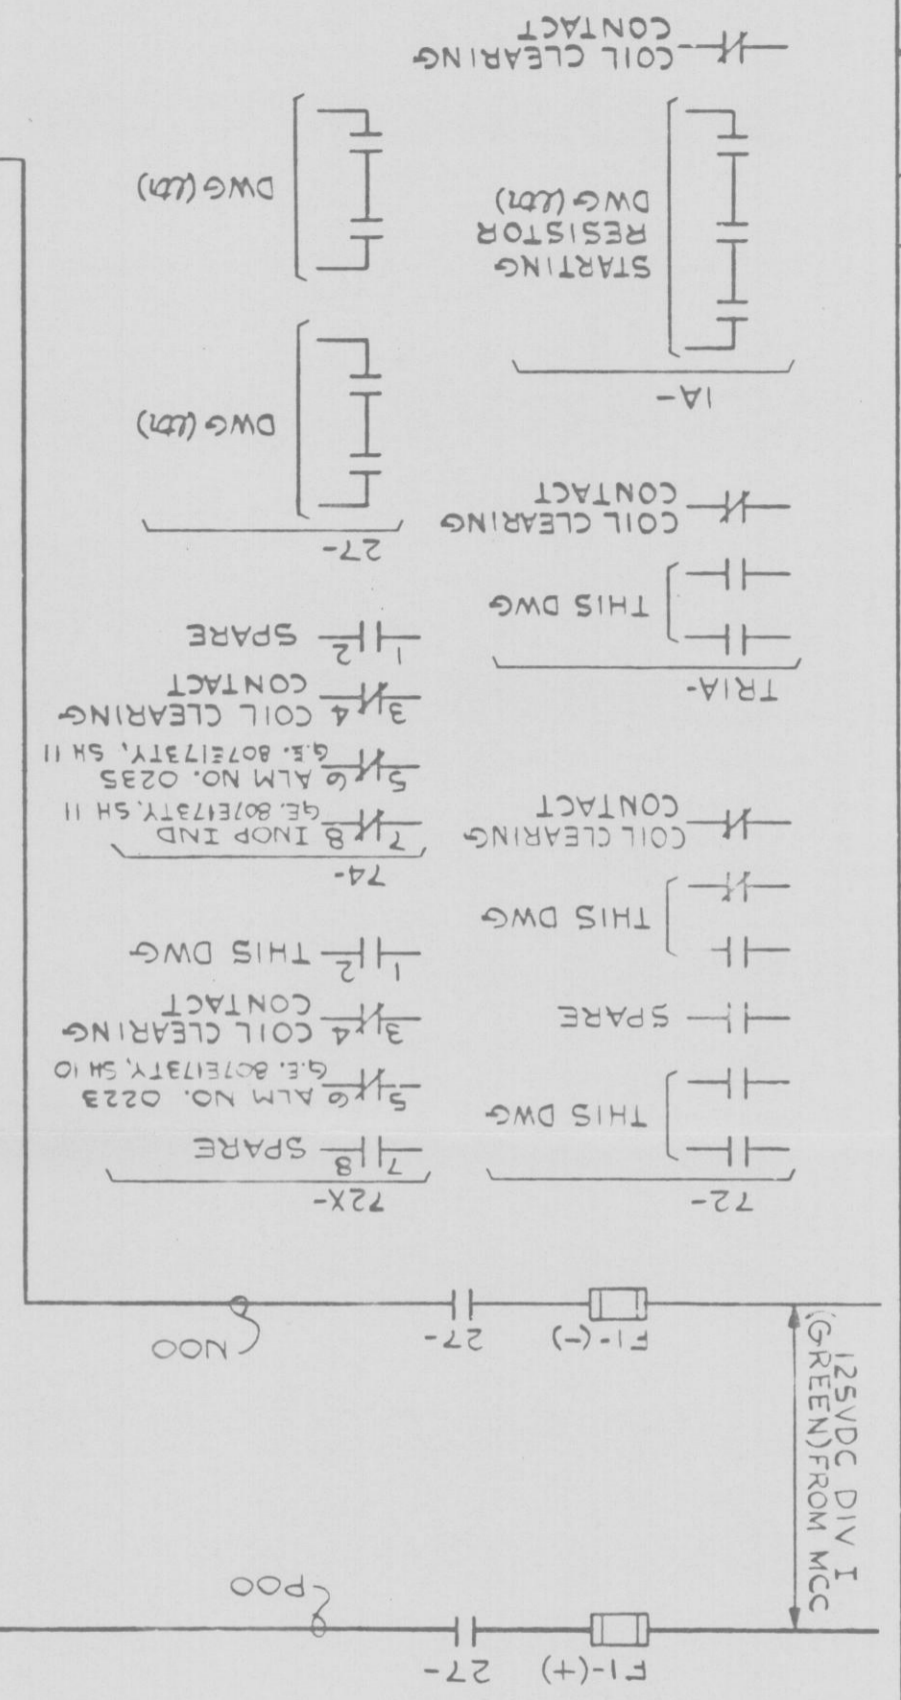

CS  
DETAIL ESK SPARES USED DN  
SWS-2RSSNB4 BE 3K  
CONTROL REFERENCE  
ELEMENTS G.E. DWGS  
K5 807E173TY, SH 4  
S15

NUCLEAR SAFETY RELATED  
QA CAT I

NOTES:  
1. ALL EQUIPMENT LOCATED AT MCC  
UNLESS OTHERWISE NOTED.  
2. APPLICABLE G.E. ELEMENTARY:  
807E173TY  
3. -INDICATES PNL P405 TERMINATION.

PRC  
APERTURE  
CARD

