


PRC
APERTURE
CARD

- NOTES:
1. ALL EQUIPMENT LOCATED AS NOTED.
2. PRESSURE SWITCHES ARE QA CAT I, NON CLASS 1E.

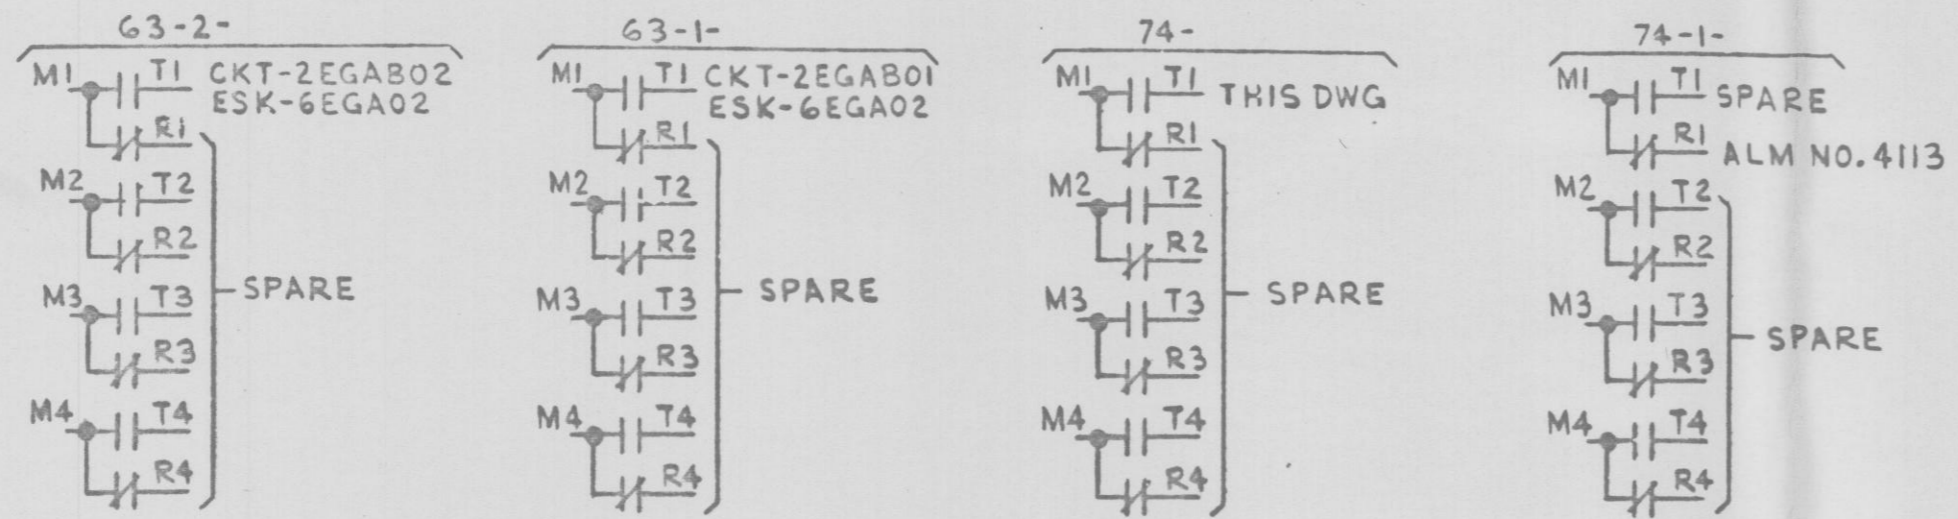

NUCLEAR SAFETY RELATED
QA CAT I, II

DC ELEM DIAG 125V ISOLATOR CKTS
DSL GEN 2EGS*EG3 CPRSR CONT BY P/INOP
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION

DESIGN
CONTROL
ISSUE

7	6	5	4	3	2	1
---	---	---	---	---	---	---

12177-ESK-11EGA02

D