


PRC
APERTURE
CARD

NOTES:
1. ALL EQUIPMENT LOCATED AS NOTED.
2. PRESSURE SWITCHES ARE QA CAT I
NON-CLASS I.E.

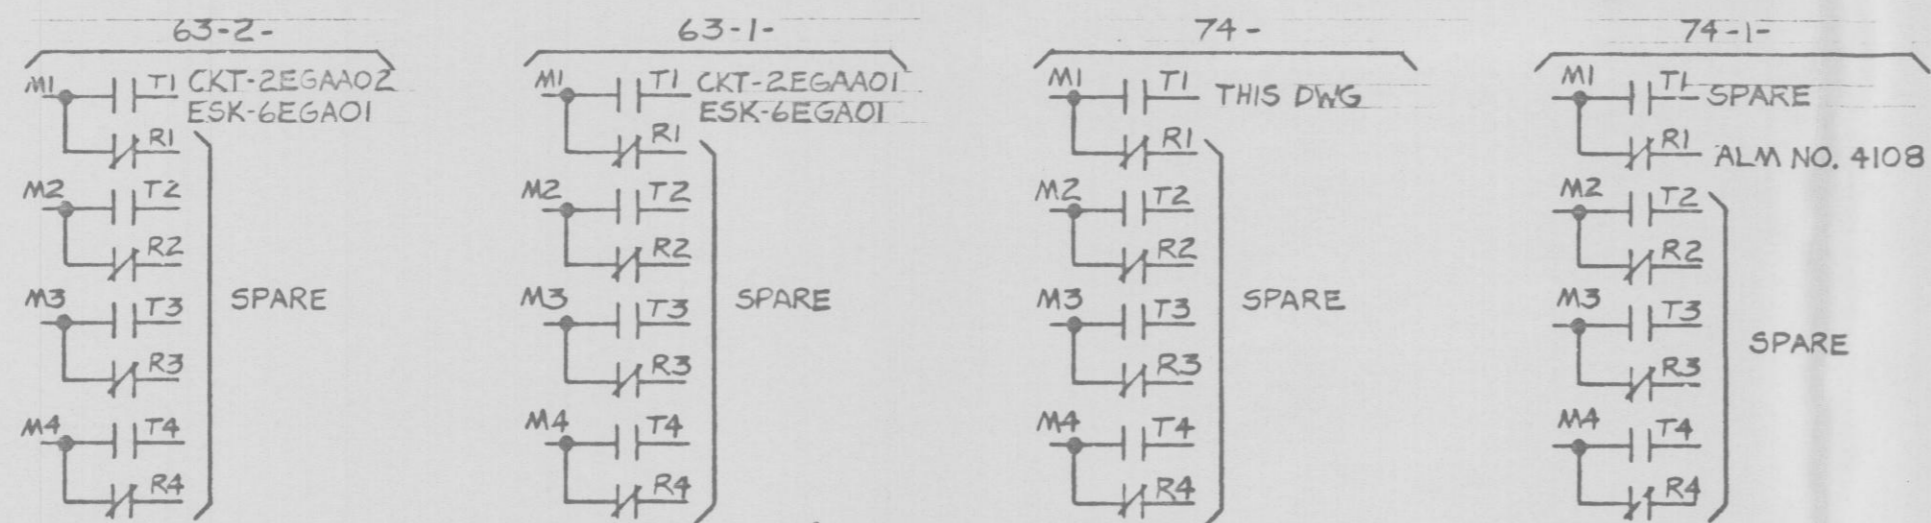

7	6	5	4	3	2	1
---	---	---	---	---	---	---

NUCLEAR SAFETY RELATED
QA CAT I,II

DC ELEM DIAG-125V MISC CKTS
DSL GEN 2EGS*EGI CPRSR CONT & BYP/INOP
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION

DESIGN
CONTROL
ISSUE

12177-ESK-11EGAO1

SWR