

**NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL
(TEMPORARY FORM)**

CONTROL NO: 9332
FILE: _____

FROM: LeBoeuf, Lamb, Leiby & MacRae Washington, D. C. LeBoruf, Lamb, Leiby & MacRae		DATE OF DOC 9-2-75	DATE REC'D 9-2-75	LTR XXX	TWX	RPT	OTHER
TO: Ben C. Rusche		ORIG 3 Signed	CC	OTHER	SENT NRC PDR	XXXX	
					SENT LOCAL PDR	XXXX	
CLASS	UNCLASS XXXX	PROP INFO	INPUT	NO CYS REC'D 3	DOCKET NO: 50-220		

DESCRIPTION:
N otarized ltr. 8-29-75...trans the follow-
ing.....

PLANT NAME: Nine Mile Point #.1

ENCLOSURES:
Proposed Amdt. to O/L change to Tech Spec; con-
sisting of Revisions to Change Minimum Critical P
power Ratio....Attach. "B"-Rod Withdrawal Error
Transient Analysis....W/Figs...
Certificate of Service "Application for Amdt
to Opert. Lic." served yupon Mr. Robert P. Jones
Supervisor, Town of Scriba, R.D. #4, Osewege, N.Y.
et al..... (40 cys. Rec'd).

FOR ACTION/INFORMATION

VCR 9-4-75

- | | | | |
|-------------------------|----------------------------|-----------------------------|------------------------|
| BUTLER (L)
W/ Copies | SCHWENCER (L)
W/ Copies | ZIEMANN (L)
W/ Copies | REGAN (E)
W/ Copies |
| CLARK (L)
W/ Copies | STOLZ (L)
W/ Copies | DICKER (E)
W/ Copies | LEAR (L)
W/ Copies |
| PARR (L)
W/ Copies | VASSALLO (L)
W/ Copies | KNIGHTON (E)
W/ Copies | SPIES
W/ Copies |
| KNIEL (L)
W/ Copies | PURPLE (L)
W/ Copies | YOUNGBLOOD (E)
W/ Copies | LPM
W/ Copies |

**ACKNOWLEDGED
DO NOT REMOVE**

INTERNAL DISTRIBUTION

- | | | | | |
|----------------------------|---------------------------------|---------------|---------------------------------|----------------------|
| <u>REG FILE</u>
NRC PDR | <u>TECH REVIEW</u>
SCHROEDER | DENTON | <u>LIC ASST</u>
R. DIGGS (L) | A/T IND.
BRAITMAN |
| OGC, ROOM P-506A | MACCARY | GRIMES | H. GEARIN (L) | SALTZMAN |
| GOSSICK/STAFF | KNIGHT | GAMMILL | E. GOULBOURNE (L) | MELTZ |
| CASE | PAWLICKI | KASTNER | P. KREUTZER (E) | |
| GIAMBUSSO | SHAO | BALLARD | J. LEE (L) | <u>PLANS</u> |
| BOYD | STELLO | SPANGLER | M. RUSHBROOK (L) | MCDONALD |
| MOORE (L) | HOUSTON | | S. REED (E) | CHAPMAN |
| DEYOUNG (L) | NOVAK | <u>ENVIRO</u> | M. SERVICE (L) | DUBE (Ltr) |
| SKOVHOLT (L) | ROSS | MULLER | S. SHEPPARD (L) | E. COUPE |
| GOLLER (L) (Ltr) | IPPOLITO | DICKER | M. SLATER (E) | PETERSON |
| P. COLLINS | TEDESCO | KNIGHTON | H. SMITH (L) | HARTFIELD (2) |
| DENISE | J. COLLINS | YOUNGBLOOD | S. TEETS (L) | KLECKER |
| <u>REG OPR</u> | LAINAS | REGAN | G. WILLIAMS (E) | EISENHUT |
| FILE & REGION (2) | BENAROYA | PROJECT LDR | V. WILSON (L) | WIGGINTON |
| MIPC | VOLLMER | <u>Gill</u> | R. INGRAM (L) | |
| | | HARLESS | M. DUNCAN (E) | |

EXTERNAL DISTRIBUTION

- | | | |
|--|--------------------------------|------------------------|
| 1 - LOCAL PDR <u>Osewego N.Y.</u> | 1 - NATIONAL LABS | 1 - PDR-SAN/LA/NY |
| 1 - TIC (ABERNATHY) (1)(2)(10) | 1 - W. PENNINGTON, Rm E-201 GT | 1 - BROOKHAVEN NAT LAB |
| 1 - NSIC (BUCHANAN) | 1 - CONSULTANTS | 1 - G. ULRIKSON ORNL |
| 1 - ASLB | NEWMARK/BLUME/AGBABIAN | |
| 1 - Newton Anderson | | |
| 16 - ACRS Holdings /SENT <u>Teets</u> | | |

The following information was obtained from the records of the
 Department of the Interior, Bureau of Land Management, on
 the subject of the above captioned matter.
 The land in question is situated in the
 County of _____ State of _____
 and is more particularly described as follows:
 Section _____ Township _____ Range _____
 The land is owned by _____
 and is being offered for sale to the public.
 The land is situated in the _____
 and is more particularly described as follows:
 Section _____ Township _____ Range _____
 The land is owned by _____
 and is being offered for sale to the public.
 The land is situated in the _____
 and is more particularly described as follows:
 Section _____ Township _____ Range _____
 The land is owned by _____
 and is being offered for sale to the public.

Regulatory

File Cy.

LAW OFFICES OF
LEBOEUF, LAMB, LEIBY & MACRAE
1757 N STREET, N. W.
WASHINGTON, D. C. 20036


September 2, 1975

140 BROADWAY
NEW YORK, N. Y. 10005

WASHINGTON TELEPHONE
202-872-8668

CABLE ADDRESS
LALALU, WASHINGTON D. C.
TELEX: 440274

ARVIN E. UPTON
LEONARD M. TROSTEN
WILLIAM O. DOUB
EUGENE B. THOMAS, JR.
HARRY H. VOIGT
L. MANNING MUNTZING
LEX K. LARSON
HENRY V. NICKEL
WASHINGTON PARTNERS

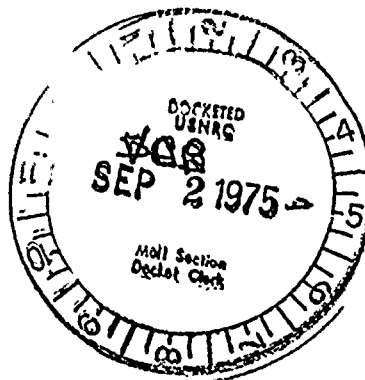

Mr. Ben C. Rusche
Director
Office of Nuclear Reactor
Regulation
U.S. Nuclear Regulatory
Commission
Washington, D.C. 20555

Re: Niagara Mohawk Power Corporation
Nine Mile Point Nuclear Station Unit No. 1
Docket No. 50-220


Dear Mr. Rusche:

Transmitted herewith are three (3) signed originals and nineteen (19) copies of a document entitled "Application for Amendment to Operating License." This Application seeks to amend Section 3.1.7c of the Technical Specifications set forth in Appendix A to Facility Operating License No. DPR-63 to change the Minimum Critical Power Ratio from 1.24 to 1.25. Forty (40) copies of the proposed change in Technical Specifications and safety evaluation accompany this Application.

A Certificate of Service showing service of these documents upon the persons listed therein is also enclosed.

Very truly yours,


LeBoeuf, Lamb, Leiby & MacRae
LeBoeuf, Lamb, Leiby & MacRae
Attorneys for Niagara Mohawk
Power Corporation

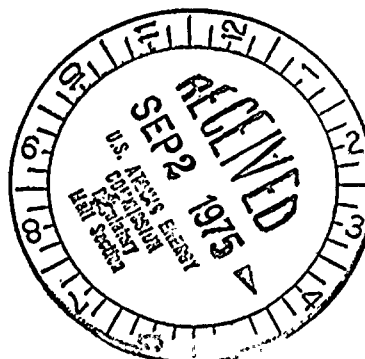

9332

... ..

BEFORE THE UNITED STATES
NUCLEAR REGULATORY COMMISSION

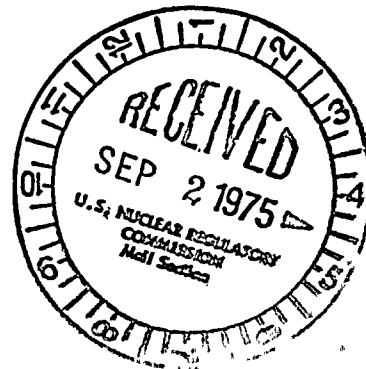

In the Matter of)
)
NIAGARA MOHAWK POWER CORPORATION) Docket No. 50-220
(Nine Mile Point Nuclear Station)
Unit No. 1))

CERTIFICATE OF SERVICE

I hereby certify that I have served a document entitled "Application for Amendment to Operating License" by mailing a copy thereof first class, postage prepaid, to the following persons this 2nd day of September, 1975.

Mr. Robert P. Jones
Supervisor
Town of Scriba
R. D. #4
Oswego, New York 13126

Miss Juanita Kersey
Librarian
Oswego City Library
120 E. Second Street
Oswego, New York 13126

Dr. William E. Seymour
Staff Coordinator
New York State Atomic
Energy Council
New York State Department
of Commerce
99 Washington Avenue
Albany, New York 12210

Hope M. Babcock
Hope M. Babcock

LeBoeuf, Lamb, Leiby & MacRae
Attorneys for Applicant

10


UNITED STATES OF AMERICA
NUCLEAR REGULATORY COMMISSION

In the Matter of)
)
NIAGARA MOHAWK POWER CORPORATION)
(Nine Mile Point Nuclear Station))
Unit No. 1)

Docket No. 50-220

APPLICATION FOR AMENDMENT
TO
OPERATING LICENSE


Pursuant to Section 50.90 of the regulations of the Nuclear Regulatory Commission, Niagara Mohawk Power Corporation, holder of Facility Operating License No. DPR-63, hereby requests that Section 3.1.7c of the Technical Specifications set forth in Appendix A to that License be amended. This change is provided in response to the August 14, 1975 letter of request from Mr. George Lear to Mr. G. K. Rhode. This proposed change has been approved by the Site Operations Review Committee and Safety Review and Audit Board.

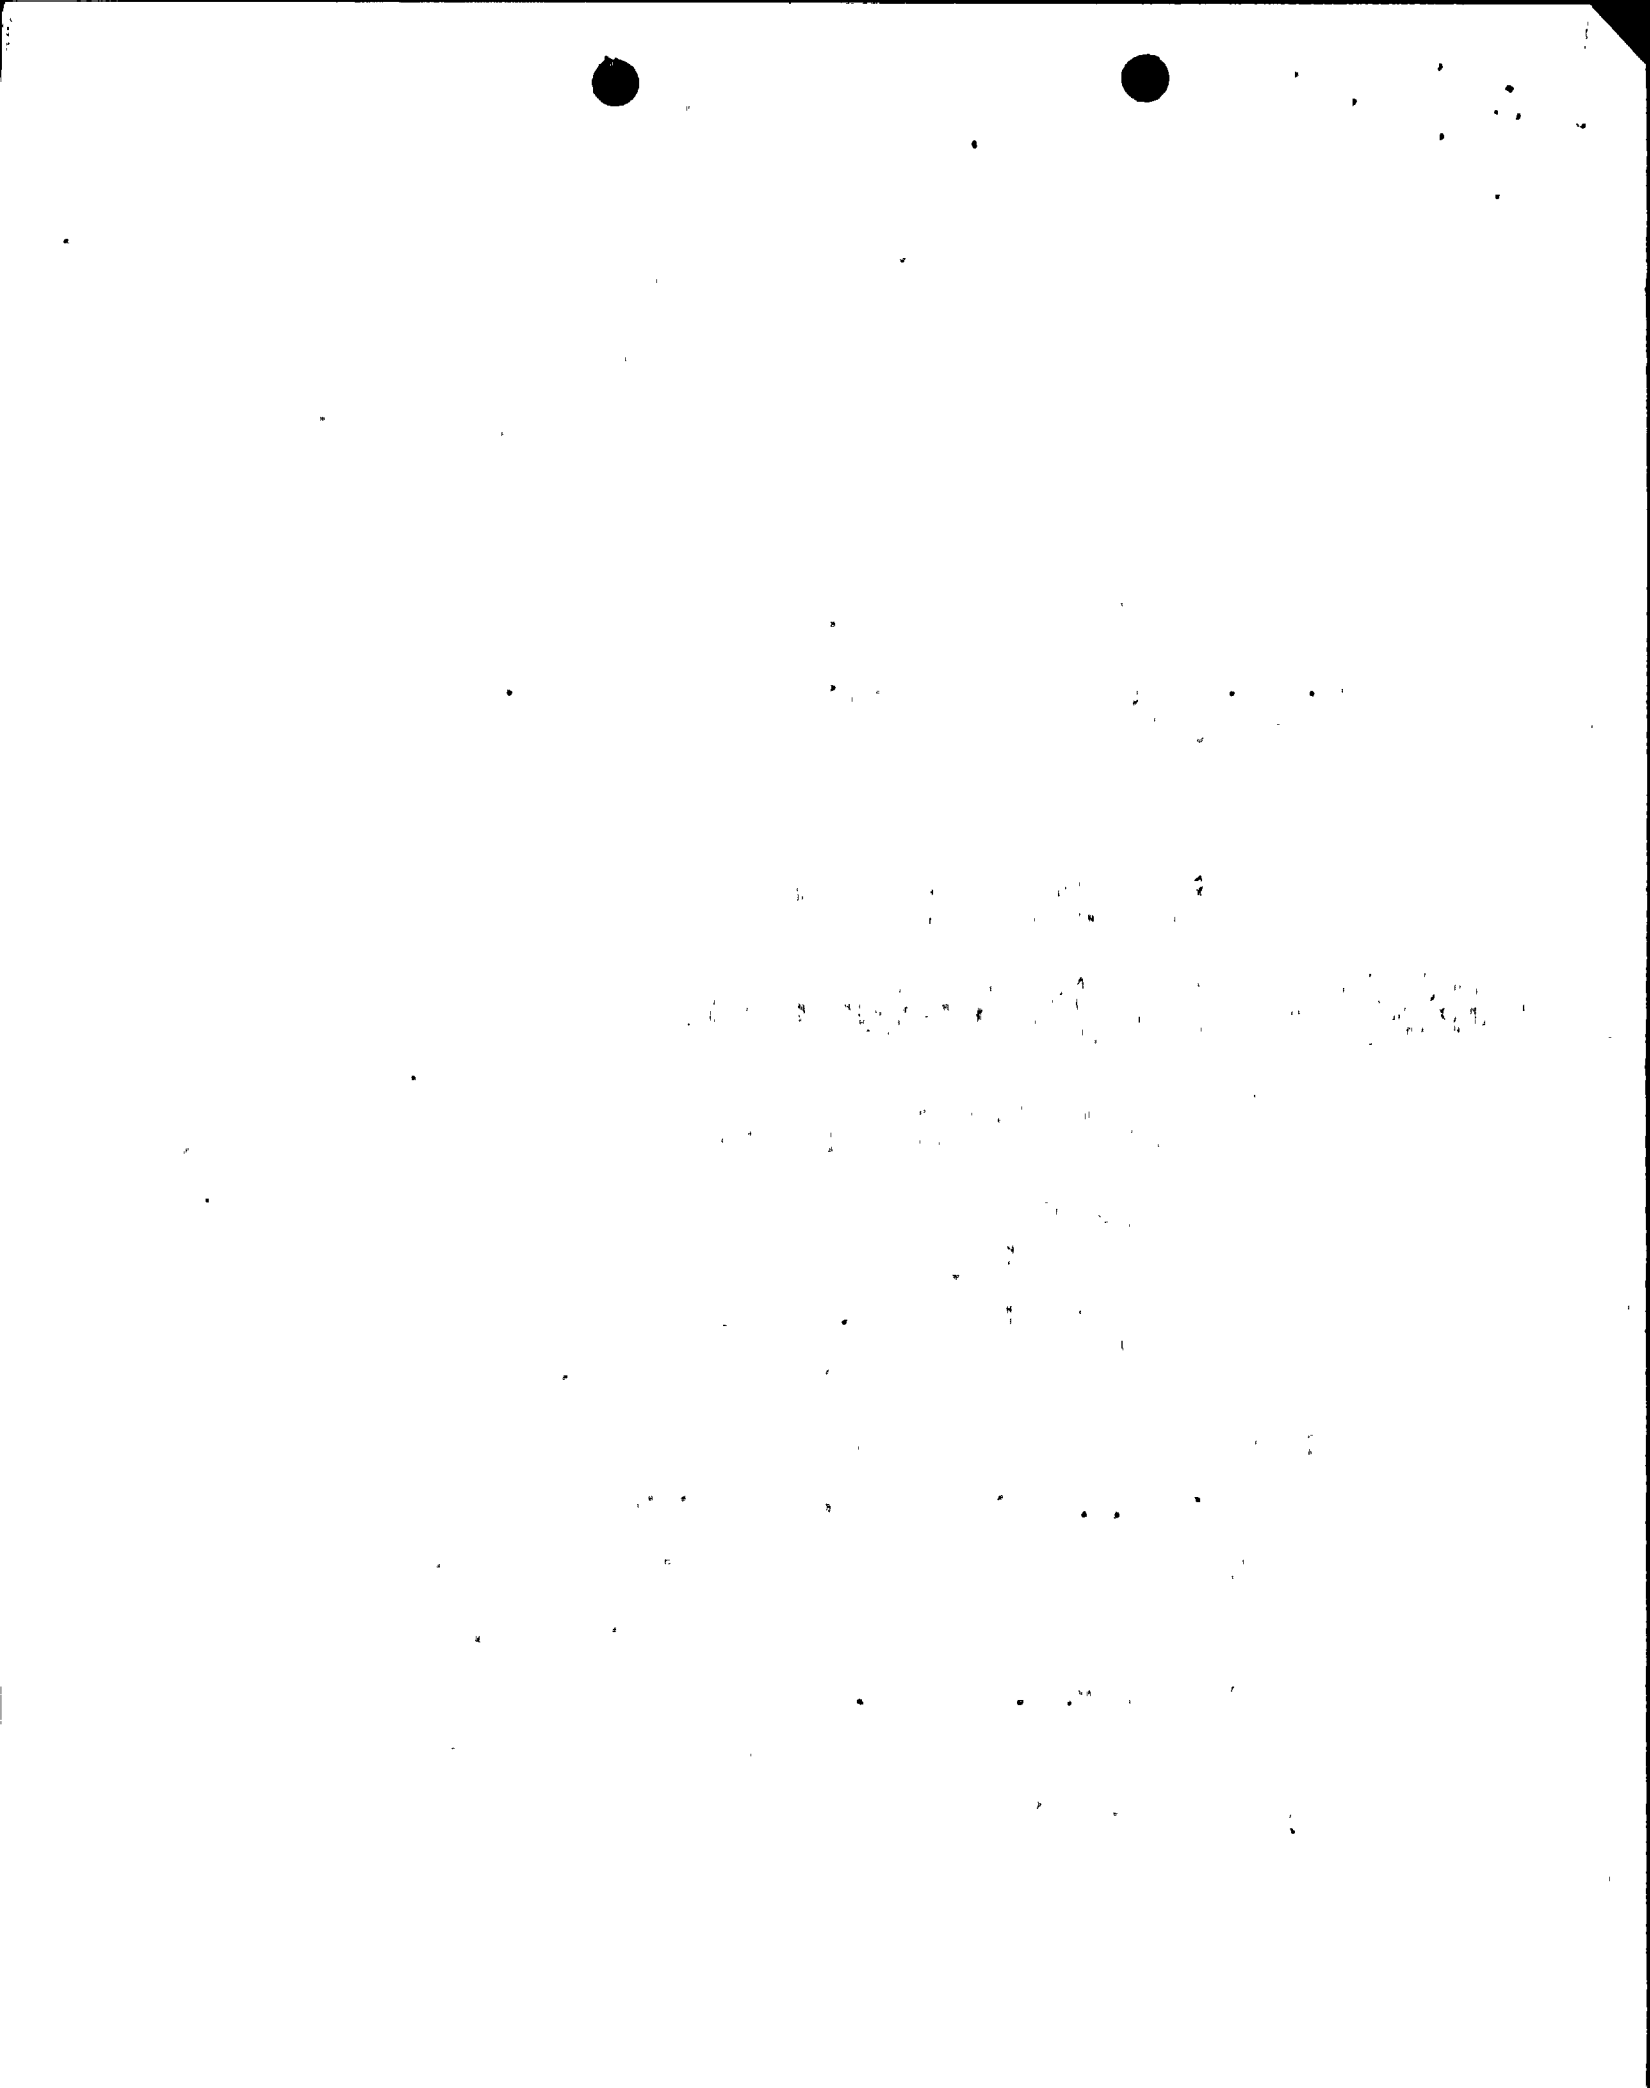

The proposed technical specification change is set forth in Attachment A to this application. The Licensee also transmits as Attachment B a document entitled, "Rod Withdrawal Error Transient Analysis." The proposed change would not authorize any change in the types or any increase in the amounts of effluents or any increase in the authorized power level of the facility.

WHEREFORE, Applicant respectfully requests that Appendix A to Facility Operating License No. DPR-63 be amended in the form attached hereto as Attachment A.

NIAGARA MOHAWK POWER CORPORATION

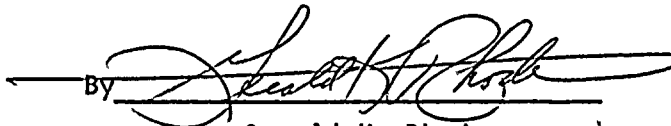BY 
Gerald K. Rhode
Vice President-Engineering

Subscribed and sworn to
before me on this 27 day
of August, 1975.



Notary Public

HAZEL J. CARRICK

Notary Public in the State of New York

Qualified in Onon. Co. No. 4524460

My Commission Expires March 30, 1976

12

ATTACHMENT A

Niagara Mohawk Power Corporation


License No. DPR-63

Docket No. 50-220

Proposed Change to Technical Specifications

<u>Item</u>	<u>Location*</u>	<u>Change</u>
Limiting Condition for Operation 3.1.7c	Page 64a	Change Minimum Critical Power Ratio (MCPR) value for 8 x 8 fuel to " <u>></u> 1.25"

*The June 27, 1975 "Application of General Electric Thermal Analysis Basis (GETAB)" submittal proposed the addition of page 64a to the Technical Specifications.




ATTACHMENT B

Nine Mile Point Unit 1 Nuclear Power Station
Rod Withdrawal Error Transient Analysis

(Supplement to "Application of General Electric
Thermal Analysis Basis (GETAB)," June 1975)

August 1975



I. Introduction

This report presents the results of an analysis of the rod withdrawal error transient for Cycle 3. This information is provided in response to Reference 1 and supplements that in Reference 2.

II. Analysis of Rod Withdrawal Error Transient

Discussion of the rod withdrawal error transient analysis, including assumptions, is presented in Sections 6.2.4 and 6.3.3.2 of Reference 3. A description of input to this analysis is presented in Section IV of Attachment B to Reference 2.

With the rod block setting at 105%, the Cycle 3 rod block response is shown in Figures 24 and 25 of Reference 4. The worst case MCPR at rod block is determined from the attached Figures 1 and 2.

As a result of this analysis, it is necessary that the 8 x 8 MCPR operating limit be increased to 1.25, in order to avoid violating the MCPR Safety Limit during a postulated rod withdrawal error transient.



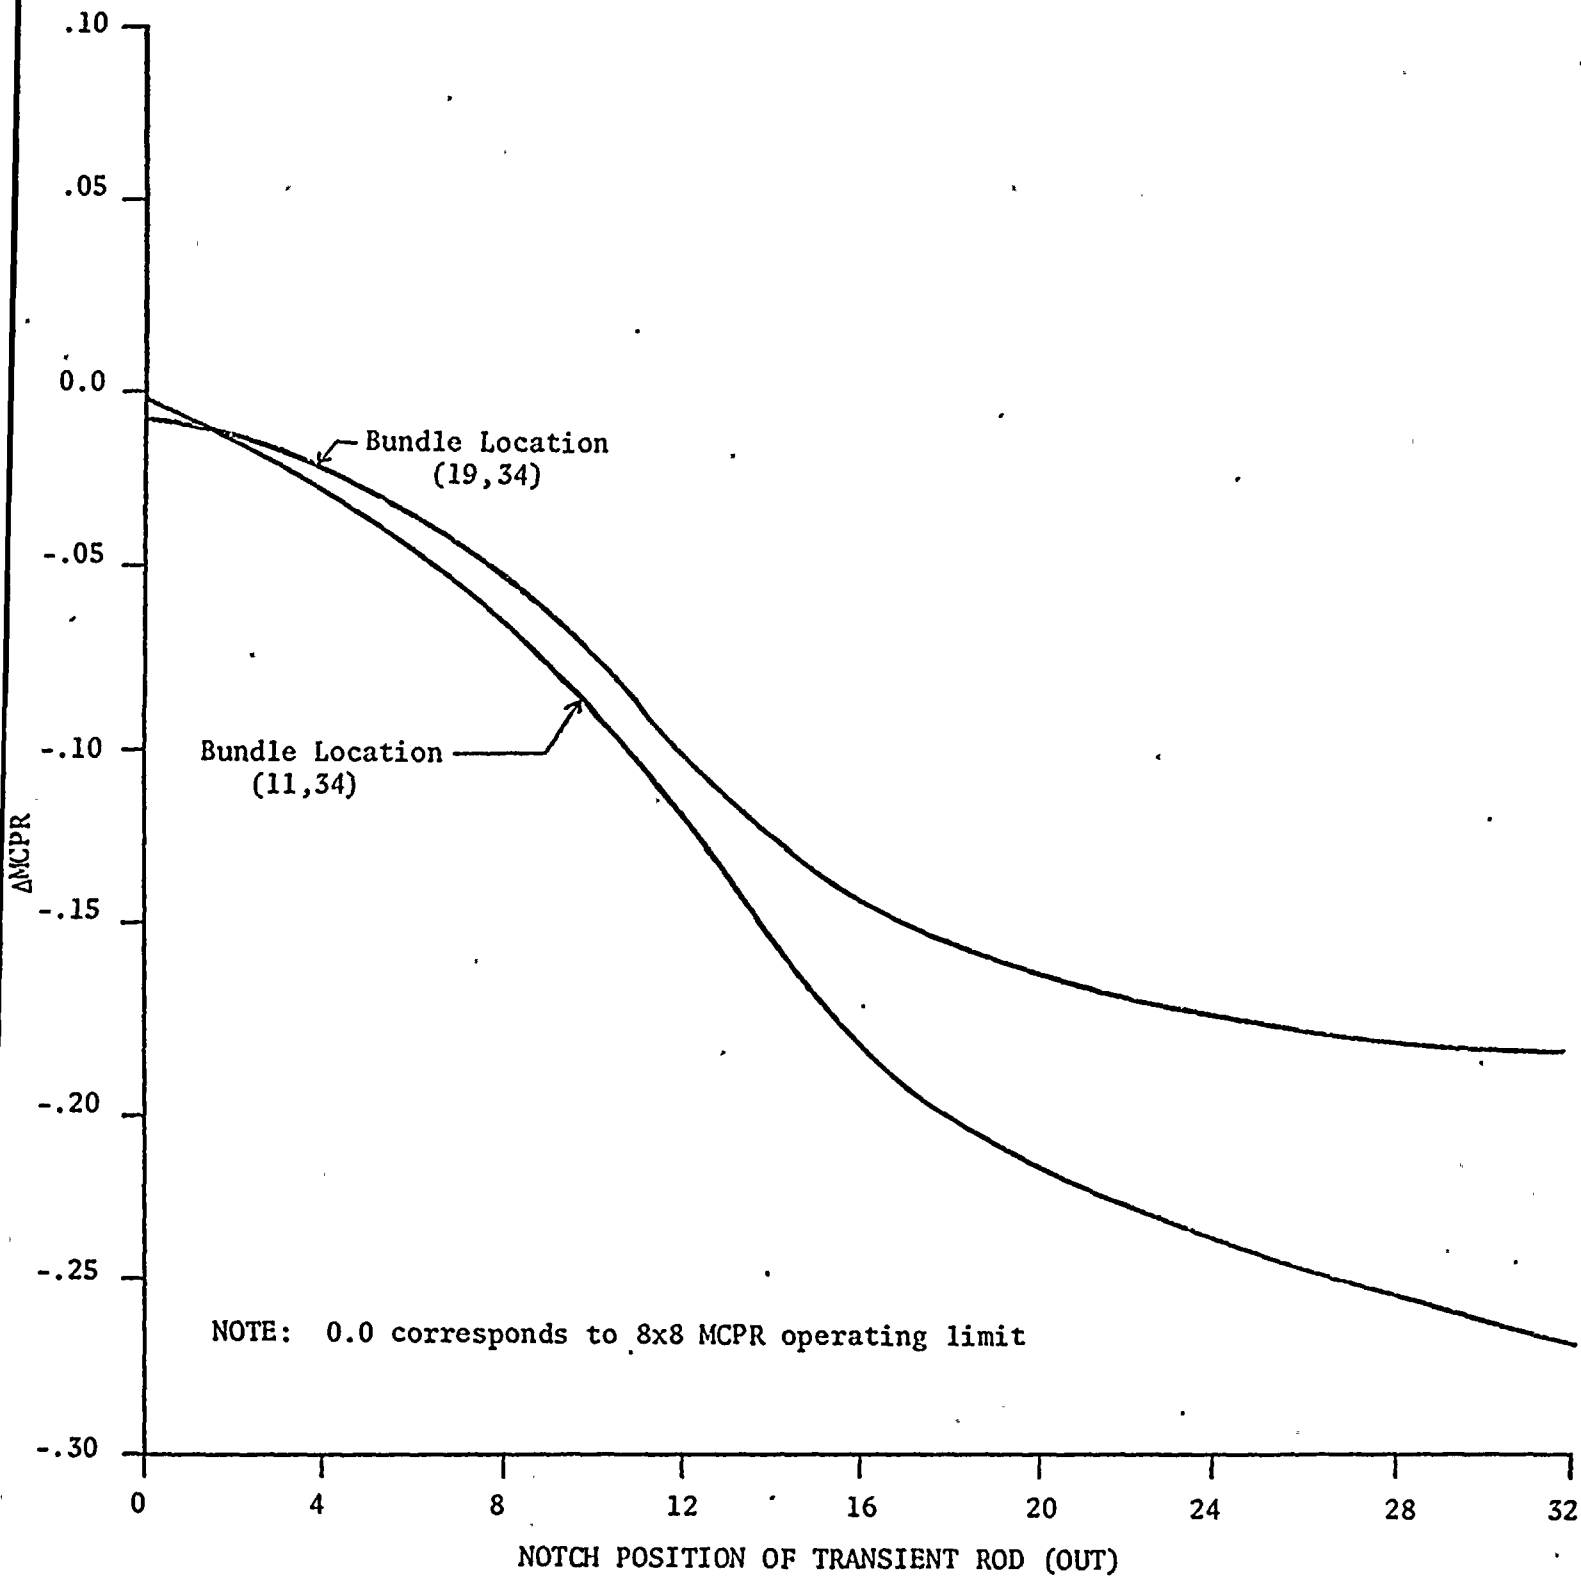


Figure 1. NMP-1 Cycle 3 Notch Position of Transient Rod versus ΔMCPR for 7x7 Fuel




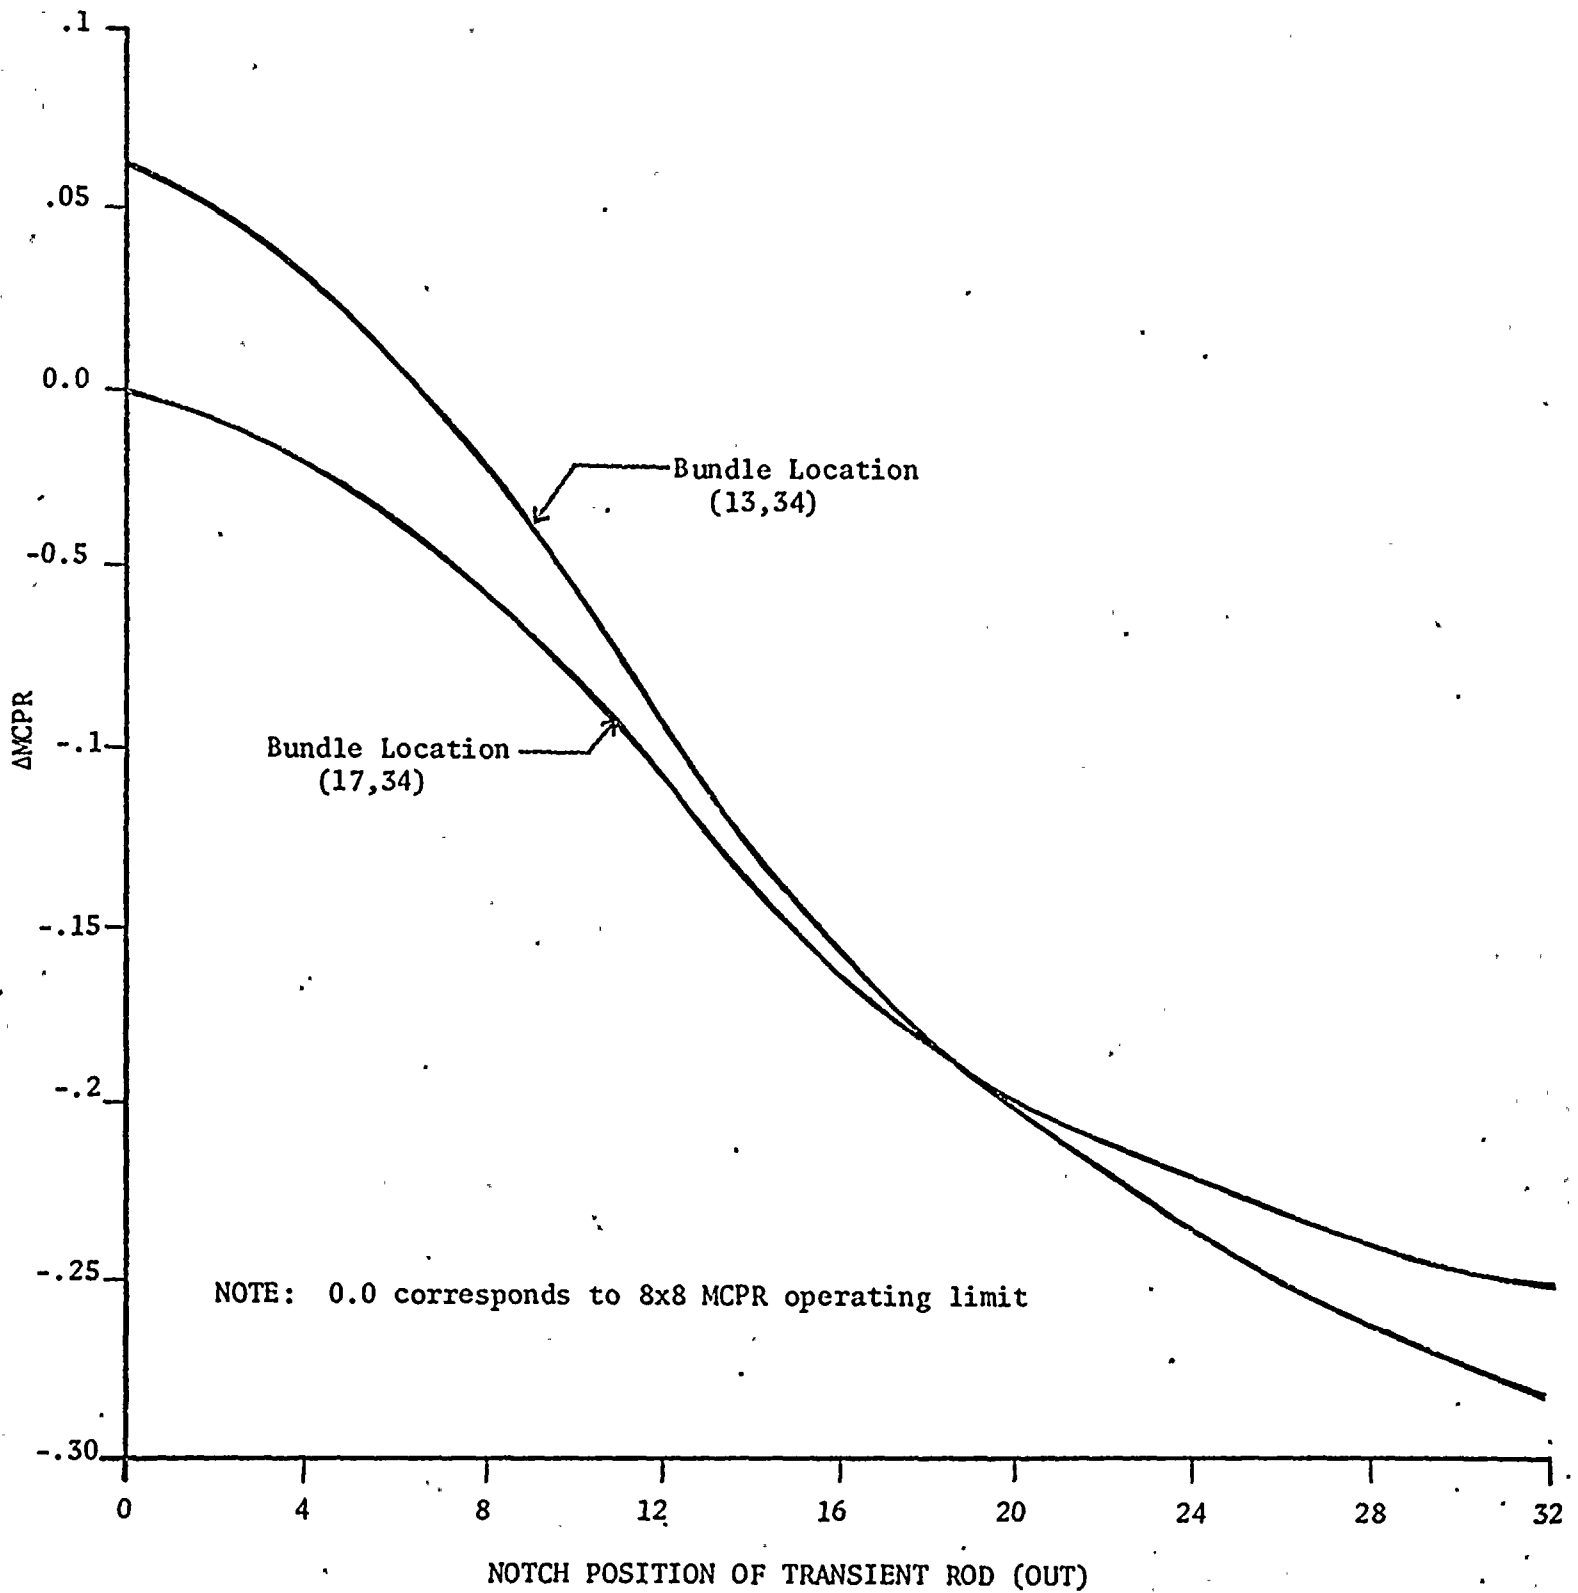


Figure 2. NMP-1 Cycle 3 Notch Position of Transient Rod versus ΔMCPR for 8x8 Fuel



REFERENCES

1. Letter from Mr. G. Lear (Nuclear Regulatory Commission) to Mr. G. K. Rhode (Niagara Mohawk), August 14, 1975.
2. Niagara Mohawk Power Corporation to United States Nuclear Regulatory Commission, "Application for Amendment to Technical Specifications," June 27, 1975.
3. GE/BWR Generic Reload Application for 8 x 8 Fuel, Supplement 2, May, 1975 (NEDO-20360).
4. Letter from Mr. P. D. Raymond (Niagara Mohawk) to Mr. A. Giambusso (Atomic Energy Commission) dated October 15, 1973.

