

700 04/14/78

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)  
DISTRIBUTION FOR INCOMING MATERIAL 50-220

REC: LEAR G  
NRC

ORG: DISE D P  
NIAGARA MOHAWK PWR

DOC DATE: 04/13/78  
DATE RCVD: 04/14/78

DOCTYPE: LETTER NOTARIZED: .NO  
SUBJECT:

COPIES RECEIVED  
LTR 1 ENCL 0

ADVISING INSTALLATION OF SUBJECT FACILITY'S HIGH REACTOR VESSEL WATER LEVEL TRIP ON THE SHAFT-DRIVEN REACTOR FEEDWATER PUMP WILL BE COMPLETED DURING THE SPRING 1979 REFUELING OUTAGE.

PLANT NAME: NINE MILE PT - UNIT 1

REVIEWER INITIAL: XJM  
DISTRIBUTOR INITIAL: JL

\*\*\*\*\* DISTRIBUTION OF THIS MATERIAL IS AS FOLLOWS \*\*\*\*\*

GENERAL DISTRIBUTION FOR AFTER ISSUANCE OF OPERATING LICENSE.  
(DISTRIBUTION CODE A001)

FOR ACTION: BR CHIEF LEAR\*\*LTR ONLY(7)

INTERNAL:

- REG FILE\*\*LTR ONLY(1)
- I & F\*\*LTR ONLY(2)
- HANAUER\*\*LTR ONLY(1)
- EISENHUT\*\*LTR ONLY(1)
- BAER\*\*LTR ONLY(1)
- EEB\*\*LTR ONLY(1)
- J. MCGOUGH\*\*LTR ONLY(1)

- NRC PDR\*\*LTR ONLY(1)
- OELD\*\*LTR ONLY(1)
- CHECK\*\*LTR ONLY(1)
- SHAO\*\*LTR ONLY(1)
- BUTLER\*\*LTR ONLY(1)
- J COLLINS\*\*LTR ONLY(1)

EXTERNAL:


- LPDR'S
- OSWEGO, NY\*\*LTR ONLY(1)
- TIC\*\*LTR ONLY(1)
- NSIC\*\*LTR ONLY(1)
- ACRS CAT B\*\*LTR ONLY(16)

9

DISTRIBUTION: LTR 40 ENCL 0  
SIZE: 1P

CONTROL NBR: 781040211

\*\*\*\*\* THE END \*\*\*\*\*

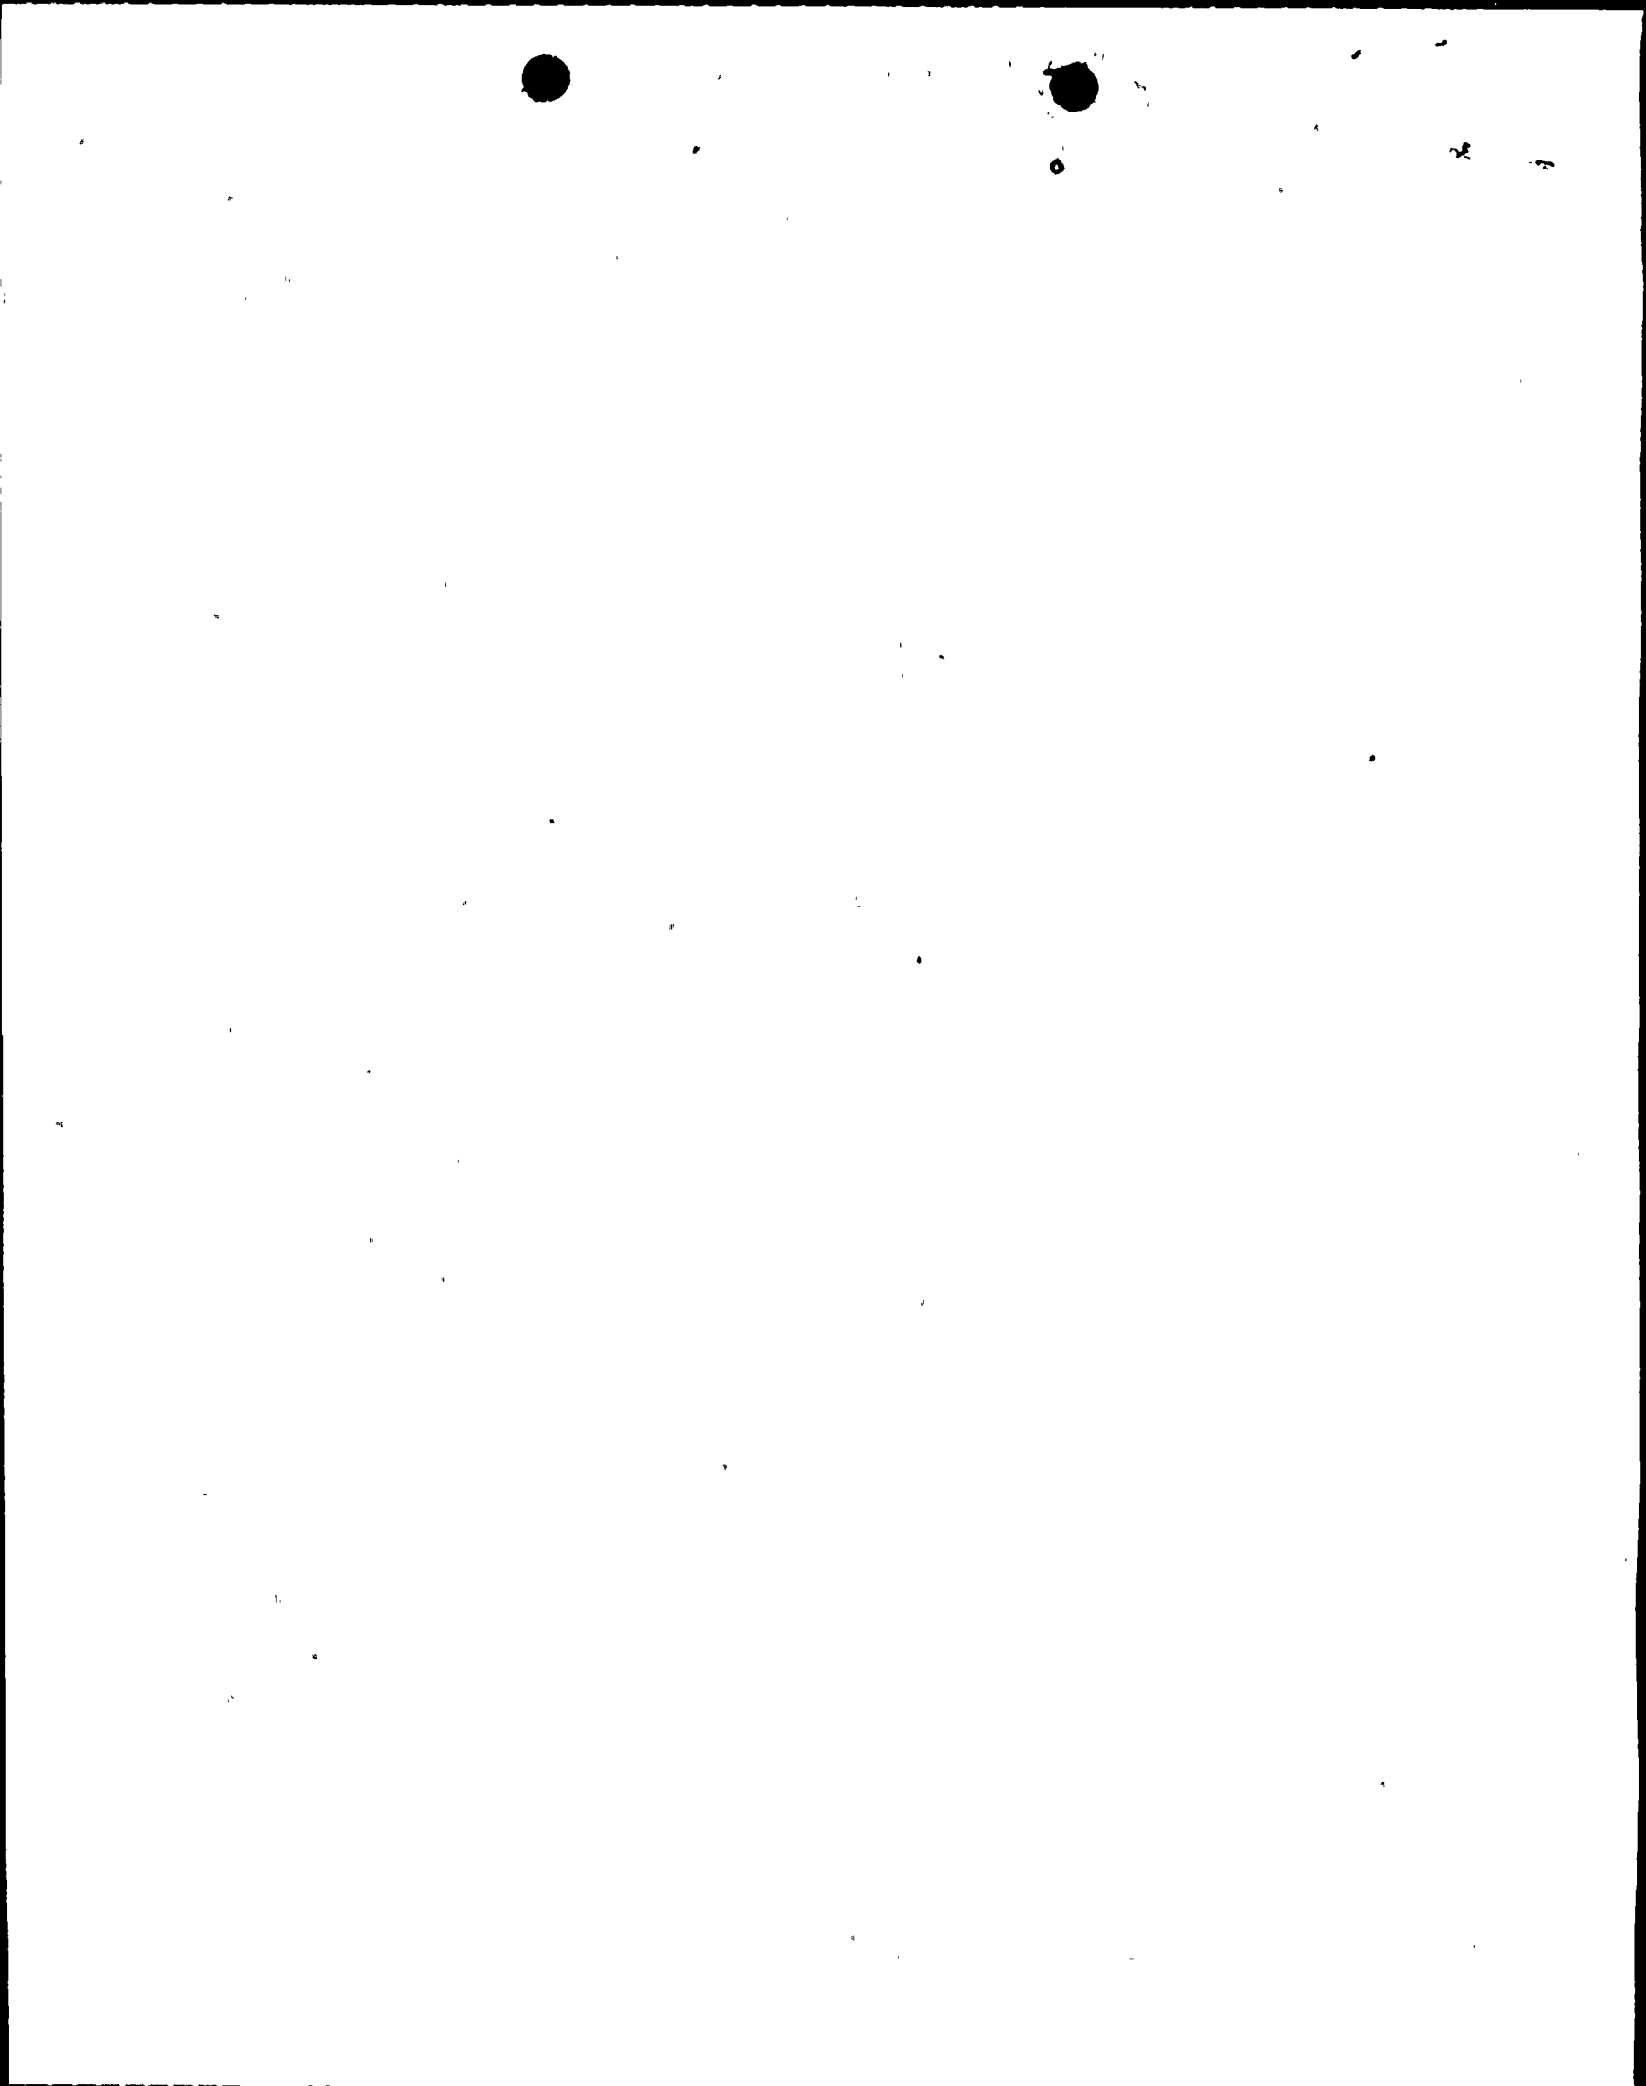

NIAGARA MOHAWK POWER CORPORATION

NIAGARA  MOHAWK

300 ERIE BOULEVARD, WEST  
SYRACUSE, N. Y. 13202

April 13, 1978

REGULATORY BUCKET FILE COPY

Director of Nuclear Reactor Regulation  
Attn: Mr. George Lear, Chief  
Operating Reactors  
Branch #3  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

Re: Nine Mile Point Unit 1  
Docket No. 50-220  
DPR-63

US NRC  
DISTRIBUTION SERVICES  
BRANCH

1978 APR 14 PM 4 04

FED DISTRIBUTION  
SERVICES UNIT

Gentlemen:

Our letter of March 2, 1978 indicated that we were evaluating the feasibility of installing a high reactor vessel water level trip on the shaft-driven reactor feed-water pump. Results of this evaluation indicate that this trip is feasible and can be accomplished by automatically disengaging the clutch between the pump and the turbine.

Installation of this trip will be completed during the Spring 1979 refueling outage.

Very truly yours,

NIAGARA MOHAWK POWER CORPORATION

*Donald P. Dise*

Donald P. Dise  
Vice President-Engineering

MGM/szd

781040211

4001  
5/10

1950

1951

1952