

D 4/19/78

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)
DISTRIBUTION FOR INCOMING MATERIAL 50-220

REC: NRC ORG: SCHNEIDER R R NIAGARA MOHAWK PWR DOCDATE: 04/10/78 DATE RCVD: 04/18/78

DOCTYPE: LETTER NOTARIZED: NO COPIES RECEIVED
SUBJECT: LTR 1 ENCL 1
FORWARDING SUBJECT FACILITY'S MONTHLY OPERATING REPT FOR THE MONTH OF MARCH,
1978.

PLANT NAME: NINE MILE PT - UNIT 1 REVIEWER INITIAL: XJM
DISTRIBUTOR INITIAL: *w*


***** DISTRIBUTION OF THIS MATERIAL IS AS FOLLOWS *****

MONTHLY OPERATING REPORT FOR GRAY BOOK PREPARATION.
(DISTRIBUTION CODE A003)

FOR ACTION: ~~BB CHIEF LEAD~~**W/2 ENCL
INTERNAL: REG FILE**W/ENCL NRC PDR**W/ENCL
~~MIRC FOR ACTION**W/2 ENCL~~
EXTERNAL: LPDR'S
OSWEGO, NY**W/ENCL
TIC**W/ENCL
NSIC**W/ENCL
BNL(NATLAB)**W/ENCL
ACRS CAT B**W/O ENCL

DISTRIBUTION: LTR 10 ENCL 10 CONTROL NBR: 781090033
SIZE: 1P+4P

***** THE END *****

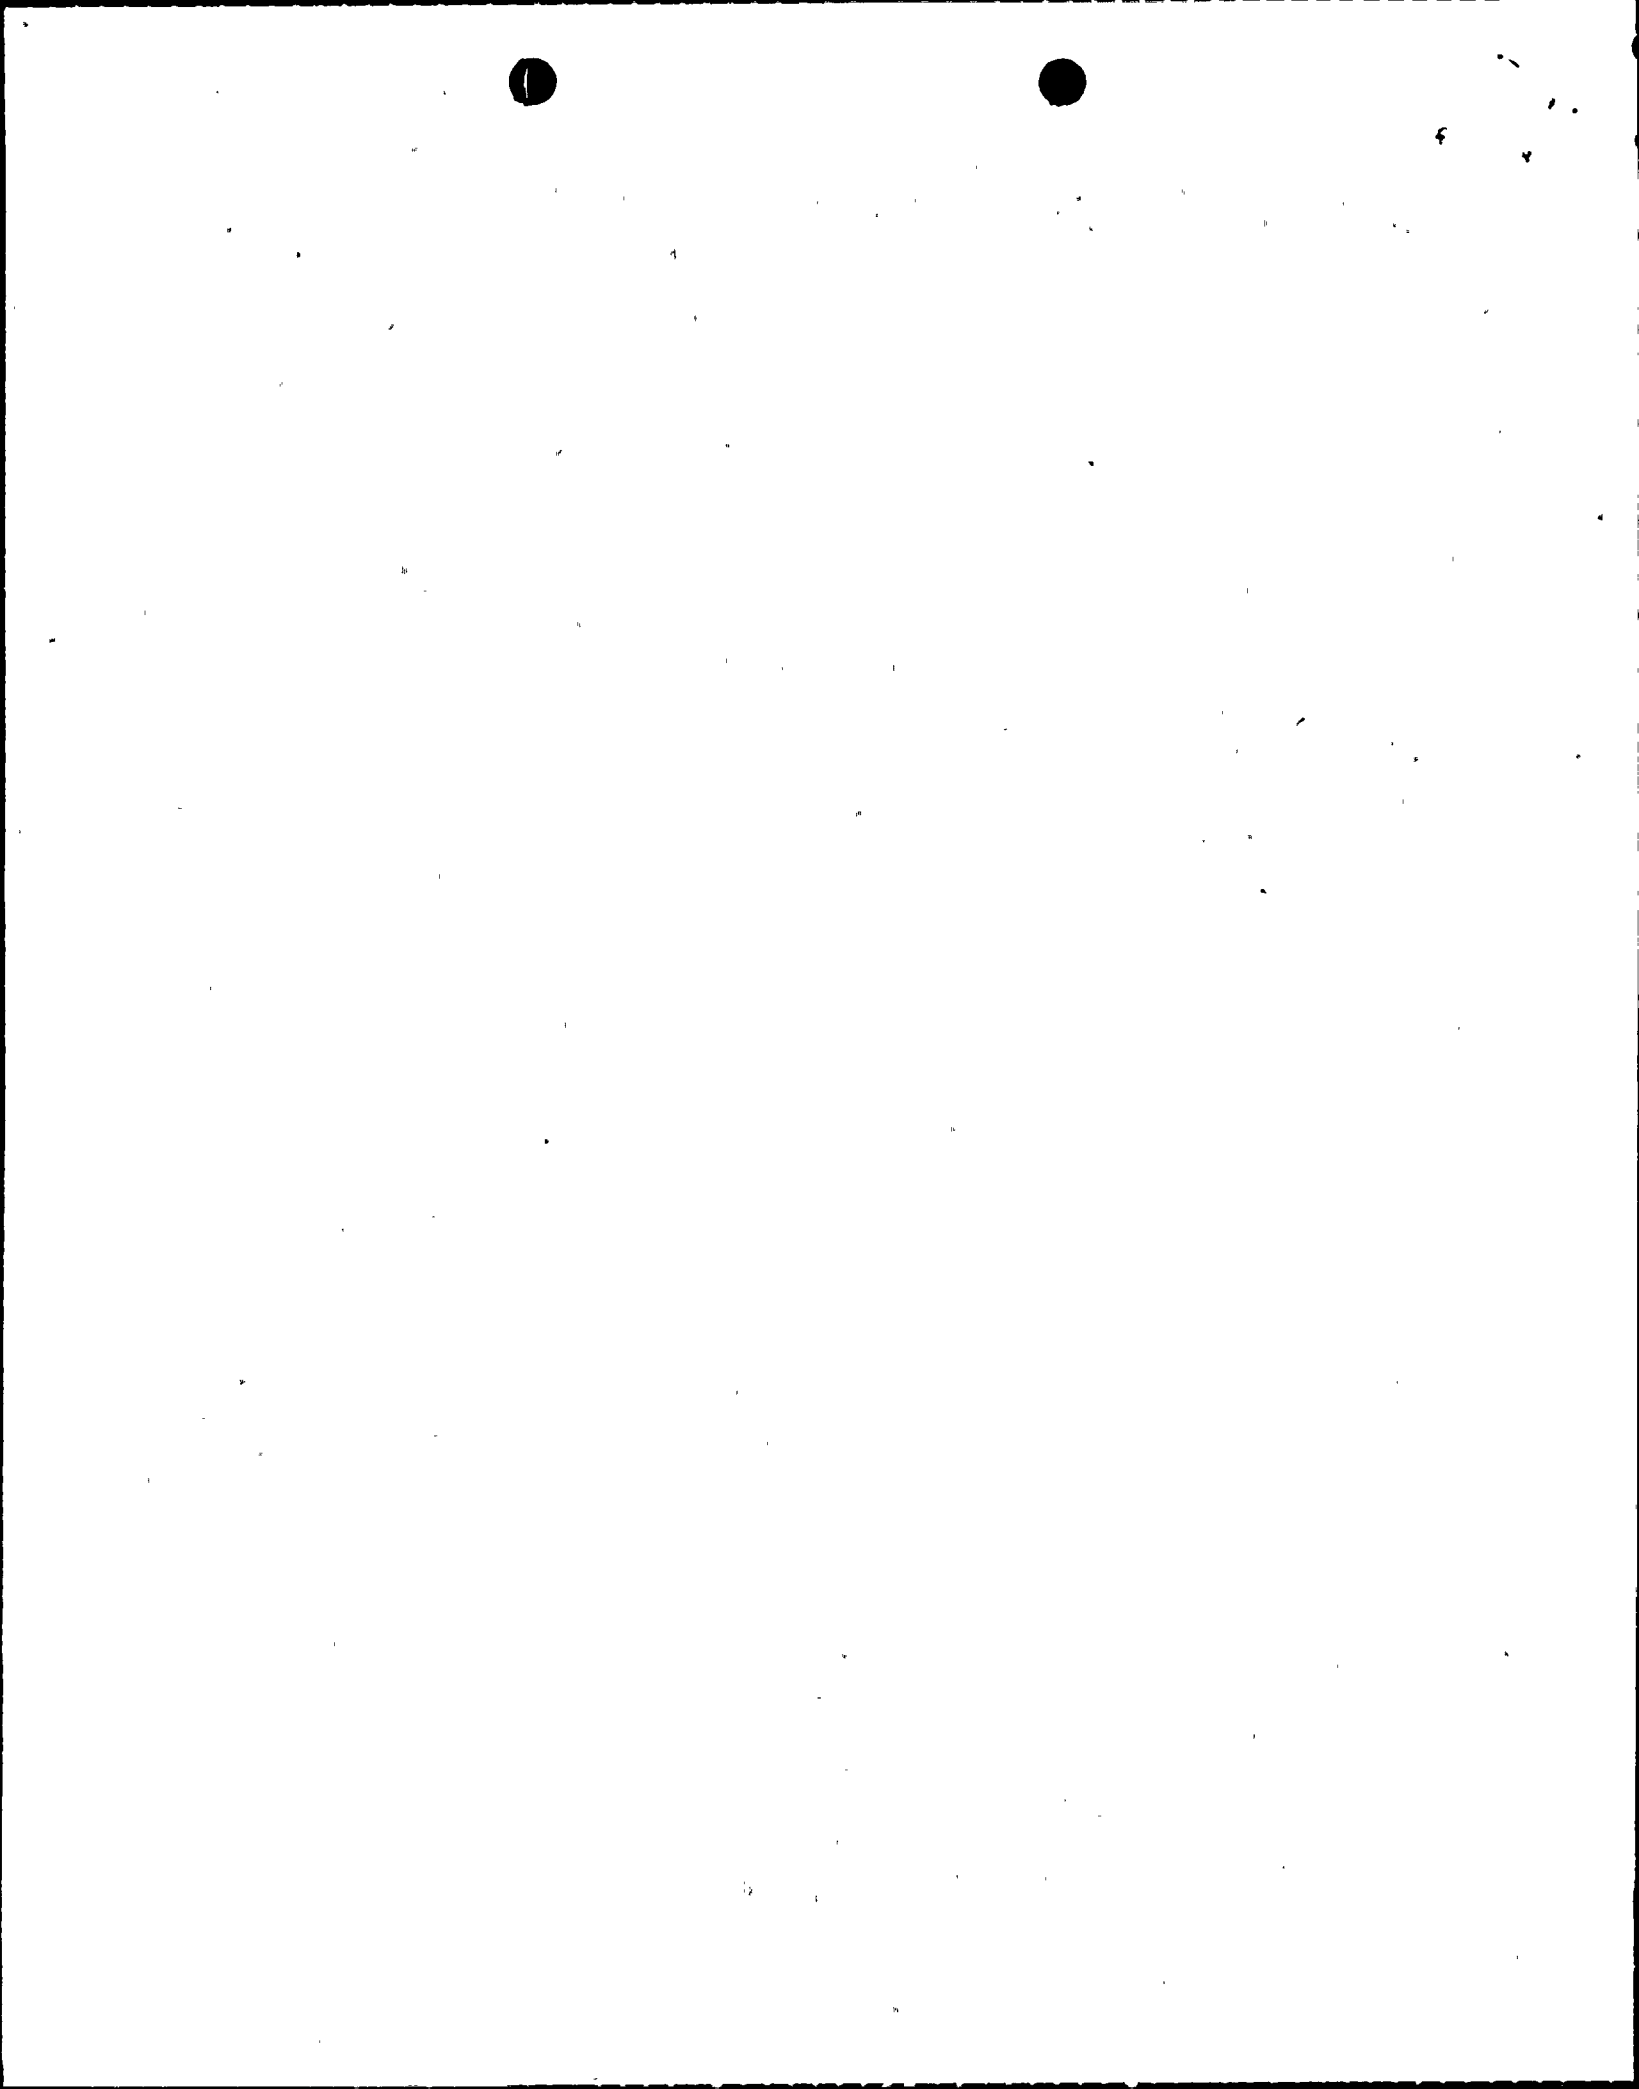

April 10, 1978

1978 APR 13 AM 11 53
RECEIVED DISTRIBUTION
SERVICES UNIT
DIS: ... FOR SERVICES
... ARCH

Director
Office of Management Information
and Program Control
United States Nuclear Regulatory Commission
Washington, D.C. 20555

RE: Docket No. 50-220
DPR-63

Gentlemen:

Submitted herewith is the Report of Operating Statistics and Shutdown Experience for March 1978 for the Nine Mile Point Nuclear Station Unit #1. Also included is a narrative report of Operating Experience for the month.

Very truly yours,

R.R. Schneider
R.R. Schneider
Vice President -
Electric Production

Enclosures

mtm

xc: Director, Office of I&E (10 copies)
NRC Region I Office (1 copy)

REGULATORY DOCKET FILE COPY

781090033

A003
5/11

OPERATING DATA REPORT

DOCKET NO. 50-220
 DATE _____
 COMPLETED BY T.J. Perkins
 TELEPHONE 315 343-2110
 ex 1312

OPERATING STATUS

1. Unit Name: Nine Mile Point Unit #1
2. Reporting Period: 03/01/78 03/31/78
3. Licensed Thermal Power (MWt): 1850
4. Nameplate Rating (Gross MWe): 640
5. Design Electrical Rating (Net MWe): 620
6. Maximum Dependable Capacity (Gross MWe): 630
7. Maximum Dependable Capacity (Net MWe): 610
8. If Changes Occur in Capacity Ratings (Items Number 3 Through 7) Since Last Report, Give Reasons: _____

Notes

9. Power Level To Which Restricted, If Any (Net MWe): _____
10. Reasons For Restrictions, If Any: _____

	This Month	Yr.-to-Date	Cumulative
11. Hours In Reporting Period	744	2160.0	73,752
12. Number Of Hours Reactor Was Critical	744	2111.1	53,180.0
13. Reactor Reserve Shutdown Hours	0	0	1,204.0
14. Hours Generator On-Line	744	2087.3	50,777.5
15. Unit Reserve Shutdown Hours	0	0	20.2
16. Gross Thermal Energy Generated (MWH)	1,317,536	3,645,422	82,099,431
17. Gross Electrical Energy Generated (MWH)	448,174	1,240,041	27,021,753
18. Net Electrical Energy Generated (MWH)	433,263	1,198,448	26,175,371
19. Unit Service Factor	100	96.6	68.8
20. Unit Availability Factor	100	96.6	68.9
21. Unit Capacity Factor (Using MDC Net)	95.5	90.9	58.2
22. Unit Capacity Factor (Using DER Net)	93.9	89.5	57.2
23. Unit Forced Outage Rate	0	5.1	11.2

24. Shutdowns Scheduled Over Next 6 Months (Type, Date, and Duration of Each):
April 24, 1978 Snubber Inspection (Subject to change due to fossil unit availability)

25. If Shut Down At End Of Report Period, Estimated Date of Startup: _____

26. Units In Test Status (Prior to Commercial Operation):	Forecast	Achieved
INITIAL CRITICALITY	_____	_____
INITIAL ELECTRICITY	_____	_____
COMMERCIAL OPERATION	_____	_____

AVERAGE DAILY UNIT POWER LEVEL

DOCKET NO. 50-220

UNIT 9 Mile Pt.

DATE _____

COMPLETED BY T.J. Perkins

TELEPHONE 315 343-2110
ex 1312

MONTH March

DAY	AVERAGE DAILY POWER LEVEL (MWe-Net)
1	607
2	609
3	609
4	609
5	610
6	608
7	607
8	607
9	605
10	606
11	606
12	591
13	605
14	607
15	610
16	607

DAY	AVERAGE DAILY POWER LEVEL (MWe-Net)		
17	607		
18	608		
19	610		
20	607		
21	608		
22	606		
23	593	}	
24	273		Rod Swap
25	414		& Demin Change
26	519		
27	575	}	
28	596		Flux Pattern
29	587		
30	588		
31	579	Economy	

INSTRUCTIONS

On this format, list the average daily unit power level in MWe-Net for each day in the reporting month. Compute to the nearest whole megawatt.



UNIT SHUTDOWNS AND POWER REDUCTIONS

DOCKET NO. 50-220
 UNIT NAME 9 Mile Pt.
 DATE _____
 COMPLETED BY T. J. Perkins
 TELEPHONE 315 343-2110
 ex 1312

REPORT MONTH March

No.	Date	Type ¹	Duration (Hours)	Reason ²	Method of Shutting Down Reactor ³	Licensee Event Report #	System Code ⁴	Component Code ⁵	Cause & Corrective Action to Prevent Recurrence
0	3/12	S	3.4	H	Recirc Flow	NA			Change Condensate Demin
0	3/23	S	6.9	H	Recirc Flow	NA			Rod Swap
0	3/31	S	2.0	F	Recirc Flow Rods	NA			Economy

¹
 F: Forced
 S: Scheduled

²
 Reason:
 A-Equipment Failure (Explain)
 B-Maintenance of Test
 C-Refueling
 D-Regulatory Restriction
 E-Operator Training & License Examination
 F-Administrative
 G-Operational Error (Explain)
 H-Other (Explain)

³
 Method:
 1-Manual
 2-Manual Scram.
 3-Automatic Scram.
 4-Other (Explain)

⁴
 Exhibit G - Instructions for Preparation of Data Entry Sheets for Licensee Event Report (LER) File (NUREG-0161)

⁵
 Exhibit I - Same Source

(9/77)

NIAGARA MOHAWK POWER CORPORATION
NINE MILE POINT NUCLEAR STATION UNIT #1

NARRATIVE OF OPERATING EXPERIENCE
MARCH 1978

The station operated at 100% availability and 95.5% capacity factor for the month. The daily operating history follows:

- March 1 to March 23 Operated at a steady state power level of approximately 621 MWe and 1836 MWt.
- March 23 At 2055, started load reduction for a control rod sequence change.
At 2220, the unit load was 290 MWe with recirculation flow at minimum.
- March 24 At 0320 after the control rod sequence change was completed, unit load was 161 MWt. Started to pull rods to increase load.
At 2230, unit load was 352 MWe. Continued to increase load at the preconditioning rate via recirculation flow increases.
- March 25 & March 26 Continued to increase load within PCIOMR Limits.
- March 27 Load at 582 MWe and 1750 MWt. Continued to increase load at preconditioning rate.
- March 28 At 0000, unit load was 601 MWe and 1807 MWt. Continued to increase load at the preconditioning rate.
At 0800, unit load reached 616 MWe and 1815 MWt. Holding here due to core thermal limits.
- March 29 to March 31 Steady state operation of approximately 602 MWe and 1785 MWt.
- March 31 At 2200, started a load reduction via recirculation flow for economy reasons.
At 2300, unit load reached 325 MWe and 1042 MWt.