

**NIAGARA DISTRIBUTION FOR PART 50 DOCKET MATERIAL
(TEMPORARY FORM)**

CONTROL NO: 7907
FILE: _____

FROM: Niagara Mohawk Power Co. Syracuse, N. Y. G.K. Rhode		DATE OF DOC 7-21-75	DATE REC'D 7-25-75	LTR XXX	TWX	RPT	OTHER
TO: Karl R. Goller		ORIG 1 Signed	CC	OTHER	SENT NRC PDR _____ XXXX SENT LOCAL PDR _____ XXXX		
CLASS	UNCLASS XXX ^X	PROP INFO	INPUT	NO CYS REC'D 1	DOCKET NO: 50-220		
DESCRIPTION: Re our ltr. of 6-18-75 trans the following...				ENCLOSURES: Advising Refueling shutdown scheduled for 9-13-75... Scheduled date for restart following refueling..11-9-75 (1 cy. Encl. rec'd)			
PLANT NAME: Nine Mile Pt. # 1							

ACKNOWLEDGED
DO NOT REMOVE

FOR ACTION/INFORMATION

VCR 7-30-75

- | | | | |
|-------------------------|----------------------------|-----------------------------|------------------------|
| BUTLER (L)
W/ Copies | SCHWENCER (L)
W/ Copies | ZIEMANN (L)
W/ Copies | REGAN (E)
W/ Copies |
| CLARK (L)
W/ Copies | STOLZ (L)
W/ Copies | DICKER (E)
W/ Copies | LEAR (L)
W/ Copies |
| PARR (L)
W/ Copies | VASSALLO (L)
W/ Copies | KNIGHTON (E)
W/ Copies | SPIES
W/ Copies |
| KNIEL (L)
W/ Copies | PURPLE (L)
W/ Copies | YOUNGBLOOD (E)
W/ Copies | LPM
W/ Copies |

INTERNAL DISTRIBUTION


- | | | | | |
|--|--|---|---|---|
| REG FILE
NRC PDR
OGC, ROOM P-506A
GOSSICK/STAFF
CASE
GIAMBUSSO
BOYD
MOORE (L)
DEYOUNG (L)
SKOVHOLT (L)
GOLLER (L) (Ltr)
P. COLLINS
DENISE
REG OPR
FILE & REGION (2)
MIPC | <u>TECH REVIEW</u>
SCHROEDER
MACCARY
KNIGHT
PAWLICKI
SHAO
STELLO
HOUSTON
NOVAK
ROSS
IPPOLITO
TEDESCO
J. COLLINS
LAINAS
BENAROYA
VOLLMER | DENTON
GRIMES
GAMMILL
KASTNER
BALLARD
SPANGLER

<u>ENVIRO</u>
MULLER
DICKER
KNIGHTON
YOUNGBLOOD
REGAN
PROJECT LDR
HARLESS | <u>LIC ASST</u>
R. DIGGS (L)
H. GEARIN (L)
E. GOULBOURNE (L)
P. KREUTZER (E)
J. LEE (L)
M. RUSHBROOK (L)
S. REED (E)
M. SERVICE (L)
S. SHEPPARD (L)
M. SLATER (E)
H. SMITH (L)
S. TEETS (L)
G. WILLIAMS (E)
V. WILSON (L)
R. INGRAM (L)
M. DUNCAN (E) | <u>A/T IND.</u>
BRAITMAN
SALTZMAN
MELTZ


<u>PLANS</u>
MCDONALD
CHAPMAN
DUBE (Ltr) <i>Aug 1975</i>
E. COUPE
PETERSON
HARTFIELD (2)
KLECKER
EISENHUT
WIGGINTON |
|--|--|---|---|---|

EXTERNAL DISTRIBUTION


- | | | |
|-----------------------------------|--------------------------------|------------------------|
| 1 - LOCAL PDR <i>Overseas NY</i> | 1 - NATIONAL LABS _____ | 1 - PDR-SAN/LA/NY |
| 1 - TIC (ABERNATHY) (1)(2)(10) | 1 - W. PENNINGTON, Rm E-201 GT | 1 - BROOKHAVEN NAT LAB |
| 1 - NSIC (BUCHANAN) | 1 - CONSULTANTS | 1 - G. ULRIKSON ORNL |
| 1 - ASLB | NEWMARK/BLUME/AGBABIAN | |
| 1 - Newton Anderson | | |
| 16 ACRS HOLDING/SENT <i>Leets</i> | | |



NIAGARA MOHAWK POWER CORPORATION

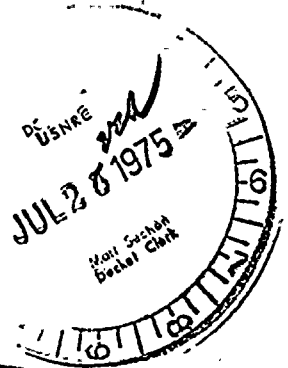NIAGARA  MOHAWK300 ERIE BOULEVARD WEST
SYRACUSE, N. Y. 13202

July 21, 1975

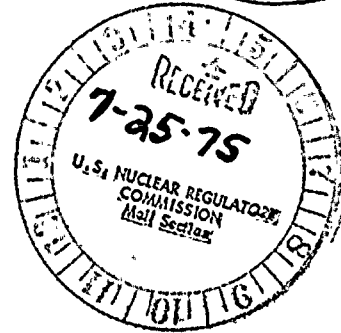

Mr. Karl R. Goller, Assistant Director
Operating Reactors
Division of Reactor Licensing
United States Nuclear Regulatory Commission
Washington, D. C. 20555

Re: Nine Mile Point Unit 1
Docket No. 50-220


Dear Mr. Goller:

The attached refueling information for Nine Mile Point Unit 1 is in response to your June 18, 1975 letter. Our present plans provide for plant shutdown on September 13, 1975 and start-up, following the refueling, on November 9, 1975.

The reload license amendment submittal will be provided by August 15, 1975 in accordance with the requirements of Enclosure 1 of your letter. We regret that this does not meet your requested 90 day lead-time. A heavy licensing workload at our fuel supplier is the reason for the delay.

Sincerely,

NIAGARA MOHAWK POWER CORPORATION



G. K. Rhode
Vice President-Engineering

Attachment

7907

after



1-2-78

MEMORANDUM FOR THE RECORD

SUBJECT: [Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

[Illegible]

Refueling Information Request

1. Name of Facility: Nine Mile Point Unit 1
2. Scheduled date for next refueling shutdown: September 13, 1975
3. Scheduled date for restart following refueling: November 9, 1975
4. Will refueling or resumption of operation thereafter require a technical specification change or other license amendment?: Yes

There will be minor changes to Minimum Critical Power Ratio (MCPR) and possible changes to Rod Block Limits. The MCPR changes will arise from cycle dependent analyses of the most limiting MCPR transient. The possible changes to the Rod Block Limits will be based on cycle dependent analyses of the Rod Withdrawal Error transient.

5. Scheduled date(s) for submitting proposed licensing action and supporting information: August 15, 1975.
6. Important licensing considerations associated with refueling, e.g., new or different fuel design or supplier, unreviewed design or performance analysis methods, significant changes in fuel design, new operating procedures:

A cycle dependent analysis may require review of a Control Rod Drop accident which is outside the generic boundary approach.

(# 10) name me (10)