

DISTRIBUTION

Docket File
AEC PDR
RP Reading File
Branch Reading File
DJSkovholt, L:OR
ACRS (16)
RO (3)
OGC
RfShceme
DLZiemann, L:ORB#2
TJCarter, L:OR
CJDeBevec, L:ORB#2
RMDiggs, L:ORB#2

AUG 15 1973

Docket No. 50-220

Niagara Mohawk Power Corporation
ATTN: Mr. Philip D. Raymond
Vice President - Engineering
300 Erie Boulevard West
Syracuse, New York 13202

Gentlemen:

We have reviewed your proposed design of the Cask Drop Protection System to be installed in Nine Mile Point Unit 1 as described in your letters to us dated September 29, 1972, and May 31, 1973, which supersedes the proposed design described in your application submitted July 5, 1972, for a full-term operating license. We have concluded from our review that this proposed Cask Drop Protection System is acceptable for installation at Nine Mile Point Unit 1 and provides reasonable protection against loss of integrity of the fuel pool and against damage to stored spent fuel in the event a fuel cask is dropped in the pool.

The Redundant Hoisting System and Crane Movement Controls proposed by your letter of July 26, 1973, to be installed in Nine Mile Point Unit 1 was not considered in our review discussed above. This proposal will be reviewed at a later date.

Sincerely,

Original Signed by
D. J. Skovholt

Donald J. Skovholt
Assistant Director for
Operating Reactors
Directorate of Licensing


cc: Arvin E. Upton, Esquire
LeBoeuf, Lamb, Leiby & MacRae
1821 Jefferson Place, N. W.
Washington, D. C. 20036

Oswego City Library
120 E. Second Street
Oswego, New York 13126

J. Bruce MacDonald, Esquire
Deputy Commissioner and Counsel
New York State Department of
Commerce and Counsel to the

Dr. William Seymour, Staff
Coordinator (w/incoming of
9/29/72, 5/31/73 & 7/26/73)
N. Y. Atomic Energy Council
N. Y. Department of Commerce

OFFICE ▶	Atomic Energy Council 99 Washington Avenue Albany, New York 12210	L:ORB#2 CJDeBevec:dc	112 State Street Albany, New York 12207	L:ORB#2 RMDiggs DLZiemann	L:ORB#2 DJSkovholt
SURNAME ▶					
DATE ▶		8/14/73	8/14/73	8/14/73	8/14/73

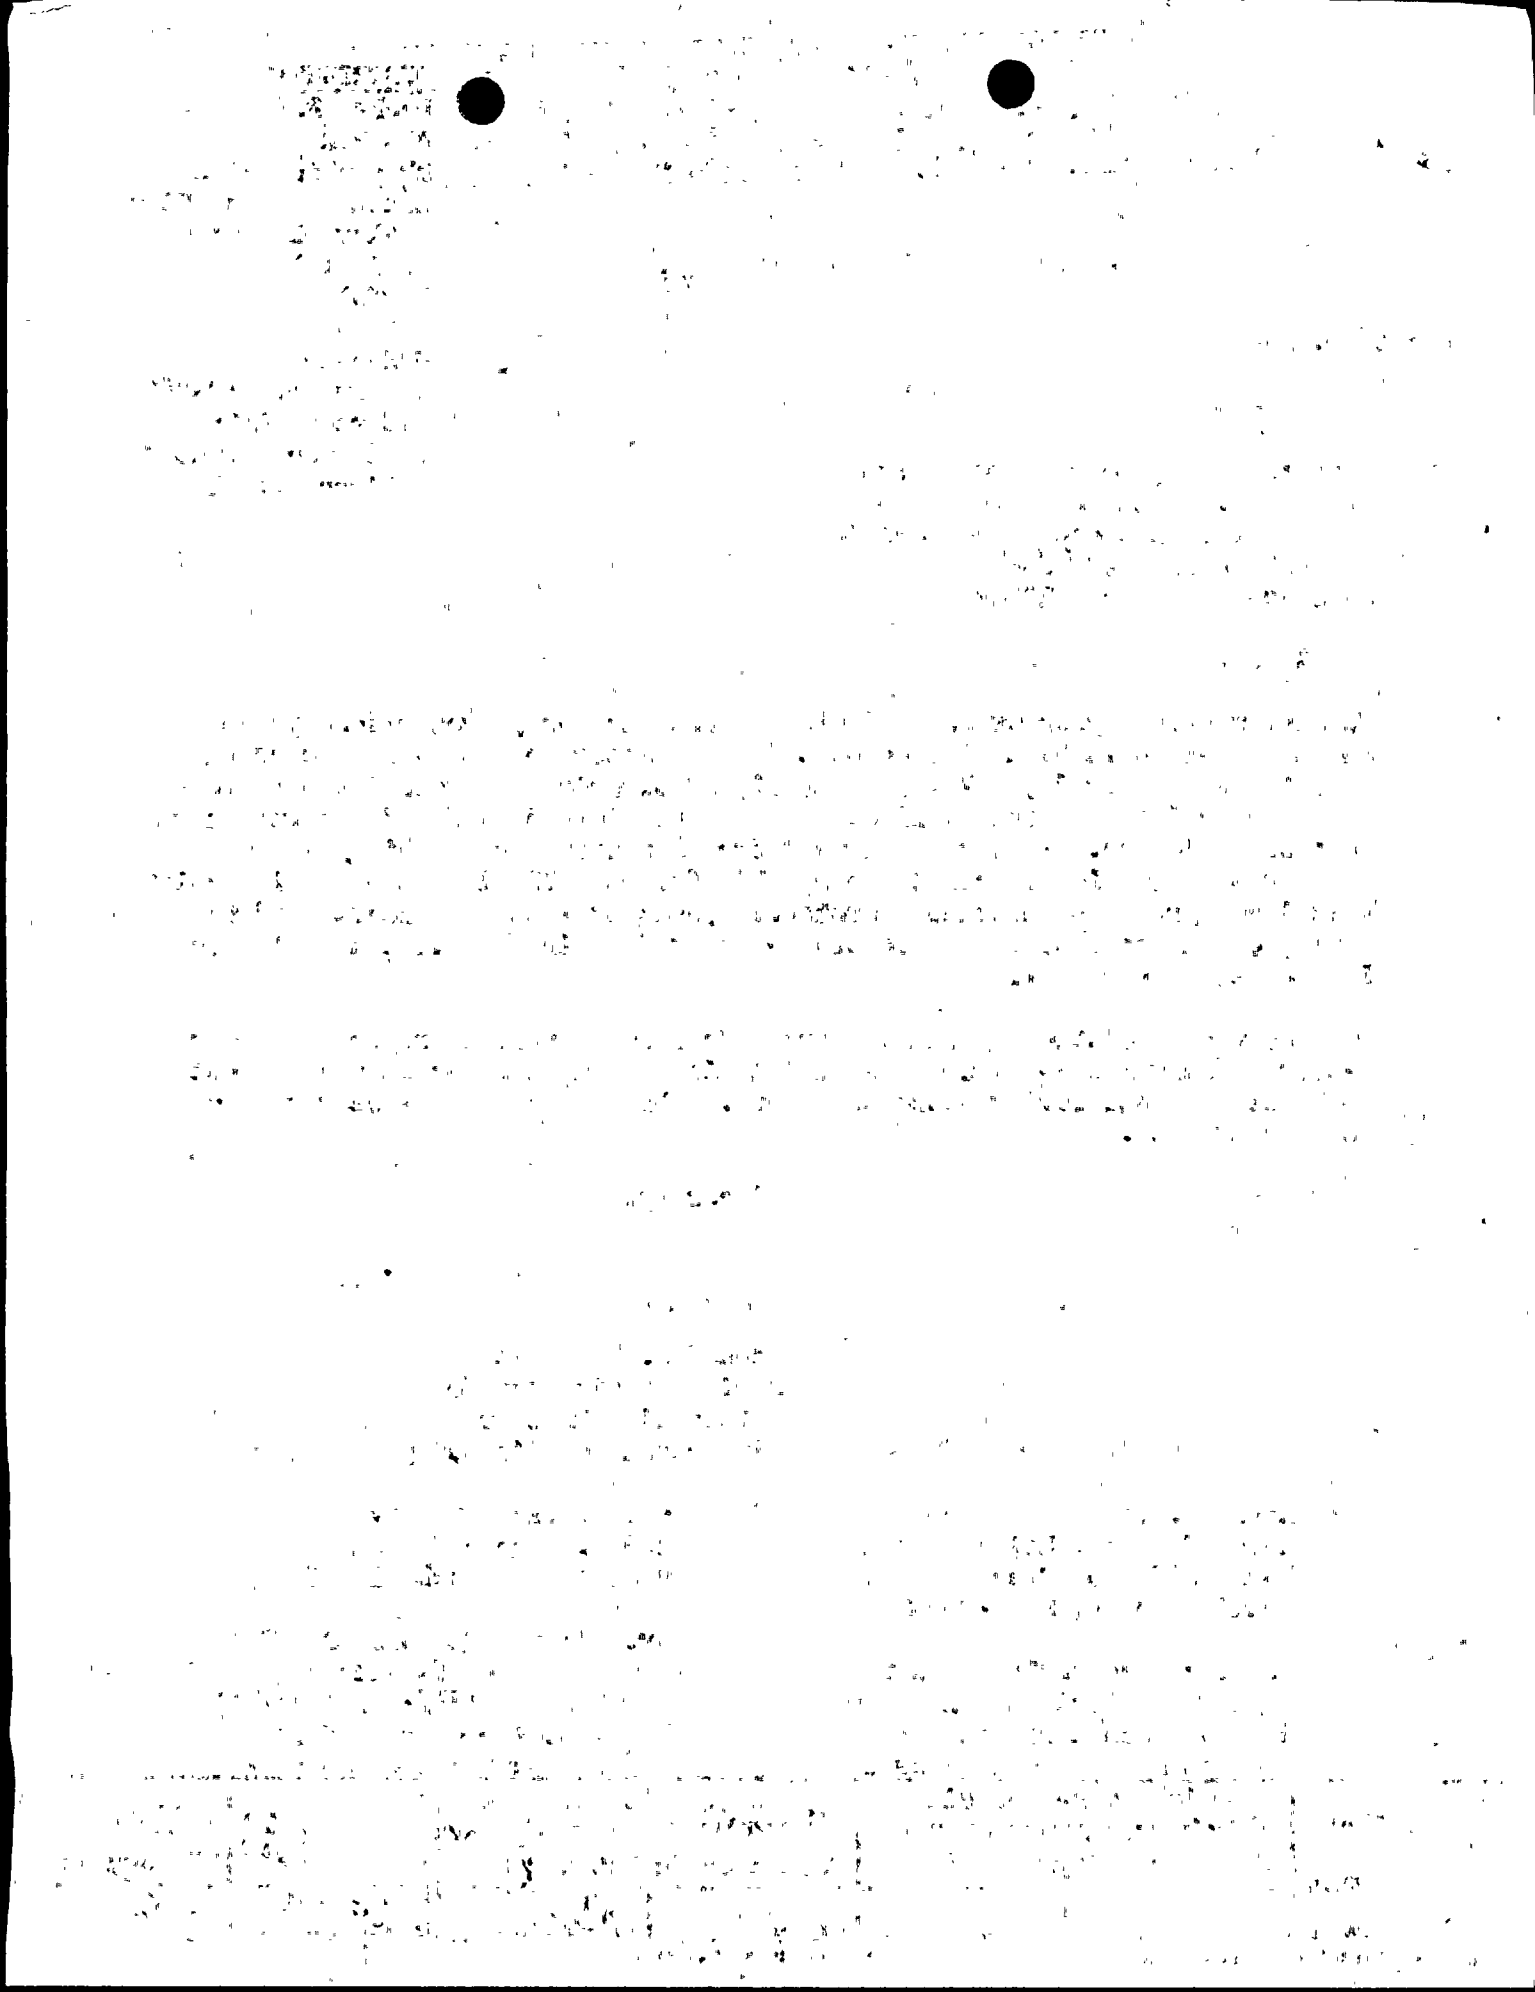

OCT 19 1973

Docket No. 50-220

Niagara Mohawk Power Corporation
ATTN: Mr. Philip D. Raymond
Vice President - Engineering
300 Erie Boulevard West
Syracuse, New York 13202

Gentlemen:

The Regulatory staff has had the subject of anticipated transients without scram (ATWS) in water-cooled reactor power plants under study for some time.

The staff has completed its review of ATWS and has concluded that measures should be taken to improve nuclear plant designs in this regard. Details of the staff review and conclusions and of the steps that should be taken to deal with ATWS are given in the staff "Technical Report on Anticipated Transients Without Scram for Water-Cooled Power Reactors", September 1973, a copy of which is enclosed for your information.

You have included an analysis of the capability of Nine Mile Point Unit I to accommodate an ATWS event in your application for conversion of Provisional Operating License No. DPR-17 to a full-term operating license. This analysis concluded that the trip of the recirculation pumps combined with liquid poison injection would effectively augment the present reactor safety system design. In a letter to you dated September 28, 1973, regarding additional information on the full-term license review, we requested that you propose appropriate technical specifications to reflect the requirement of tripping the recirculation pumps whenever reactor pressure is equal to or greater than 1150 psia.

180

1950

...

...

...

...

...

...

...

...

...

...

...

...

...

...

OCT 19 1973

This approach may be considered to be an acceptable measure for your facility in reference to the provisions set forth in Section II-C of Appendix A to the staff report on ATWS. In addition, you are requested to review your analysis and conclusions against the staff position described in the enclosed report and confirm that your proposal is consistent with the staff position. Please provide this confirmation by December 1, 1973.

Sincerely,

for *KL* Roger Boyd
 for A. Giambusso, Deputy Director
 for Reactor Projects
 Directorate of Licensing

Enclosure:
 Technical Report on Anticipated
 Transients Without Scram for
 Water-Cooled Power Reactors

cc w/enclosure:
 J. Bruce MacDonald, Esquire
 Deputy Commissioner and Counsel
 New York State Department of Commerce
 and Counsel to the Atomic Energy Council
 99 Washington Avenue
 Albany, New York 12210

Arvin E. Upton, Esquire
 LeBoeuf, Lamb, Leiby & MacRae

Dr. William Seymour
 Staff Coordinator
 N. Y. State Atomic Energy Council
 112 State Street
 Albany, New York 12207

Oswego City Library

Distribution

- Docket File
- AEC PDR
- L Reading
- RP Reading
- Branch Reading
- DJSkovholt, L:OR
- AGiambusso, L:RP
- TJCarter, L:OR
- ACRS (16)
- RO (3)
- OGC
- DLZiemann, L:ORB #2
- CJDeBevec, L:ORB #2
- RMDiggs, L:ORB #2
- JMHendrie, L:TR

OFFICE ▶	L:ORB #2	L:ORB #2	L:ORB #2	L:TR	L:OR	L:RP
	X7403					
SURNAME ▶	CJDeBevec:rwg	RMDiggs	DLZiemann	JMHendrie	DJSkovholt	AGiambusso
DATE ▶	10/10/73	10/10/73	10/10/73	10/11/73	10/15/73	10/18/73

