

AEC DISTRIBUTION FOR PART 50 DOCKET MATERIAL
(TEMPORARY FORM)

8642

CONTROL NO: _____

FILE: _____

FROM: Niagara Mohawk Power Corporation Syracuse, N.Y. 13202 Mr. R.R. Schneider			DATE OF DOC 11-30-73	DATE REC'D 12-4-73	LTR X	MEMO	RPT	OTHER
TO: A. Giambusso			ORIG 1 signed	CC	OTHER	SENT AEC PDR SENT LOCAL PDR		XXX XXX
CLASS	UNCLASS XXX	PROP INFO	INPUT	NO CYS REC'D 1	DOCKET NO: 50-220			

DESCRIPTION:
Ltr re our 10-19-73 ltr....concerning reanalyses of the anticipated transients with scram, adv that this study has been initiated and will be submitted by 10-1-74, as requested in our ltr.

ENCLOSURES:

ACKNOWLEDGED

DO NOT REMOVE

PLANT NAME: Nine Mile Point

FOR ACTION/INFORMATION 12-5-73

BUTLER(L) W/ Copies	SCHWENCER(L) W/ Copies	✓ ZIEMANN(L) W/ 4 Copies	REGAN(E) W/ Copies
CLARK(L) W/ Copies	STOLZ(L) W/ Copies	DICKER(E) W/ Copies	W/ Copies
GOLLER(L) W/ Copies	VASSALLO(L) W/ Copies	KNIGHTON(E) W/ Copies	W/ Copies
KNIEL(L) W/ Copies	SCHEMEL(L) W/ Copies	YOUNGBLOOD(E) W/ Copies	W/ Copies

INTERNAL DISTRIBUTION

✓ <u>REG FILE</u> AEC PDR OGC, ROOM P-506A MUNTZING/STAFF CASE ✓ GIAMBUSSO BOYD MOORE (L)(BWR) DEYOUNG(L)(PWR) ✓ SKOVHOLT (L) P. COLLINS	✓ <u>TECH REVIEW</u> HENDRIE SCHROEDER MACCARY KNIGHT PAWLICKI SHAO STELLO HOUSTON NOVAK ROSS IPPOLITO TEDESCO LONG LAINAS BENAROYA VOLLMER	DENTON GRIMES GAMMILL KASTNER BALLARD SPANGLER <u>ENVIRO</u> MULLER DICKER KNIGHTON YOUNGBLOOD REGAN PROJECT LDR HARLESS	<u>LIC ASST</u> ✓ DIGGS (L) GEARIN (L) GOULBOURNE (L) LEE (L) MAIGRET (L) SERVICE (L) SHEPPARD (E) SMITH (L) TEETS (L) WADE (E) WILLIAMS (E) WILSON (L)	<u>A/T IND</u> BRAITMAN SALTZMAN B. HURT <u>PLANS</u> ✓ MCDONALD DUBE <u>INFO</u> C. MILES
--	---	---	---	--

EXTERNAL DISTRIBUTION

✓ 1 - LOCAL PDR Oswego, N.Y.	(1) (2X10) NATIONAL LAB'S	1-PDR-SAN/LA/NY
1 - DTIE (ABERNATHY)	1-ASLBP (E/W Bldg, Rm 529)	1-GERALD LELLOUCHE
1 - NSIC (BUCHANAN)	1-W. PENNINGTON, Rm E-201 GT	BROOKHAVEN NAT. LAB
1 - ASLB (YORE/SAYRE/ WOODARD/"H" ST.)	1-CONSULTANT'S NEWMARK/BLUME/AGBABIAN	1-AGMED (Ruth Gussman) RM-B-127, GT.
16 - CYS ACRS HOLDING	1-GERALD MULLER... ORNL	1-RD..MULLER..F-309 GT

... ..

...

... ..

...

...


...

...

NIAGARA MOHAWK POWER CORPORATION

NIAGARA  MOHAWK300 ERIE BOULEVARD WEST
SYRACUSE, N. Y. 13202


November 30, 1973

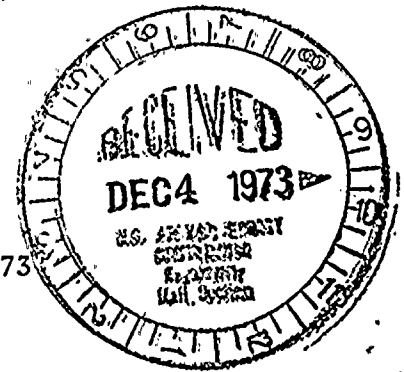

Mr. A. Giambusso
Deputy Director for Reactor Projects
Directorate of Licensing
U. S. Atomic Energy Commission
Washington, D. C. 20545

Dear Mr. Giambusso:

Re: Nine Mile Point Unit 1
Docket No. 50-220

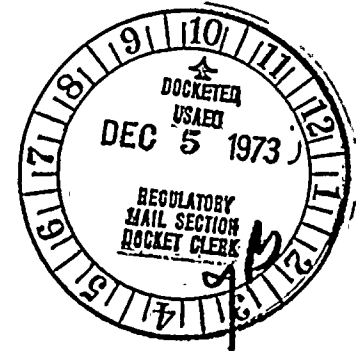


Our application for conversion of Provisional Operating License No. DPR-17 to a full-term operating license included an analysis of the capability of Nine Mile Point Unit 1 to accommodate anticipated transients without scram. Since the time of that submittal, certain changes have taken place which affect the analysis of these transients and other anticipated transients.

The attachment to your letter of October 19, 1973 included assumptions and criteria to be used in the analysis of transients without scram. The analysis which was included in our previous submittal showed that for the worst case during anticipated transients without scram, containment pressure could reach 45 psig. This exceeds the design pressure of the suppression chamber. The attachment to your letter of October 19, 1973 specified containment design pressure as the acceptable limit.

The previous analyses of other transients which include scram were performed assuming no tripping of the recirculation pumps. Preliminary investigations indicate that incorporation of a tripping of the pumps on high reactor pressure aggravates these transients.

...See Page 2


8642

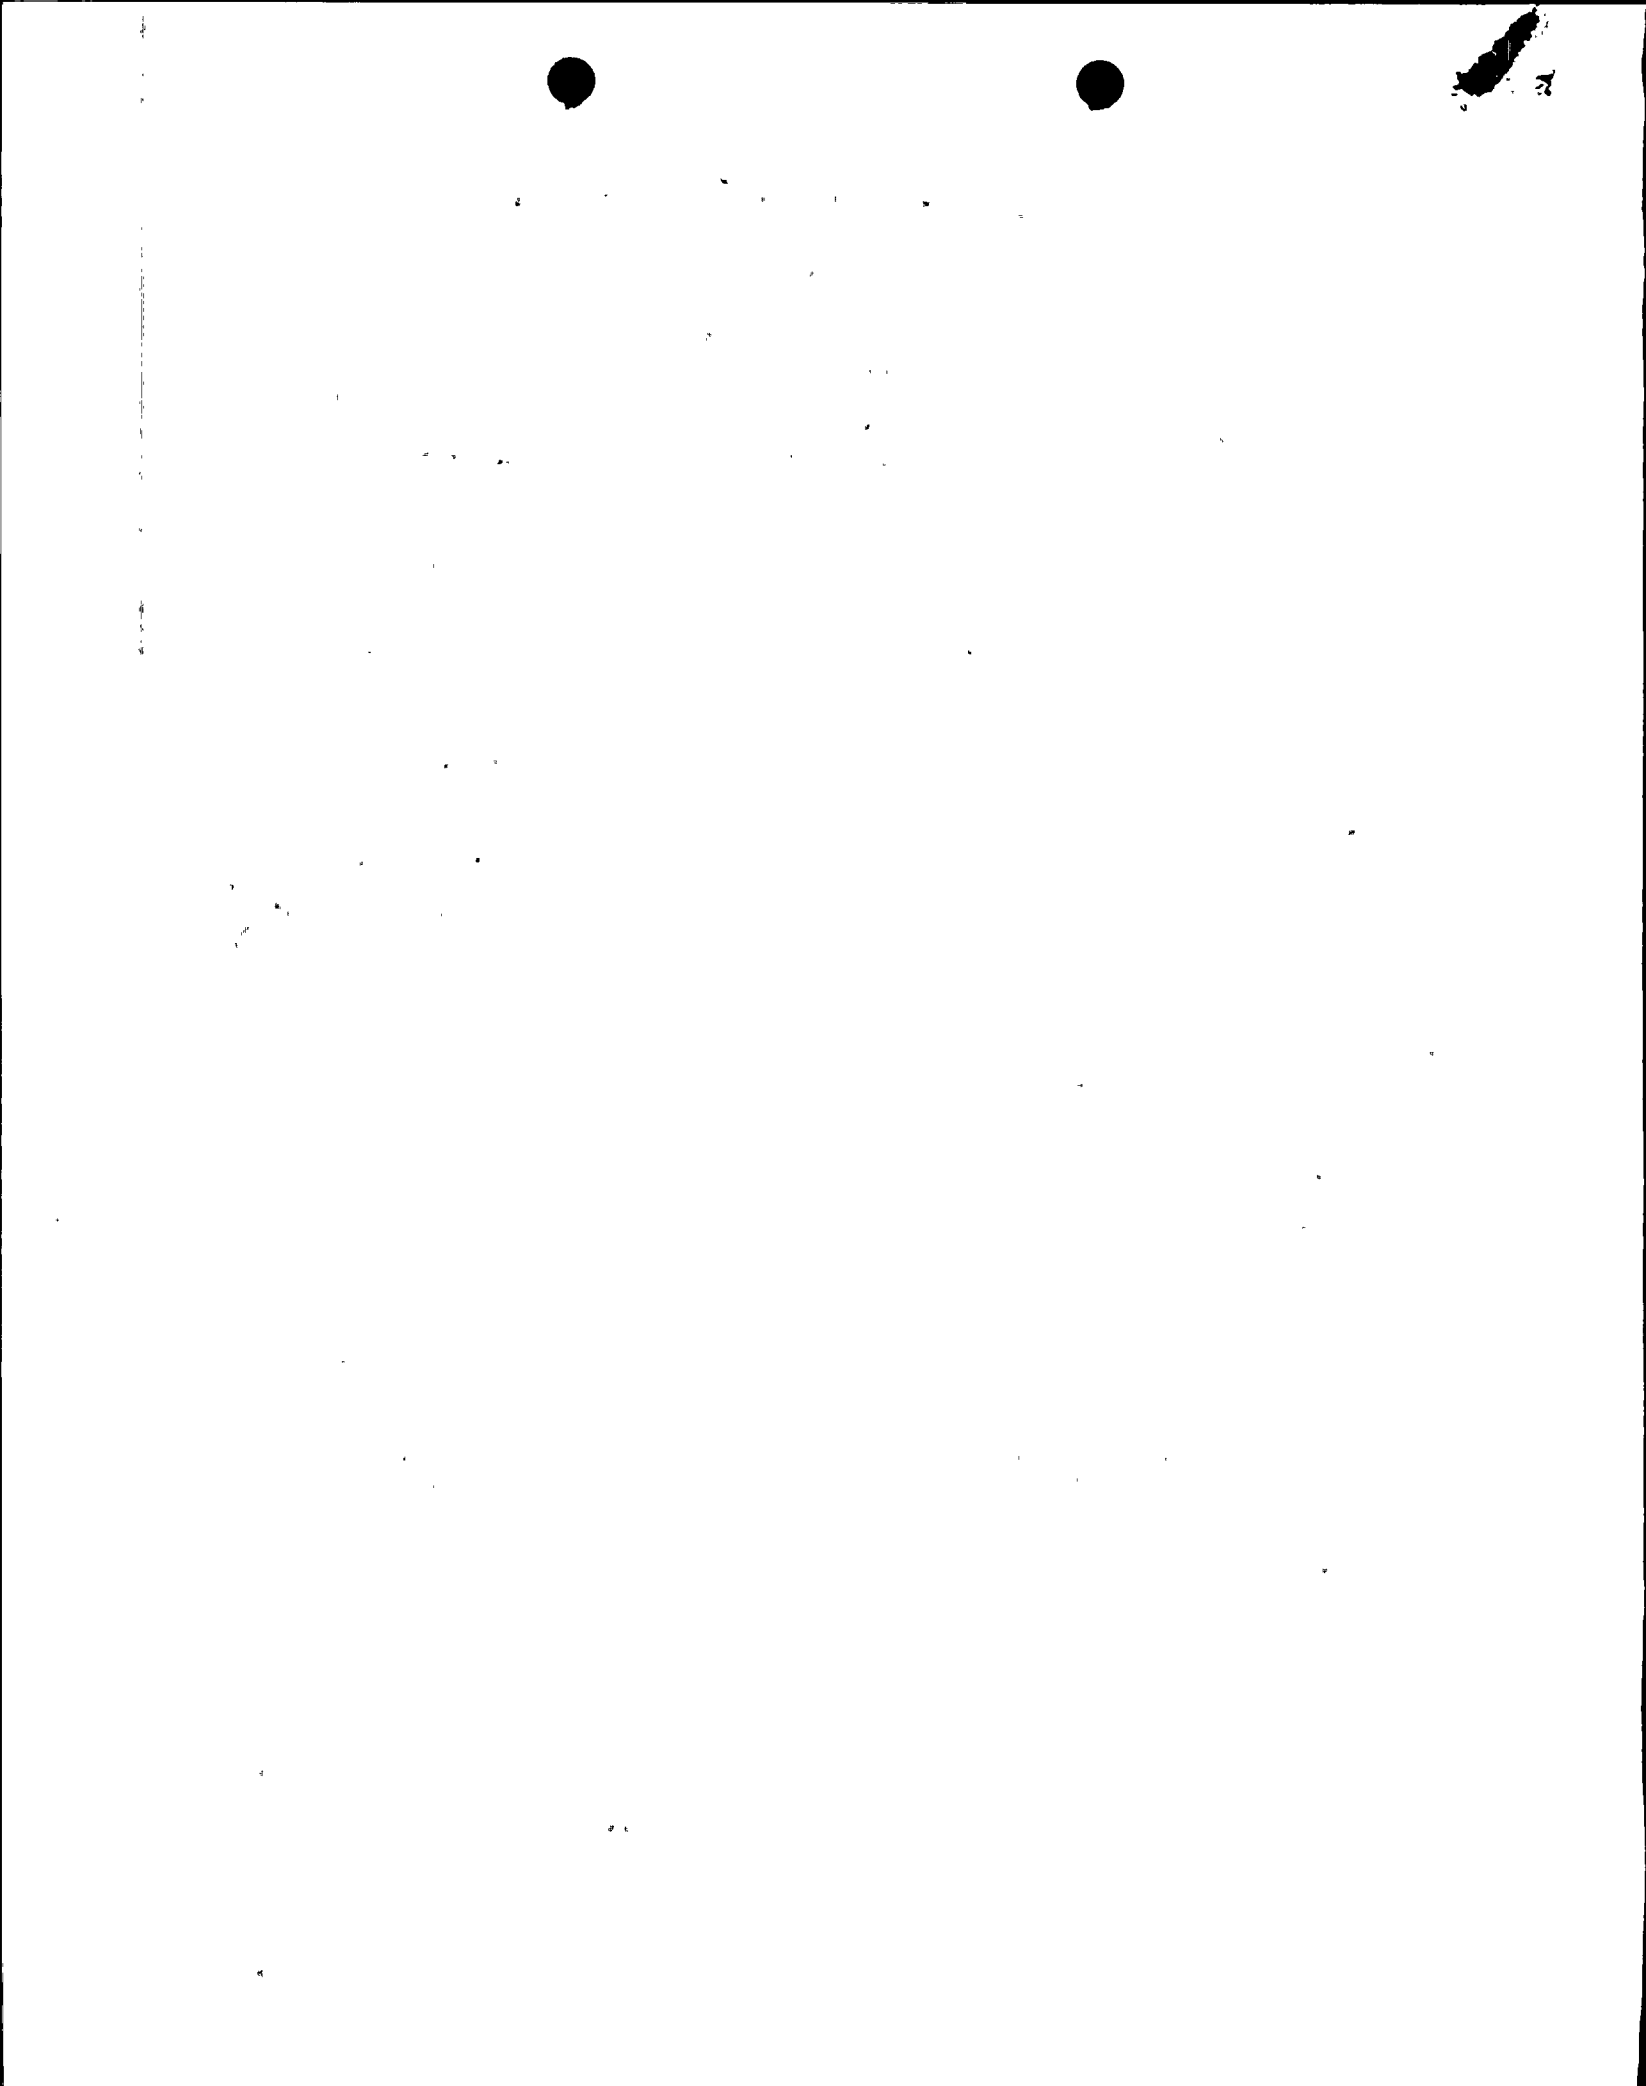

November 30, 1973

Because of the changes to the analyses as described above, Niagara Mohawk considers that the addition of the recirculation pump trip is not justified until reanalyses of anticipated transients without scram and other transients are completed. Therefore, the trip of the recirculation pumps on high reactor pressure is being deleted from the protection system circuitry. The reanalyses of the anticipated transients without scram have been initiated and will be submitted by October 1, 1974 as requested in the attachment to your letter.

Very truly yours,

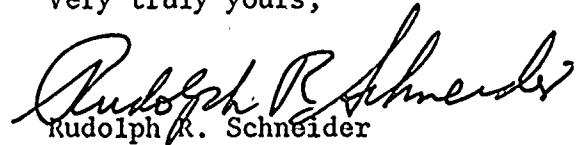

Rudolph R. Schneider

Vice President - Electric Operations

CVM/sz

