

NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL.

FILE NUMBER
ENVIRO.

TO:

Mr. James P. O'Reilly

FROM:
Niagara Mohawk Power Corporation
Syracuse, New York
R. R. Schneider

DATE OF DOCUMENT
12/2/76

DATE RECEIVED
12/10/76

LETTER
 ORIGINAL
 COPY

NOTORIZED
 UNCLASSIFIED

PROP

INPUT FORM

NUMBER OF COPIES RECEIVED
One signed copy

DESCRIPTION

Ltr. w/attached....re their 2/25/75 ltr. ...furnishing corrections to previously submitted Semi-Annual Effluent and Waste Disposal Report for the second half of 1975.

(6-P)

PLANT NAME:
Nine Mile Point Unit #1

ENCLOSURE

ACKNOWLEDGED

DO NOT REMOVE

SAFETY		FOR ACTION/INFORMATION		ENVIRO	12/10/76	RJL
ASSIGNED AD:				ASSIGNED AD:		
<input checked="" type="checkbox"/> BRANCH CHIEF:	Lear	<input checked="" type="checkbox"/>		BRANCH CHIEF:	Regan	
PROJECT MANAGER:				PROJECT MANAGER:		
<input checked="" type="checkbox"/> LIC. ASST. :	Parrish (m)	<input checked="" type="checkbox"/>		LIC. ASST. :	Duncan	(7)

INTERNAL DISTRIBUTION			
<input checked="" type="checkbox"/> REG FILE	SYSTEMS SAFETY	PLANT SYSTEMS	SITE SAFETY &
<input checked="" type="checkbox"/> NRC PDR	HEINEMAN	TEDESCO	ENVIRO ANALYSIS
<input checked="" type="checkbox"/> I & E (2)	SCHROEDER	BENAROYA	DENTON & MULLER
OELD		LAINAS	
GOSSICK & STAFF	ENGINEERING	IPPOLITO	ENVIRO TECH.
MIPC	MACARRY	KIRKWOOD	ERNST
CASE	KNIGHT		<input checked="" type="checkbox"/> BALLARD
HANAUER	SIHWEIL	OPERATING REACTORS	SPANGLER
HARLESS	PAWLICKI	STELLO	
			SITE TECH.
PROJECT MANAGEMENT	REACTOR SAFETY	OPERATING TECH.	GAMMILL
BOYD	ROSS	EISENHUT	STEPP
P. COLLINS	NOVAK	SHAO	HULMAN
HOUSTON	ROSZTOCZY	BAER	
PETERSON	CHECK	BUTLER	SITE ANALYSIS
MELTZ		<input checked="" type="checkbox"/> GRIMES	VOLLMER
HELTMES	AT & I	<input checked="" type="checkbox"/> J. KASNER	BUNCH
SKOVHOLT	SALTZMAN		<input checked="" type="checkbox"/> J. COLLINS
	RUTBERG		<input checked="" type="checkbox"/> KREGER


EXTERNAL DISTRIBUTION			CONTROL NUMBER
<input checked="" type="checkbox"/> LPDR: Oswego, N. Y.	NAT. LAB:	BROOKHAVEN NAT. LAB.	912471 50-220 Env. 1
<input checked="" type="checkbox"/> TIC:	REG V. IE	ULRIKSON (ORNI.)	
<input checked="" type="checkbox"/> NSIC:	LA PDR		
ASLB:	CONSULTANTS:		
ACRS CYS HOLDING/SENT			

1944

INCOME

NIAGARA MOHAWK POWER CORPORATION

NIAGARA MOHAWK
300 ERIE BOULEVARD WEST
SYRACUSE, N. Y. 13202

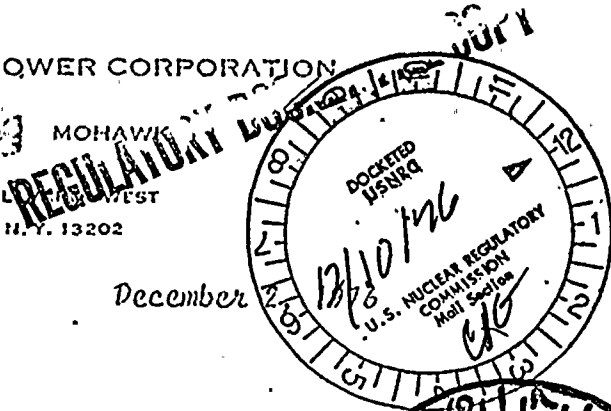

December



Mr. James P. O'Reilly
Director
United States Nuclear Regulatory Commission
Region I
631 Park Avenue
King of Prussia, Pennsylvania 19406

RE: Nine Mile Point Nuclear Station #1
Facility Operating License DPR-63
Docket No. 50-220

Dear Mr. O'Reilly:

This letter is to correct our previously submitted Semi-Annual Effluent and Waste Disposal Report for the Nine Mile Point Nuclear Station Unit #1 for the second half of 1975. The report was originally submitted on February 25, 1975.

Very truly yours,

ORIGINAL SIGNED BY R.R. SCHNEIDER

R.R. Schneider
Vice President -
Electric Production

ENC. 2 copies

mm

cc: Director, Office of T&E (40 copies)
Director, Office of Management Information (2 copies)

1954
1955
1956
1957
1958
1959
1960
1961
1962
1963
1964
1965
1966
1967
1968
1969
1970
1971
1972
1973
1974
1975
1976
1977
1978
1979
1980
1981
1982
1983
1984
1985
1986
1987
1988
1989
1990
1991
1992
1993
1994
1995
1996
1997
1998
1999
2000
2001
2002
2003
2004
2005
2006
2007
2008
2009
2010
2011
2012
2013
2014
2015
2016
2017
2018
2019
2020
2021
2022
2023
2024
2025

1954

EFFLUENT AND WASTE DISPOSAL SEMI-ANNUAL REPORT(1975)Supplemental InformationFACILITY: Nine Mile Point Unit #1LICENSEE: DPR-631. Regulatory Limits

- a. Fission and activation gases: $Q = 0.57/\bar{E}$ Ci/sec
 b. Iodines:
 c. Particulates, half-lives 8 days: } = $1.5 E+04 \times MPC$; Ci/sec
 d. Liquid effluents: Gross Beta Activity = $1E - 07$ uCi/ml or controlled
 in accordance with Appendix B, Table II, Column 2, of 10 CFR 20
 and Note 1 thereto.

2. Maximum Permissible Concentrations

Provide the MPC's used in determining allowable release rates or concentration.

- a. Fission and activation gases: $Q(\text{July-Sept}) = 0.71$ Ci/sec
 $Q(\text{Oct-Dec}) = 0.56$ Ci/sec
 b. Iodines:
 c. Particulates, half-lives 8 days: } 1.5 uCi/sec
 d. Liquid Effluents: Ave MPC (July-Sept) = $6.3 E-06$ uCi/ml
 Ave MPC (Oct-Dec) = $8.1 E-06$ uCi/ml

3. Average Energy


$$\bar{E} \text{ (July-Sept)} = 0.80 \text{ Mev} \quad \bar{E} \text{ (Oct-Dec)} = 1.01 \text{ Mev}$$

\bar{E} is the average energy of the radionuclide mixture in releases of fission and activation gases.

4. Measurements and Approximations of Total Radioactivity

Provide the methods used to measure or approximate the total radioactivity in effluents and the methods used to determine radionuclide composition.

- a. Fission and activation gases: Stack monitor calibrated to isotopic analysis (NaI) of Off Gas samples at SJAE
 b. Iodines: Weekly analysis (NaI) of stack sampler charcoal cartridge
 c. Particulates: Isotopic analysis (GeLi, by contractor) of stack sampler filters
 d. Liquid effluents: Isotopic analysis (NaI or GeLi) of representative batches



EFFLUENT AND WASTE DISPOSAL SEMI-ANNUAL REPORT (1975)

Cont'd.

5. Batch Releases

Provide the following information relating to batch releases of radioactive materials in liquid and gaseous effluents.

a. Liquid

1. Number of batch releases: 381
2. Total time period for batch releases: 444 hours 30 min.
3. Maximum time period for a batch release: 15 hours 41 min.
4. Average time period for batch release: 1 hour 10 min.
5. Minimum time period for a batch release: 0 hours 25 min.
6. Average stream flow during period of release of effluent into a flowing stream: Not Applicable

b. Gaseous

Not applicable

6. Abnormal Releases

a. Liquid

None

b. Gaseous

None



.

.

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT(1975)

GASEOUS EFFLUENTS-SUMMATION OF ALL RELEASES

	Unit	Quarter 3 75	Quarter 4 75	Est. Total Error, %
A. Fission & activation gases				
1. Total release	Ci	6.01 E+05	3.63 E+04	2.0 E+01
2. Average release rate for period	μCi/sec	7.50 E+04	4.50 E+03	
3. Percent of Technical Specification Limit	%	1.05 E+01	8.03 E-01	
B. Iodines				
1. Total iodine-131	Ci	1.45 E+00	5.15 E-01	1.4 E+01
2. Average release rate for period	μCi/sec	1.82 E-01	6.48 E-02	
3. Percent of technical specification	%	1.22 E+01	4.33 E+00	
C. Particulates				
1. Particulates with half-lives > 8 days	Ci	2.91 E-01	1.21 E-01	1.5 E+01
2. Average release rate for period	μCi/sec	3.66 E-02	1.52 E-02	
3. Percent of technical specification limit	%	2.44 E+00	9.40 E-01	
4. Gross alpha radioactivity	Ci	3.72 E-05	8.98 E-05	
D. Tritium				
1. Total release	Ci	8.02 E+00	1.54 E+00	1.6 E+01
2. Average release rate for period	μCi/sec	1.01 E+00	1.93 E-01	
3. Percent of technical specification limit	%		* E	* E

* None specified




10

TABLE 1B

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT(1975)

GASEOUS EFFLUENTS-ELEVATED RELEASE

Nuclides Released	Unit	CONTINUOUS MODE		BATCH MODE	
		Quarter	Quarter	Quarter	Quarter
		3 75	4 75		
1. Fission gases					
krypton-85m	Ci	3.41 E+04	1.20 E+03	E	E
krypton-87	Ci	7.84 E+04	4.54 E+03	E	E
krypton-88	Ci	1.15 E+05	5.01 E+03	E	E
xenon-133	Ci	5.88 E+04	8.35 E+02	E	E
xenon-135	Ci	1.79 E+05	5.70 E+03	E	E
xenon-138	Ci	8.05 E+04	1.57 E+04	E	E
Others(specifiy)	Ci	E	E	E	E
	Ci	E	E	E	E
	Ci	E	E	E	E
unidentified	Ci	5.53 E+04	3.30 E+03	E	E
Total for period	Ci	6.01 E+05	3.63 E+04	E	E
2. Iodines					
iodine-131	Ci	1.45 E+00	5.15 E-01	E	E
iodine-133	Ci	2.18 E+00	2.36 E-01	E	E
iodine-135	Ci	3.96 E-01	4.28 E-02	E	E
Total for period	Ci	4.03 E+00	7.94 E-01	E	E
3. Particulates					
strontium-89	Ci	3.64 E-02	5.3 E-04	E	E
strontium-90	Ci	2.03 E-04	<1.3 E-04	E	E
cesium-134	Ci	8.46 E-04	9.92 E-04	E	E
cesium-137	Ci	4.37 E-05	1.73 E-05	E	E
barium-lanthanum-140	Ci	7.24 E-05	1.42 E-05	E	E
Others(specify)	Ci	E	E	E	E
	Ci	E	E	E	E
manganese-54	Ci	1.43 E-05	3.31 E-05	E	E
cobalt-60	Ci	3.99 E-05	1.23 E-02	E	E
cobalt-58	Ci	2.20 E-04	6.76 E-04	E	E
zirconium-Niobium	95Ci	2.83 E-04	1.21 E-05	E	E
iodine-131	Ci	2.66 E-05	---	E	E
ruthenium-103	Ci	1.34 E-05	2.68 E-05		
ruthenium-106	Ci	4.45 E-04	2.45 E-05	E	E
cerium-144	Ci	2.54 E-04	5.25 E-05		
cerium-141	Ci	1.50 E-05	3.45 E-05	E	E
iron-59	Ci	1.21 E-04	---	E	E
zinc-65	Ci	4.67 E-05	1.98 E-04	E	E



EFFLUENT AND WASTE DISPOSAL SEMI-ANNUAL REPORT

SOLID WASTE AND IRRADIATED FUEL SHIPMENTS

A. Solid Waste Shipped Off site for Burial or Disposal (Not Irradiated Fuel)

1. TYPE OF WASTE	UNIT		EST. TOTAL ERROR, %
a. Spent Resin	m ³	1.39 E+01	1.5 E+01
	Ci	2.35 E+02	
Evaporator Bottoms	m ³	1.40 E+02	1.8 E+01
	Ci	3.44 E+02	
Resin or Filter Sludges	m ³	1.23 E+01	2.1 E+01
	Ci	8.43 E+02	
Liquid Waste	m ³	NONE	
	Ci		
b. Dry Compressible Waste or Contaminated Equip.	m ³	9.59 E+01	2.7 E+01
	Ci	3.48 E+00	
c. Irradiated Components	m ³		
	Ci	NONE	

2. ESTIMATE OF MAJOR NUCLIDE COMPOSITION (BY TYPE OF WASTE)

a. Evaporator Bottoms

Cobalt-60	4.90%
Cesium-137	47.70%
Manganese-54	1.57%
Cesium-134	40.20%
Iodine-131	1.50%
Cobalt-58	0.41%
Lanthanum-140	0.24%
Strontium-89	0.37%
Strontium-90	0.08%
Iron-59	0.25%
Sodium-24	1.90%
Tungsten-187	0.22%
Cerium-141	0.05%
Chromium-51	0.29%
Zirconium-95	0.16%
Niobium-95	0.20%
Antimony-124	0.11%
Filter Sludge not determined	

b. Dry Compressible Waste
varies

c. Irradiated Components
none



Small, faint, illegible markings or characters in the top right corner.