

**NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL  
(TEMPORARY FORM)**

CONTROL NO: 9536

FILE: \_\_\_\_\_

FROM: LeBoeuf, Lamb, Leiby & MacRae Wash. D.C. 20036		DATE OF DOC 9-8-75	DATE REC'D 9-8-75	LTR XX	TWX	RPT	OTHER
TO: Mr. B. C. Rusche		ORIG 3 signed	CC 37	OTHER	SENT NRC PDR SENT LOCAL PDR		XX XX
CLASS	UNCLASS XXX	PROP INFO	INPUT	NO CYS REC'D 40	DOCKET NO: 50-220		

DESCRIPTION: Ltr submitted on behalf of Niagara Mohawk Power Corp. trans the following:

**ACKNOWLEDGED**

**Do Not Remove**

ENCLOSURES: Application for Amdt to OL/DPR-63 Tech Specs notarized 9-5-75 suppl. the 8-15-75 submittal for Reload-5 at Nine Mile Pt. Unit 1 Plant.....with Attachment B furn Suppl info.....(3 Orig & 37 CC rec'd)

CERTIFICATE OF SERVICE dated 9-8-75 showing svc of Appl for Amdt to OL upon Mr. Robert P. Jones Supvr. Town of Scriba, Oswego, N.Y. et. al....(1 Orig cy encl rec'd)

PLANT NAME: Nine Mile Pt. Unit 1 Plant

(SEE ATTACHMT)

**FOR ACTION/INFORMATION** DHL 9-10-75

BUTLER (L) W/ Copies	SCHWENCER (L) W/ Copies	ZIEMANN (L) W/ Copies	REGAN (E) W/ Copies	REID (L) W/ COPIES
CLARK (L) W/ Copies	STOLZ (L) W/ Copies	DICKER (E) W/ Copies	LEAR (L) W/ Copies	
PARR (L) W/ Copies	VASSALLO (L) W/ Copies	KNIGHTON (E) W/ Copies	SPIES W/ Copies	
KNIEL (L) W/ Copies	PURPLE (L) W/ Copies	YOUNGBLOOD (E) W/ Copies	LPM W/ Copies	

**INTERNAL DISTRIBUTION**

<b>REG FILE</b> NRC PDR OGC, ROOM P-506A GOSSICK/STAFF CASE GIAMBUSSO BOYD MOORE (L) DEYOUNG (L) SKOVHOLT (L) GOLLER (L) (Ltr) P. COLLINS DENISE REG OPR FILE & REGION (2) MIPC	<b>TECH REVIEW</b> SCHROEDER MACCARY KNIGHT PAWLICKI SHAO STELLO HOUSTON NOVAK ROSS IPPOLITO TEDESCO J. COLLINS LAINAS BENAROYA VOLLMER	DENTON GRIMES GAMMILL KASTNER BALLARD SPANGLER  <b>ENVIRO</b> MULLER DICKER KNIGHTON YOUNGBLOOD REGAN <b>PROJECT LDR</b> <b>BEVAN</b> HARLESS	<b>LIC ASST</b> R. DIGGS (L) H. GEARIN (L) E. GOULBOURNE (L) P. KREUTZER (E) J. LEE (L) M. RUSHBROOK (L) S. REED (E) M. SERVICE (L) S. SHEPPARD (L) M. SLATER (E) H. SMITH (L) G. TEETS (L) G. WILLIAMS (E) V. WILSON (L) R. INGRAM (L) M. DUNCAN (E)	<b>A/T IND.</b> BRAITMAN SALTZMAN MELTZ  <b>PLANS</b> MCDONALD CHAPMAN <del>DUDE (L)</del> <b>E. Hughes</b> E. COUPE PETERSON HARTFIELD (2) KLECKER EISENHUT WIGGINTON
--	--	--	---	--

**EXTERNAL DISTRIBUTION**

4 - LOCAL PDR <u>Oswego, N.Y.</u>	1 - NATIONAL LABS _____	1 - PDR-SAN/LA/NY
4 - TIC (ABERNATHY) (1)(2)(10)	1 - W. PENNINGTON, Rm E-201 GT	1 - BROOKHAVEN NAT LAB
4 - NSIC (BUCHANAN)	1 - CONSULTANTS	1 - G. ULRIKSON ORNL
1 - ASLB	NEWMARK/BLUME/AGBABIAN	
4 - Newton Anderson		
76 - ACRS HOLDING/SENT		

AFA  
N

SECRET

SECRET

CONFIDENTIAL

(Class: CONFIDENTIAL).....

CONFIDENTIAL

(Class: CONFIDENTIAL).....

SECRET

SECRET

SECRET

LAW OFFICES OF  
LEBOEUF, LAMB, LEIBY & MACRAE  
1757 N STREET, N.W.  
WASHINGTON, D. C. 20036

September 8, 1975


ARVIN E. UPTON  
LEONARD M. TROSTEN  
WILLIAM O. DOUB  
EUGENE B. THOMAS, JR.  
HARRY H. VOIGT  
L. MANNING MUNTZING  
LEX K. LARSON  
HENRY V. NICKEL  
WASHINGTON PARTNERS

140 BROADWAY  
NEW YORK, N.Y. 10005

WASHINGTON TELEPHONE  
202-872-8668

CABLE ADDRESS  
LALALU, WASHINGTON D.C.  
TELEX: 440274

Mr. Ben C. Rusche  
Director  
Office of Nuclear Reactor  
Regulation  
U.S. Nuclear Regulatory  
Commission  
Washington, D.C. 20555

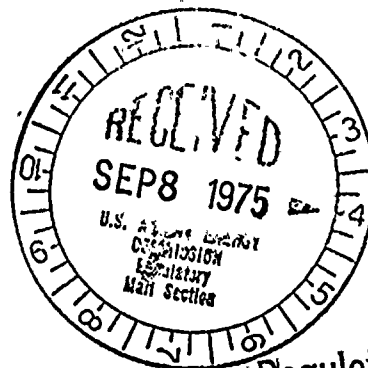

Regulatory Docket File

Re: Niagara Mohawk Power Corporation  
Nine Mile Point Nuclear Station Unit No. 1  
Docket No. 50-220


Dear Mr. Rusche:

Transmitted herewith are three (3) signed originals and nineteen (19) copies of a document entitled "Application for Amendment to Operating License." This Application corrects certain errors in a submittal made August 18, 1975, in connection with Reload Cycle 5. Transmitted with this application are the requisite corrected copies of the General Electric report submitted with the August filing.

A Certificate of Service showing service of these documents upon the persons listed therein is also enclosed.

Very truly yours,

*LeBoeuf, Lamb, Leiby & MacRae*  
LeBoeuf, Lamb, Leiby & MacRae  
Attorneys for Niagara Mohawk  
Power Corporation

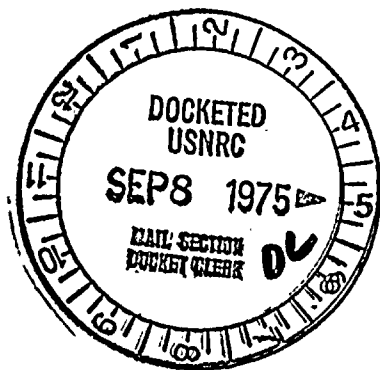

9536



BEFORE THE UNITED STATES  
NUCLEAR REGULATORY COMMISSION

Regulatory Docket File

9-8-75

In the Matter of )  
 )  
NIAGARA MOHAWK POWER CORPORATION ) Docket No. 50-220  
(Nine Mile Point Nuclear Station )  
Unit No. 1) )

CERTIFICATE OF SERVICE

I hereby certify that I have served a document entitled "Application for Amendment to Operating License" by mailing a copy thereof first class, postage prepaid, to the following persons this 8th day of September, 1975.

Mr. Robert P. Jones  
Supervisor  
Town of Scriba  
R. D. #4  
Oswego, New York 13126

Miss Juanita Kersey  
Librarian  
Oswego City Library  
120 E. Second Street  
Oswego, New York 13126

Dr. William E. Seymour  
Staff Coordinator  
New York State Atomic  
Energy Council  
New York State Department  
of Commerce  
99 Washington Avenue  
Albany, New York 12210

Hope M. Babcock  
Hope M. Babcock

LeBoeuf, Lamb, Leiby & MacRae  
Attorneys for Applicant



20

+

UNITED STATES OF AMERICA  
NUCLEAR REGULATORY COMMISSION

Regulatory Docket File

9-8-75

In the Matter of )  
 )  
NIAGARA MOHAWK POWER CORPORATION ) Docket No. 50-220  
(Nine Mile Point Nuclear Station )  
Unit No. 1) )

APPLICATION FOR AMENDMENT

TO

OPERATING LICENSE

Pursuant to Section 50.90 of the regulations of the Nuclear Regulatory Commission, Niagara Mohawk Power Corporation, holder of Facility Operating License No. DPR-63, hereby requests that Section 3.1.7.c of the Technical Specifications set forth in Appendix A to that License be amended. This proposed change supplements the August 15, 1975 submittal for Reload-5 at Nine Mile Point Unit 1. The Site Operations Review Committee and Safety Review and Audit Board have approved the proposed change.



.. . .




The proposed technical specification change is set forth on page 7-1/7-2 of Attachment A to this application, entitled, "General Electric Boiling Water Reactor Reload-5 Licensing Submittal for Nine Mile Point Nuclear Power Station, Unit 1." The attachment includes a safety evaluation which demonstrates that the proposed change does not involve a significant hazards consideration. The proposed change would not authorize any change in the types or any increase in the amounts of effluents or any change in the authorized power level of the facility. The Licensee also transmits, as Attachment B, supplemental information to Attachment A.

WHEREFORE, Applicant respectfully requests that Appendix A to Facility Operating License No. DPR-63 be amended in the form attached hereto as Attachment A.

Respectfully submitted,

NIAGARA MOHAWK POWER CORPORATION

By



GERALD K. RHODE


Vice President - Engineering

Subscribed and sworn to before  
me on this 5<sup>th</sup> day of September,  
1975.

Patricia A. Connor (Patricia C. Nott)

Notary Public

PATRICIA A. CONNOR  
Notary Public in the State of New York  
Qualified in Onondaga Co. No. 4608264  
My Commission Expires March 30, 1977



## Supplemental Information

Received w/Ltr Dated 9-8-75Background

On August 15, 1975, Niagara Mohawk Power Corporation submitted an application for amendment to Operating License, entitled, "General Electric Boiling Water Reactor Reload-5 Licensing Submittal for Nine Mile Point Nuclear Power Station, Unit 1." That document proposed changes to revise fuel operating limits for the next cycle, based on an analysis of limiting transients for Reload-5.

Subsequent to that submittal, General Electric Company informed Niagara Mohawk of a mistake in the Control Rod Withdrawal Error Transient analysis calculation. Attachment A includes the revised calculation and supplements the similar document transmitted August 15, 1975. The new MCPR limits proposed are higher than in the previous submittal, and therefore more conservative.

Listing of Changes

The following is a listing for your convenience, of the changes made to the August 15, 1975 version of Attachment A to produce the corrected Attachment A.

<u>ITEM NO.</u>	<u>LOCATION</u>	<u>CHANGE TO</u>
1.	Page 4-1, paragraph 4.2.1, second line	"... MCPR is 1.38 for 8X8 fuel and 1.36 for 7X7 fuel."



Handwritten scribbles and marks in the top right corner, possibly including a date or initials.

ITEM NO.	LOCATION	CHANGE TO
2.	Page 4-3, Table 4-3 second line under "Maximum $\Delta$ CPR"	"0.30 ... 0.32"
3.	Page 6-10, Table 6-2 item 1, under "Tran- sient MCPR Limit 7X7/ 8X8"	"1.36/1.38"
4.	Page 6-11, paragraph 6.3.3.1.4a, last line	"... reduced to 1.22 for 8X8 fuel and 1.24 for 7X7 fuel. Thus"
5.	Page 6-22, paragraph 6.3.3.2, third line	"... $\Delta$ MCPR for 8X8 fuel of 0.32 and for 7X7 fuel of 0.30. Since"
6.	Page 6-22, paragraph 6.3.3.2, fifth line	"... to be 1.38 for 8X8 fuel and 1.36 for 7X7 fuel. This"
7.	Page 6-23, Figure 6-11	replaced with new Figure 6-11
8.	Page 6-24 and 25, Figures 6-12 and 6-13	"ROD BLOCK FOR 1.38 OP LIMIT (105%)"
9.	Page 7-1/7-2, paragraph 7-2, second and third lines under "Change"	"... values to 1.38 for 8X8 fuel and 1.36 for 7X7 fuel."

221

Enc. 3 General Elec. BWR Reload-5 Lic. Submittal for Nine Mile Pt. Unit 1 Sta.  
NEDO-20772 dated Aug. 1975.

Received w/Ltr Dated 9-8-75

... ..

...

... ..