
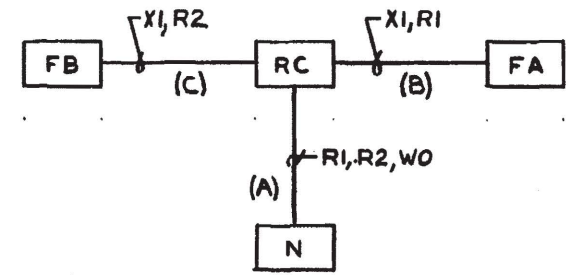


2	ADDED FUSE RATING 1 REVISED AS NOTED	DATE	DR	CHK	SUPV	CHIEF	PROJ	OWNER
1	REVISED CHANNEL & RC NO.	5-12-76	R.W.S	LEW	S.T.C			
0	ISSUED FOR CONSTRUCTION	3/5/75	R.S	LEW	S.T.C			
		6-12-75	S.J.H	M.E./S				

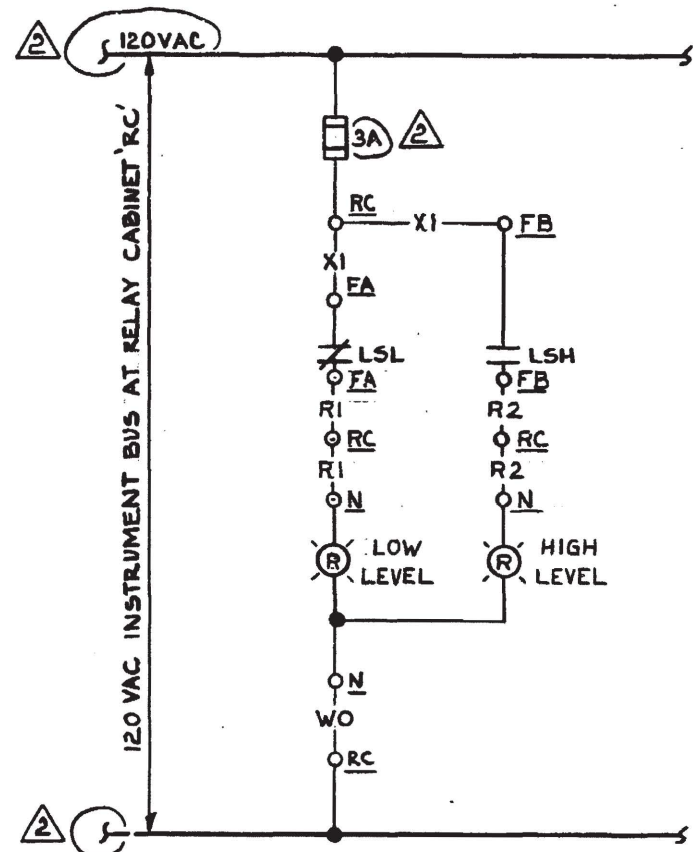

BLOCK DIAGRAM

- NOTES**
- FOR GENERAL NOTES SEE DWG INDEX E-45B
  - FOR DETAILS OF INDICATING LIGHTS SEE DRAWING E-30B, SH-7, TYPE 4 EXCEPT WITH TWO RED LENS, & LEGEND AS SHOWN.

SCHEME	SU No	CHANNEL	EQUIPMENT				DESCRIPTION
			RC	N	FA	FB	
I1183	36	A	RC2404	NIL1183	FLS1183	FLSH1183	MFPT USED LUBE OIL TK. 1-1

**DAVIS-BESSE NUCLEAR POWER STATION**  
 THE TOLEDO EDISON COMPANY  
 THE CLEVELAND ELECTRIC ILLUMINATING COMPANY

ELEMENTARY WIRING DIAGRAMS  
 MFPT CONTROL & AUXILIARIES  
 MFPT USED LUBE OIL TK 1-1

BECHTEL COMPANY	JOB NO.	DRAWING NO.	REV.
	7749	E-45B SH-9	2

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL AND REGULAR COURSE OF BUSINESS, ON THE DATE STATED BELOW AND THAT IT IS AN ACCURATE REPRODUCTION OF THE RECORD(S) SUBMITTED TO NUCLEAR RECORDS MANAGEMENT

DATE 4-9-88 OPERATOR S. Sutton 16X