



Revision 18, April 26, 2000

<p>PSEG Nuclear, LLC SALEM NUCLEAR GENERATING STATION</p>	<p>Salem Nuclear Generating Station ILLUSTRATION OF OVERTEMPERATURE AND OVERPOWER ΔT PROTECTION</p> <p>Updated FSAR Figure 15.1-1</p>
---	---

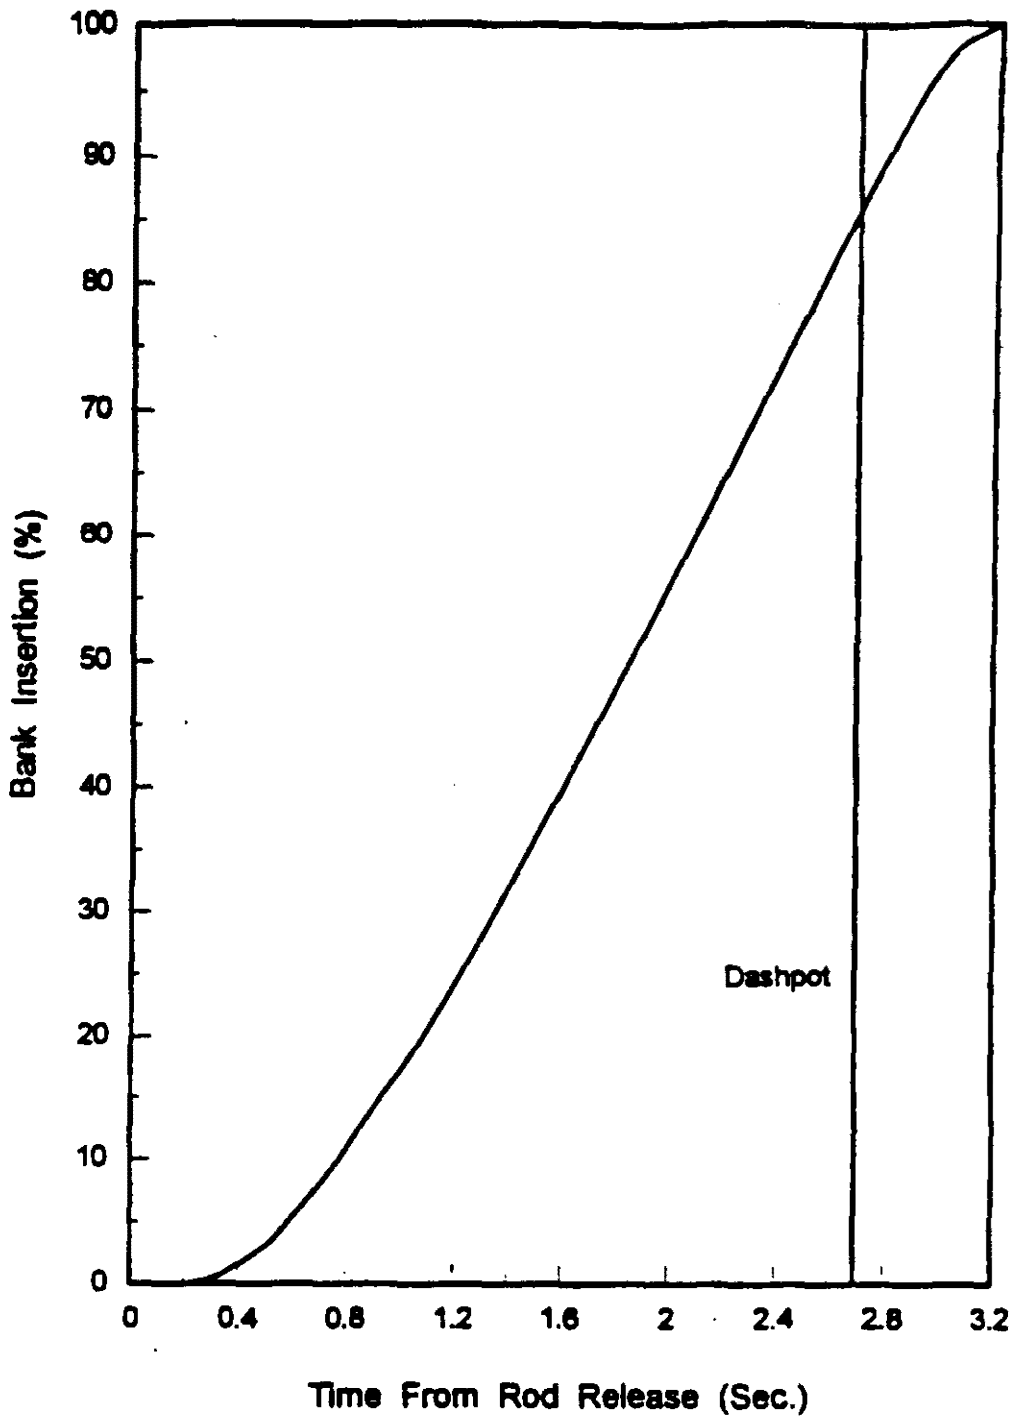


Revision 18, April 26, 2000

PSEG Nuclear, LLC SALEM NUCLEAR GENERATING STATION	Salem Nuclear Generating Station ROD POSITION VERSUS TIME ON REACTOR TRIP
	Updated FSAR Figure 15.1-2

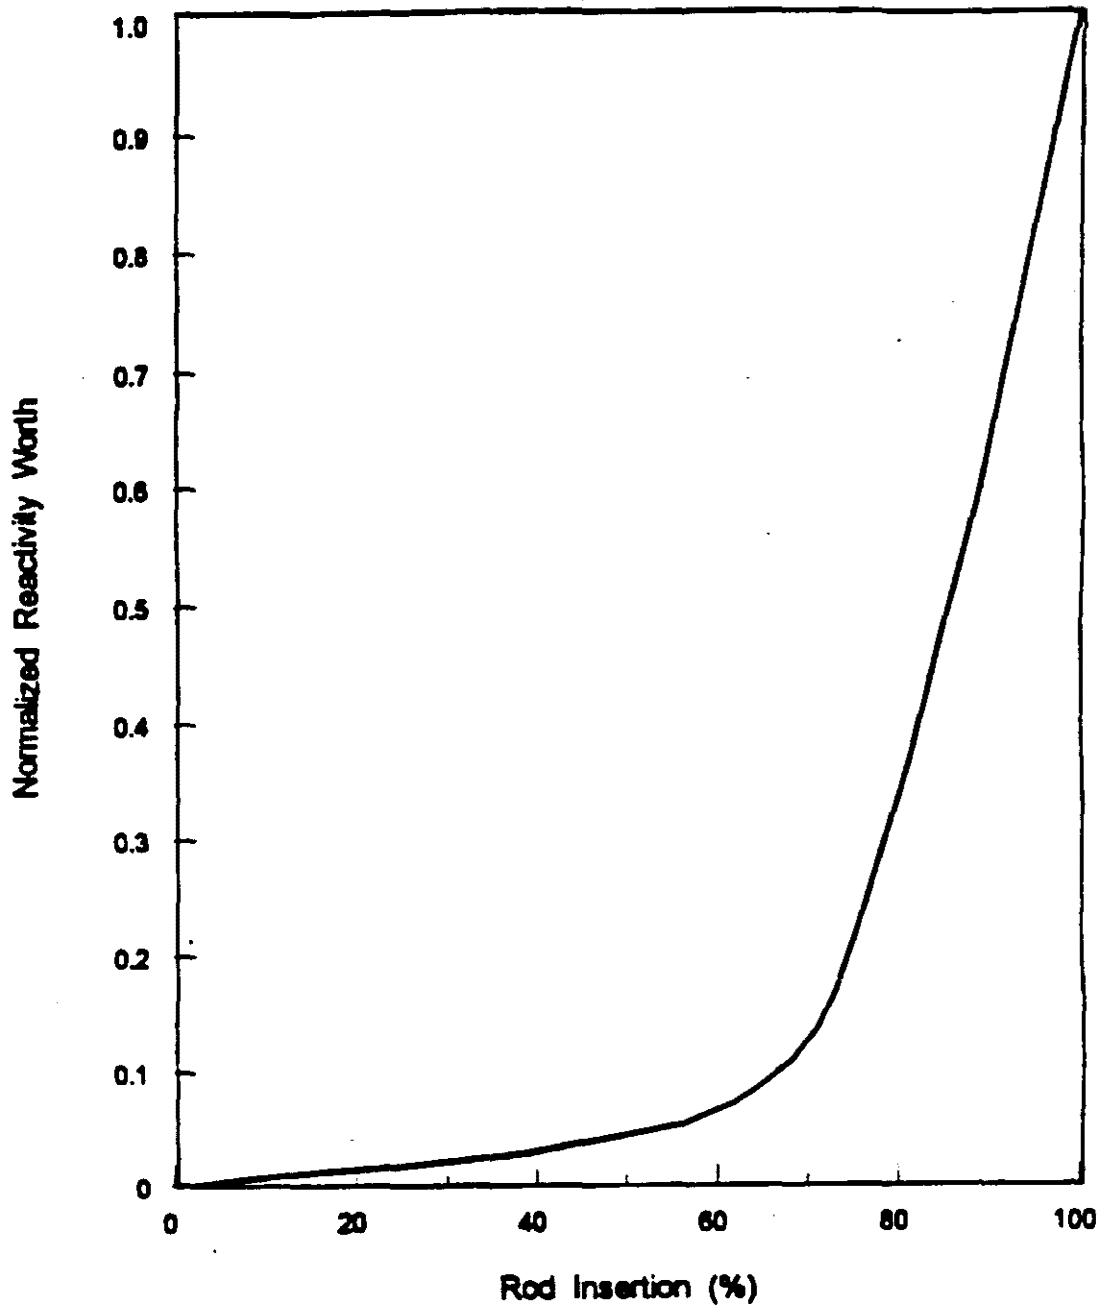

Revision 18, April 26, 2000


PSEG Nuclear, LLC SALEM NUCLEAR GENERATING STATION	Salem Nuclear Generating Station NORMALIZED RCCA REACTIVITY WORTH VERSUS PERCENT INSERTION
	Updated FSAR Figure 15.1-3

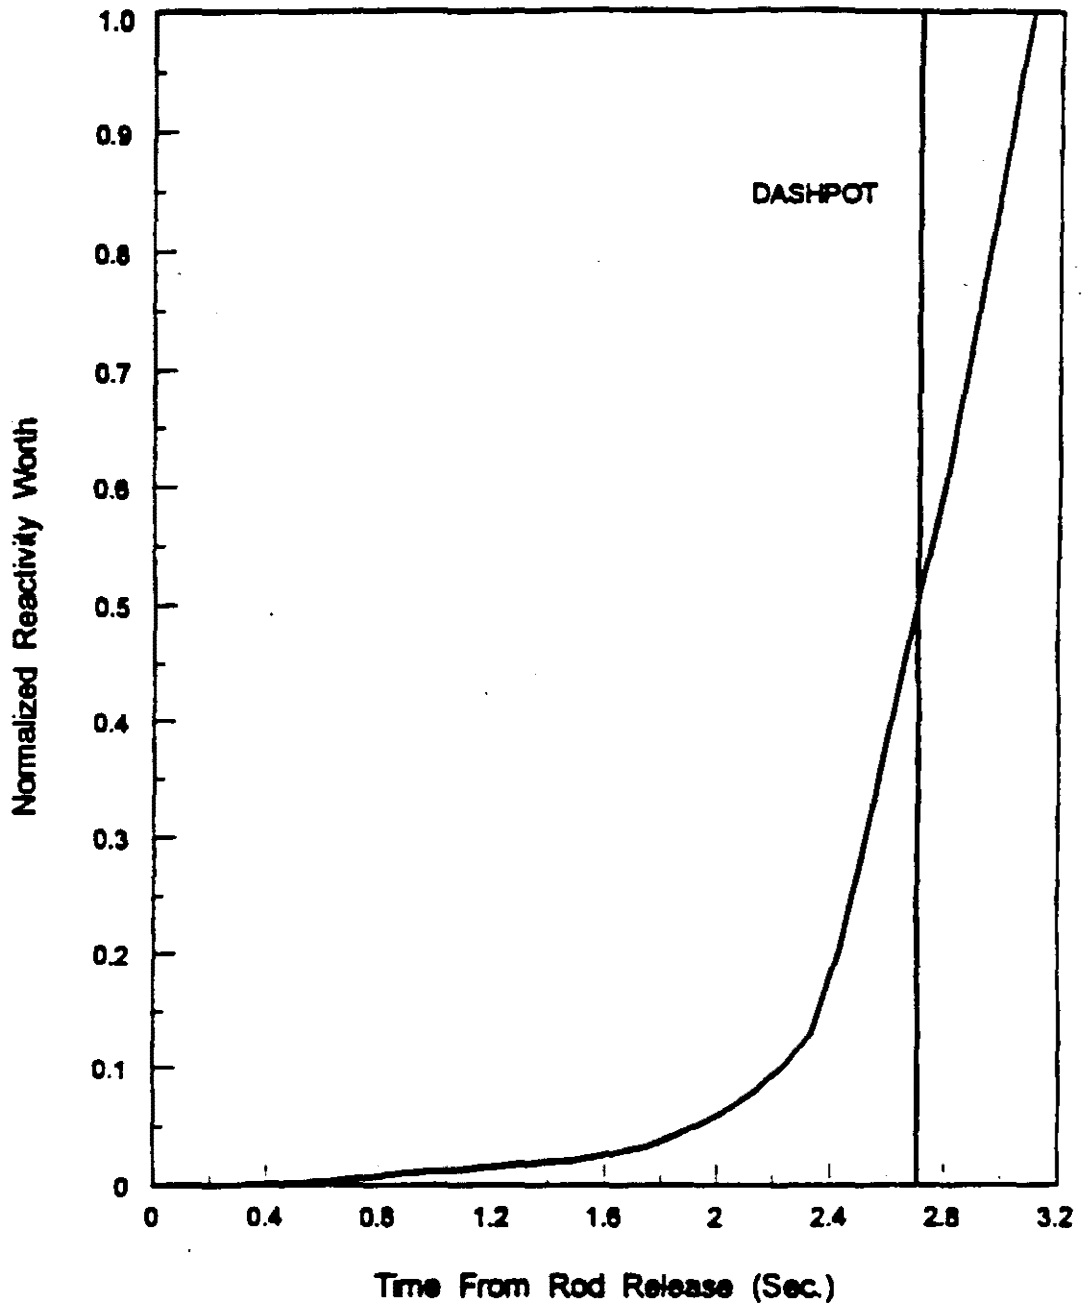

Revision 18, April 26, 2000


PSEG Nuclear, LLC SALEM NUCLEAR GENERATING STATION	Salem Nuclear Generating Station NORMALIZED RCCA REACTIVITY WORTH VERSUS TIME AFTER REACTOR TRIP
	Updated FSAR Figure 15.1-4

SEN-00-004

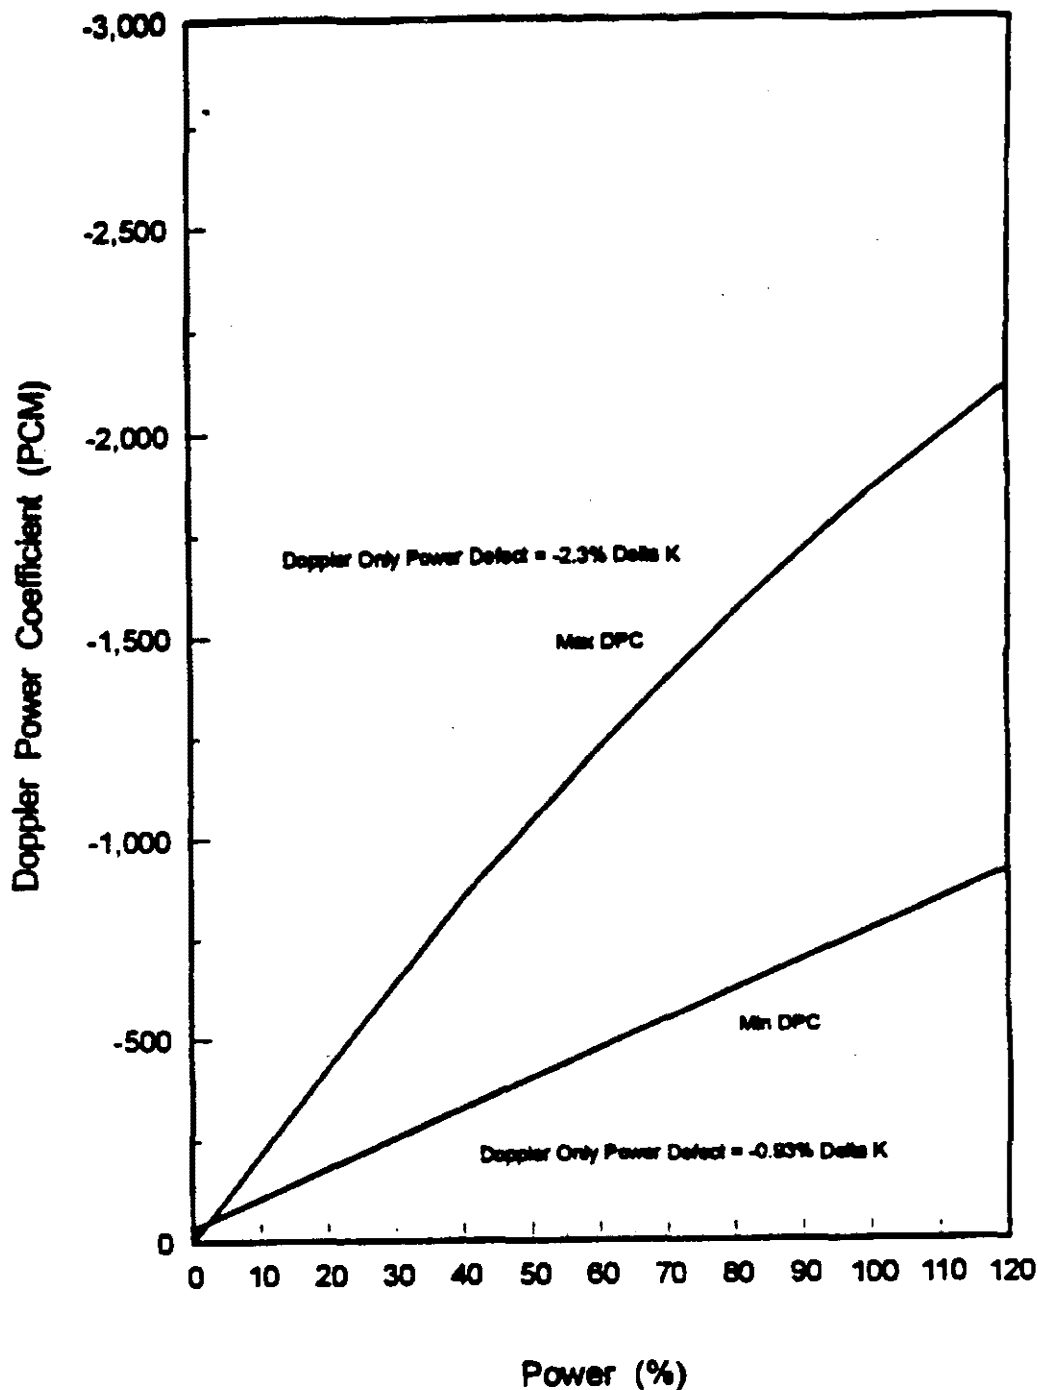


Revision 18, April 26, 2000

PSEG Nuclear, LLC SALEM NUCLEAR GENERATING STATION	Salem Nuclear Generating Station INTEGRATED DOPPLER POWER COEFFICIENT USED IN ACCIDENT ANALYSIS
	Updated FSAR Figure 15.1-5

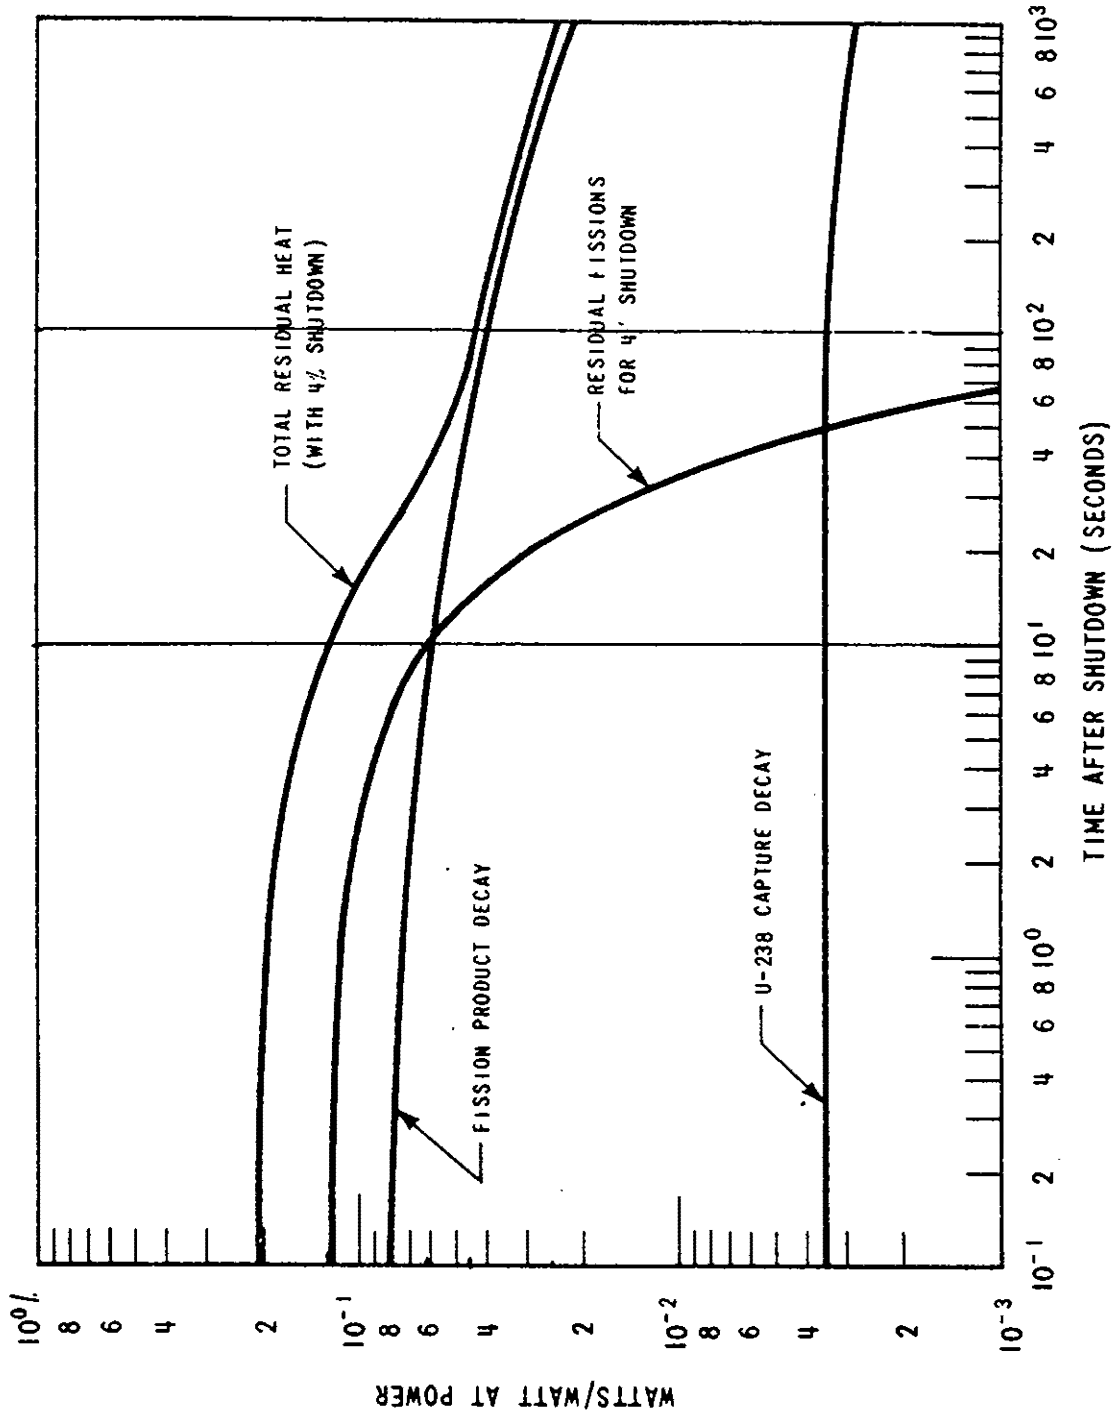

REVISION 6
FEBRUARY 15, 1987

PUBLIC SERVICE ELECTRIC AND GAS COMPANY SALEM NUCLEAR GENERATING STATION	Residual Decay Heat	
	Updated FSAR	Figure 15.1-6

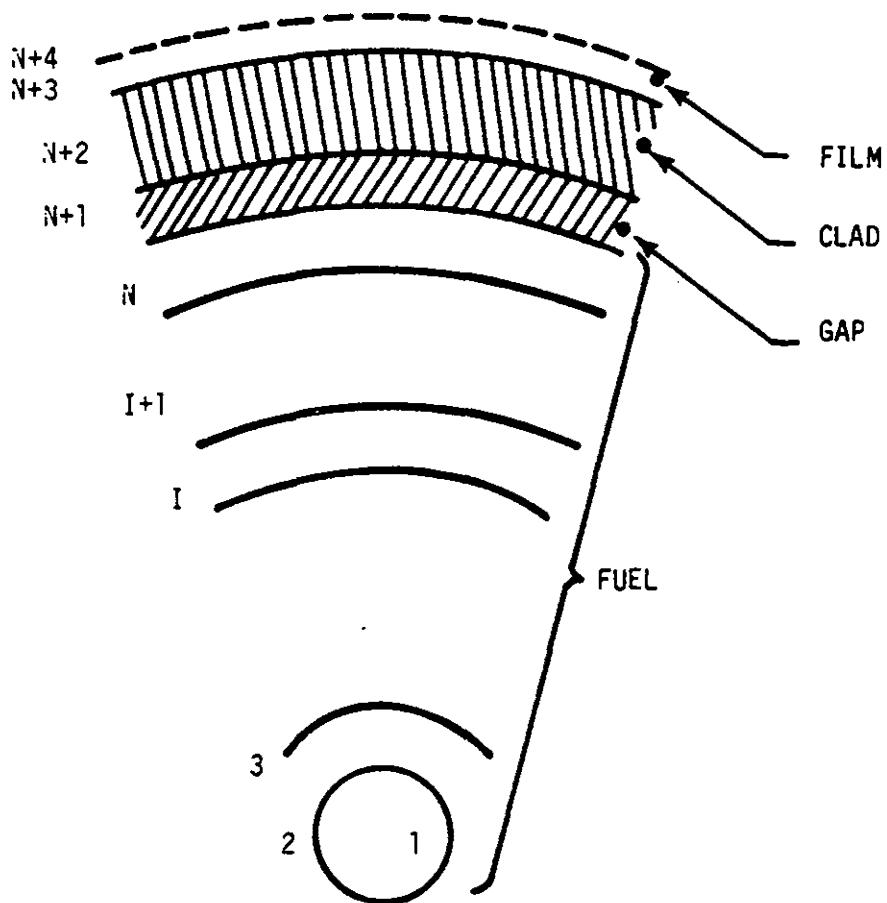

REVISION 6
 FEBRUARY 15, 1987

PUBLIC SERVICE ELECTRIC AND GAS COMPANY SALEM NUCLEAR GENERATING STATION	Fuel Rod Cross Section Updated FSAR Figure 15.1-7
---	---

THIS FIGURE HAS BEEN DELETED

PSEG NUCLEAR L.L.C.
SALEM GENERATING STATION

SALEM UFSAR - REV 18

SHEET 1 OF 1

APRIL 26, 2000

F15.1-8

THIS FIGURE HAS BEEN DELETED

PSEG NUCLEAR L.L.C.
SALEM GENERATING STATION

SALEM UFSAR - REV 18
APRIL 26, 2000

SHEET 1 OF 1
F15.1-9