

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8106090664 DOC. DATE: 81/06/02 NOTARIZED: NO DOCKET #
 FACIL: 50-220 Nine Mile Point Nuclear Station, Unit 1, Niagara Power 05000220
 AUTH. NAME: AUTHOR AFFILIATION
 DISE, D.P. Niagara Mohawk Power Corp.
 RECIP. NAME: RECIPIENT AFFILIATION
 EISENHUT, D.G. Division of Licensing

SUBJECT: Responds to NRC 810406 ltr re NUREG-0737, Item II.K.3.27. Util
 will comply w/NRC position as described in 800805 Tech Spec
 change request on existing reactor water level
 instrumentation.


DISTRIBUTION CODE: A046S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2
 TITLE: Response to NUREG -0737/NUREG-0660 TMI Action Plan Rgmts (OL's)

NOTES:

ACTION:	RECIPIENT ID CODE/NAME:		COPIES		RECIPIENT ID CODE/NAME:	COPIES	
			LTTR	ENCL		LTTR	ENCL
ACTION:	IPPOLITO, J.	05	7	7			
INTERNAL:	A/D C&C SYS	27	1	1	A/D C&S ENG	22	1
	A/D FOR TECH	32	1	1	A/D GEN PROJ	31	1
	A/D LICENS	16	1	1	A/D M&Q ENG	23	1
	A/D OP REACT	15	1	1	A/D PLANT SYS	25	1
	A/D RAD PROT	26	1	1	A/D SAFETY AS	17	1
	DEP. DIR, DHFS	29	1	1	DIR, EM PREP	33	1
	DIRECTOR, DE	21	1	1	DIRECTOR, DHFS	28	1
	DIRECTOR, DL	14	1	1	DIRECTOR, DSI	24	1
	DIRECTOR, DST	30	1	1	EMERG PREP DEV		1
	I&E	12	2	2	OELD		0
	OR ASSESS BR	18	3	3	PDR	02	1
	RAD ASMT BR		1	1	REG FILE	01	1
EXTERNAL:	ACRS	34	16	16	INPO, J. STEARNS		1
	LPDR	03	1	1	NSIC	04	1

JUN 11 1981

26

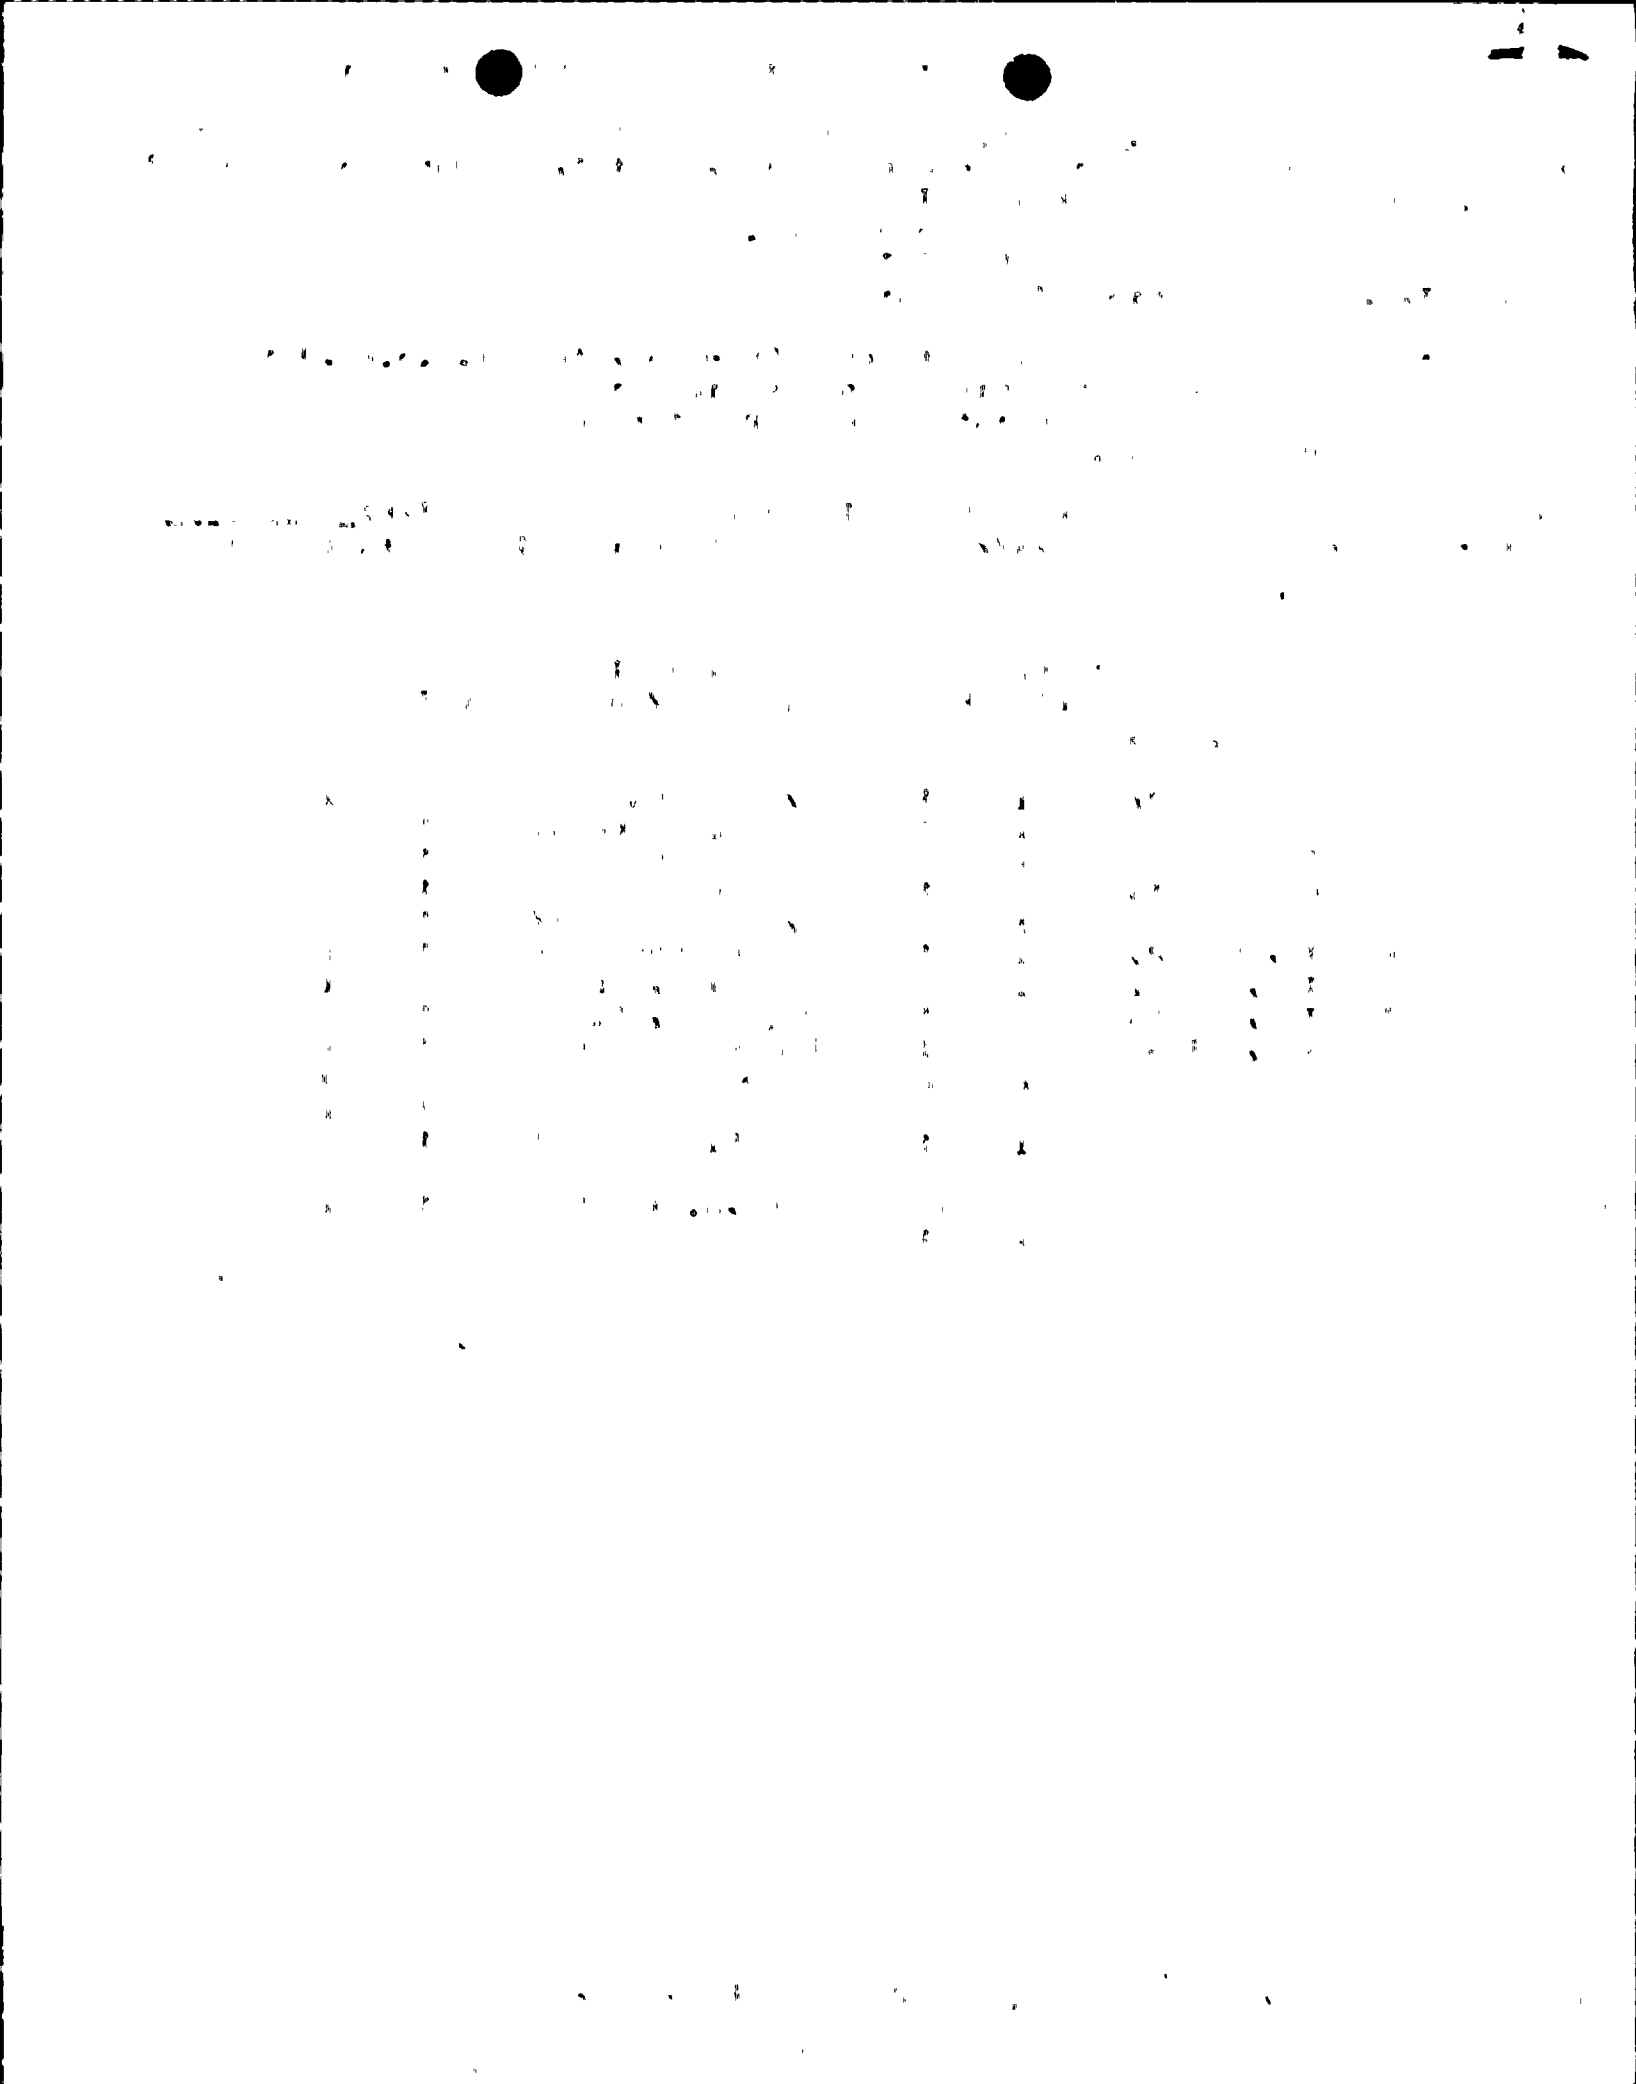

June 2, 1981

Mr. Darrell G. Eisenhut, Director
Division of Licensing
Office of Nuclear Reactor Regulation
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555



Dear Mr. Eisenhut:

Re: Nine Mile Point Unit 1
Docket No. 50-220
DPR-63

Niagara Mohawk has reviewed your letter dated April 6, 1981 to Mr. D.B. Waters, Chairman BWR Owners Group dealing with NUREG-0737 Item, II.K.3.27.

Niagara Mohawk will comply with the Nuclear Regulatory Commission staff's position as described in our Technical Specification change request dated August 5, 1980. This Technical Specification change request references all existing reactor water level instrumentation to a common reference level and will be implemented upon our receipt of approval of our Technical Specification change request.

In addition, a wide range reactor water level instrument is being installed to comply with NUREG 0737 Item II.F.2. This instrument will also be referenced to the same level as the existing reactor water level instrumentation.

As requested in your April 6, 1981 letter the attached information identifies the necessary changes required in documentation, training and operating practices to implement this item.

Very truly yours,

NIAGARA MOHAWK POWER CORPORATION


Donald P. Dise
Donald P. Dise
Vice President Engineering

PEF:bd

A046
s
1/1

P

8106090664



NIAGARA MOHAWK POWER CORPORATION

NINE MILE POINT UNIT 1

DOCKET NO. 50-220

DPR-63

Changes Required in Documentation Training and Operating Practices to
Implement TMI Action Plan Item II.K.3.2.7 - Common Water Level Reference.

1. The following instrument surveillance procedures must be revised:

- a. ISP No. H1-ISP-RPS-XMTR
- b. ISP No. H1-ISP-RPS-TP
- c. ISP No. H1-IMP-FWC-1
- d. ISP No. H1-ST-D0

2. The following special procedure must be revised:

- a. H1-SP-4
- b. H1-SP-16
- c. H1-SP-24
- d. H1-SP-29
- e. H1-SP-30

3. Training

Approximately ten (10) two (2) hour training sessions will be required to train all of the operators on the new water level scales (each operator will attend one session).

10-10-10



10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10

10-10-10