

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIOS)

ACCESSION NBR: 8111240491, DOC. DATE: 81/11/16 NOTARIZED: NO DOCKET #
 FACIL: 50-410 Nine Mile Point Nuclear Station, Unit 2, Niagara Mohawk 05000410
 AUTH: NAME: AUTHOR AFFILIATION
 RHODEL, G. K. Niagara Mohawk Power Corp.
 RECIPIENT NAME: RECIPIENT AFFILIATION
 EISENHUT, D. G. Division of Licensing

SUBJECT: Corrects typographical error in 811027 response to 810229
 Generic Ltr 81-03 on implementation of NUREG-0313, Revision 1,
 re RCPB piping.

DISTRIBUTION CODE: BODIS COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: PSAR/FSAR AMDTS and Related Correspondence.


NOTES:

ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTTR	ENCL	ID CODE/NAME	LTTR	ENCL
ACTION:	A/O LICENSNG	1	0	LIC BR #2 BC	1	0
	LIC BR #2 LA	7	7	LYNCH, D.	01	1
INTERNAL:	ELDI	1	0	IEI	06	3
	IE/DEP/EPDB 35	1	1	IE/DEP/EPLB 36	3	3
	MPAI	1	0	VRR/DE/CEB 11	1	1
	NRR/DE/EQB 13	3	3	VRR/DE/GB 28	2	2
	NRR/DE/HGEB 30	2	2	VRR/DE/MEB 18	1	1
	NRR/DE/MTEB 17	1	1	VRR/DE/QAB 21	1	1
	NRR/DE/SAB 24	1	1	NRR/DE/SEB 25	1	1
	NRR/DHFS/HFEB 40	1	1	VRR/DHFS/LQB 32	1	1
	NRR/DHFS/DLB 34	1	1	VRR/DHFS/PTRB 20	1	1
	NRR/DSI/AEB 26	1	1	NRR/DSI/ASB 27	1	1
	NRR/DSI/CPB 10	1	1	NRR/DSI/CSB 09	1	1
	NRR/DSI/ETSB 12	1	1	VRR/DSI/ICSB 16	1	1
	NRR/DSI/PSB 19	1	1	NRR/DSI/RAB 22	1	1
	NRR/DSI/RSB 23	1	1	NRR/DST/LGB 33	1	1
	<u>REG. FILE</u>	04	1			
EXTERNAL:	ACRS 41	16	16	BNL (AMDTS ONLY)	1	1
	FEMA-REP DIV 39	1	1	LPDR 03	2	2
	NRCI PDRI 02	1	1	VSIC 05	1	1
	NTIS	1	1			

NOV 20 1981

MAX

W

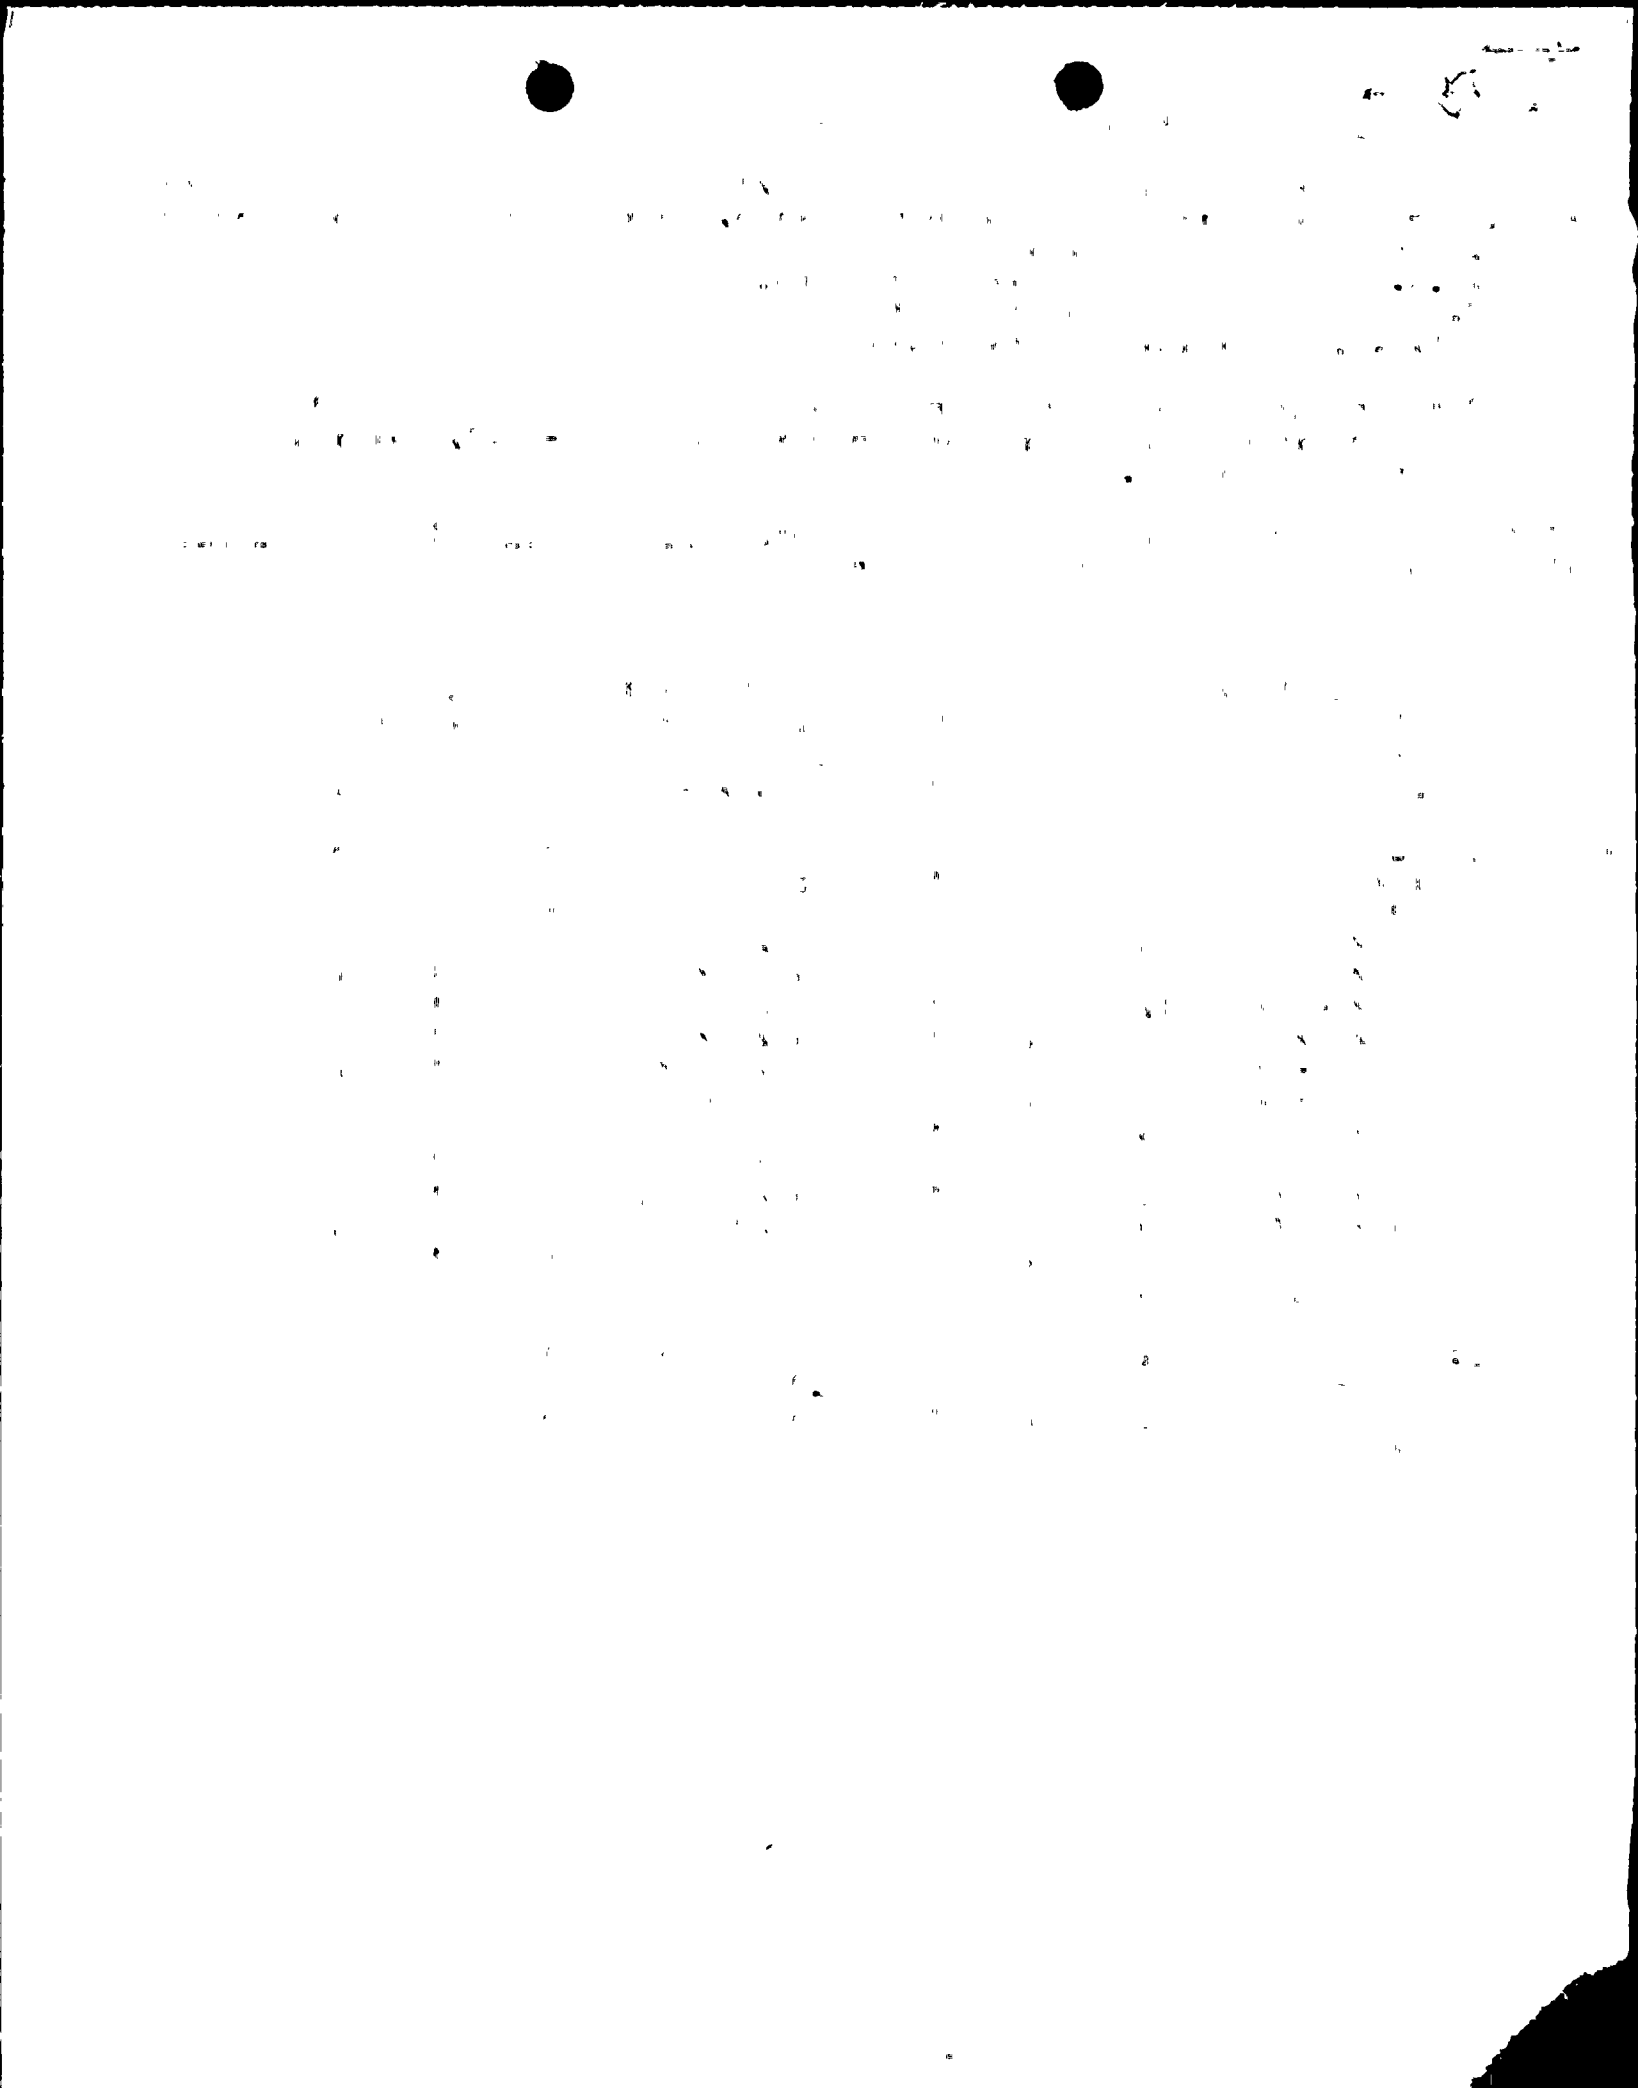

November 16, 1981



Mr. Darrell G. Eisenhut, Director
Division of Licensing
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555


Re: Nine Mile Point Unit 2
Docket No. 50-410

Dear Mr. Eisenhut:

Your generic letter 81-03, dated February 29, 1981, requested information regarding the implementation of NUREG-0313, Revision 1. Our letter, dated October 27, 1981, provided Niagara Mohawk's position with respect to the coolant pressure boundary piping at Nine Mile Point Unit 2. However, section III of our response contained a typographical error. The third sentence of the second paragraph in section III should read "Since this line will be above 200°F whenever the reactor itself is above 200°F, this line will be respecified as TP 316L grade material." instead of "...TP 316 grade material." as contained in our original letter.

Very truly yours,

NIAGARA MOHAWK POWER CORPORATION


G. K. Rhode
Vice President
System Project Management

PM:ja

8111240491 811116
PDR ADDCK 05000410
A PDR

Bool
5/0

15

[Faint, illegible text scattered across the page, possibly bleed-through from the reverse side]