

NINE MILE POINT NUCLEAR STATION / P.O. BOX 32 LYCOMING, NEW YORK 13093 / TELEPHONE (315) 343-2110

December 11, 1981

Eldon J. Brunner, Chief  
Project Branch #1  
Division of Resident and Project Inspection  
United States Nuclear Regulatory Commission  
Region I  
631 Park Avenue  
King of Prussia, PA 19406

RE: Docket No. 50-220  
Inspection Report No. 50-220/81-27

Dear Mr. Brunner


This refers to the routine, safety inspection conducted by Mr. S. Hudson of this office on October 1 - 30, 1981, at Nine Mile Point Unit #1, Scriba, New York, of activities authorized by NRC License No. DPR-63.

ITEM A. Technical Specification 6.8.1 states: "Written procedures and administrative policies shall be established, implemented and maintained..."

Administrative Procedure APN-2A, "Conduct of Operations and Composition and Responsibilities of Station or Unit Organization", Revision 5, Section 4.1.1, dated February 20, 1981, states in part: "Control Room Log Book shall contain all information pertaining to changing core reactivity during all modes of reactor operation... Also, entries affecting Station outputs..., unusual conditions..., etc. will be entered in this log."

Contrary to the above, on October 22, 1981, an entry was not made in the Control Room Log Book concerning the unexplained change in reactor recirculation flow and the accompanying change in reactor power.

8201070277 811230  
PDR ADDCK 05000220  
Q PDR

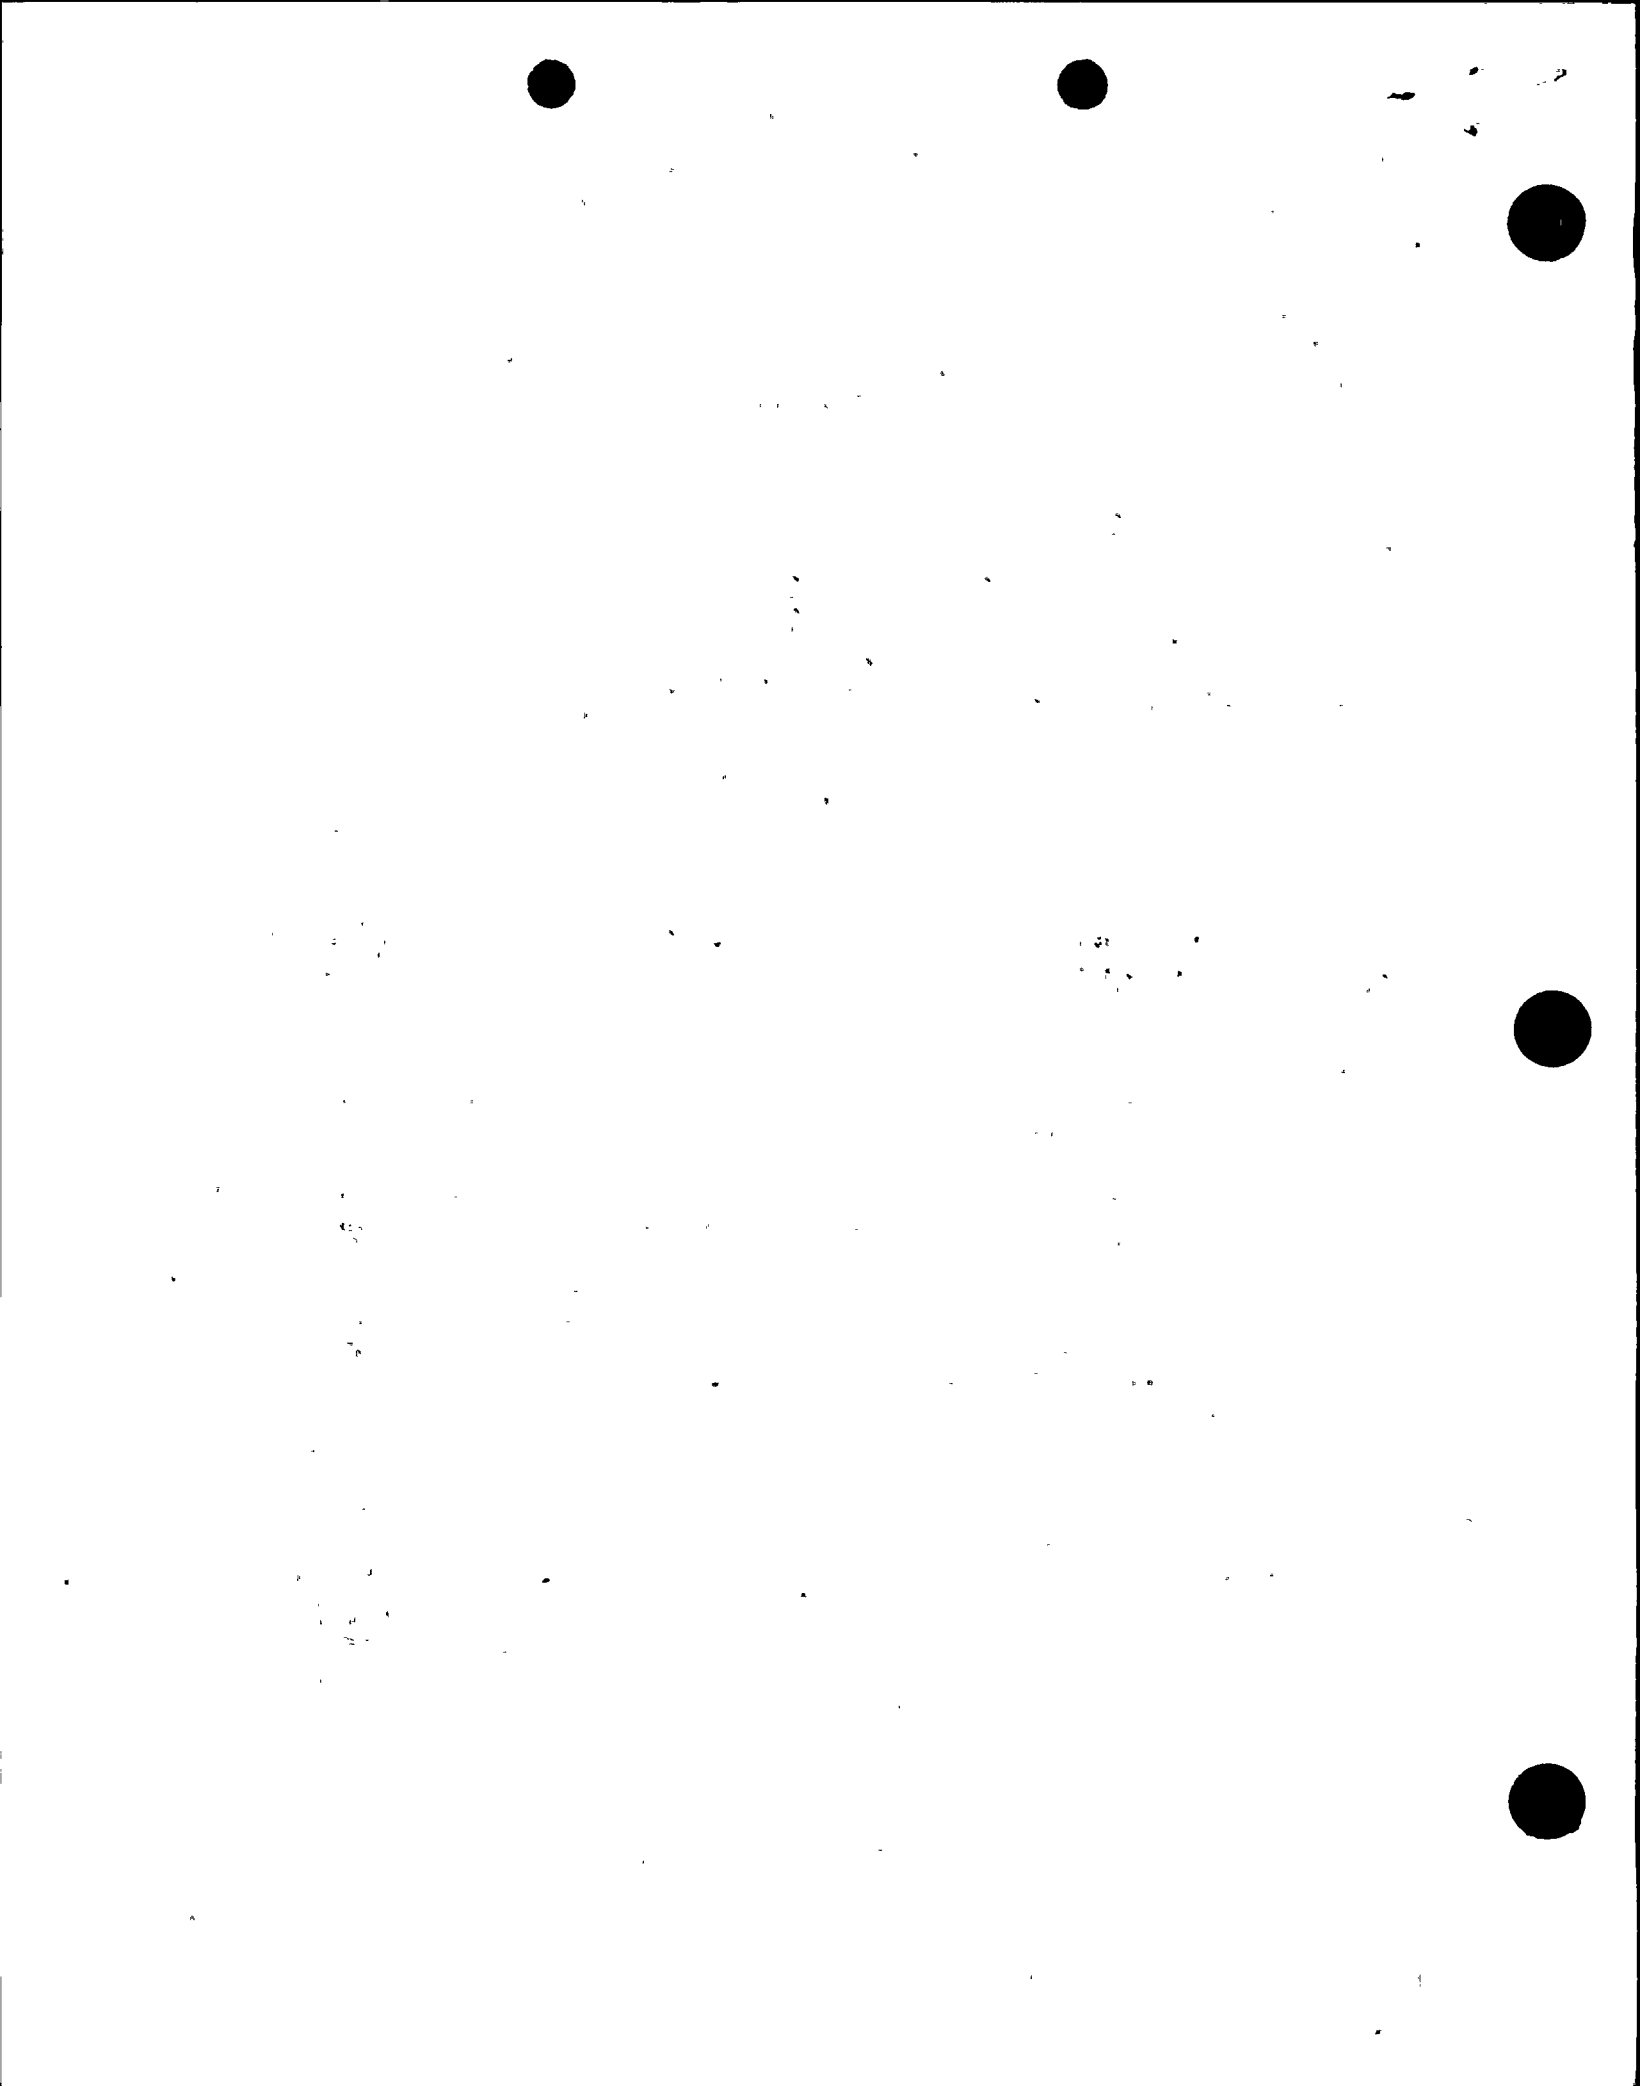

RESPONSE

*This item is strictly the result of an oversight on the part of the Chief Shift Operator, who became involved in the investigation of the event and consequently failed to note it in the log. The importance of properly documenting station operations was reemphasized to Control Room personnel.*

*Very truly yours*

*Thomas E. Lempges*

Thomas E. Lempges  
Vice President  
Nuclear Generation

TEL/jm

01 DEC 15 11 1 48

REGION 1  
NSMCC

U.S. NRC  
REGION I  
81 DEC 17 PM 1 46