



UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D. C. 20555

NIAGARA MOHAWK POWER CORPORATION

DOCKET NO. 50-220


NINE MILE POINT NUCLEAR STATION, UNIT NO. 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 61  
License No. DPR-63

1. The Nuclear Regulatory Commission (the Commission) has found that:
  - A. The application for amendment by Niagara Mohawk Power Corporation (the licensee) dated January 30, 1984, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
  - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
  - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C.(2) of Facility Operating License No. DPR-63 is hereby amended to read as follows:

8405210483 840508  
PDR ADOCK 05000220  
P PDR

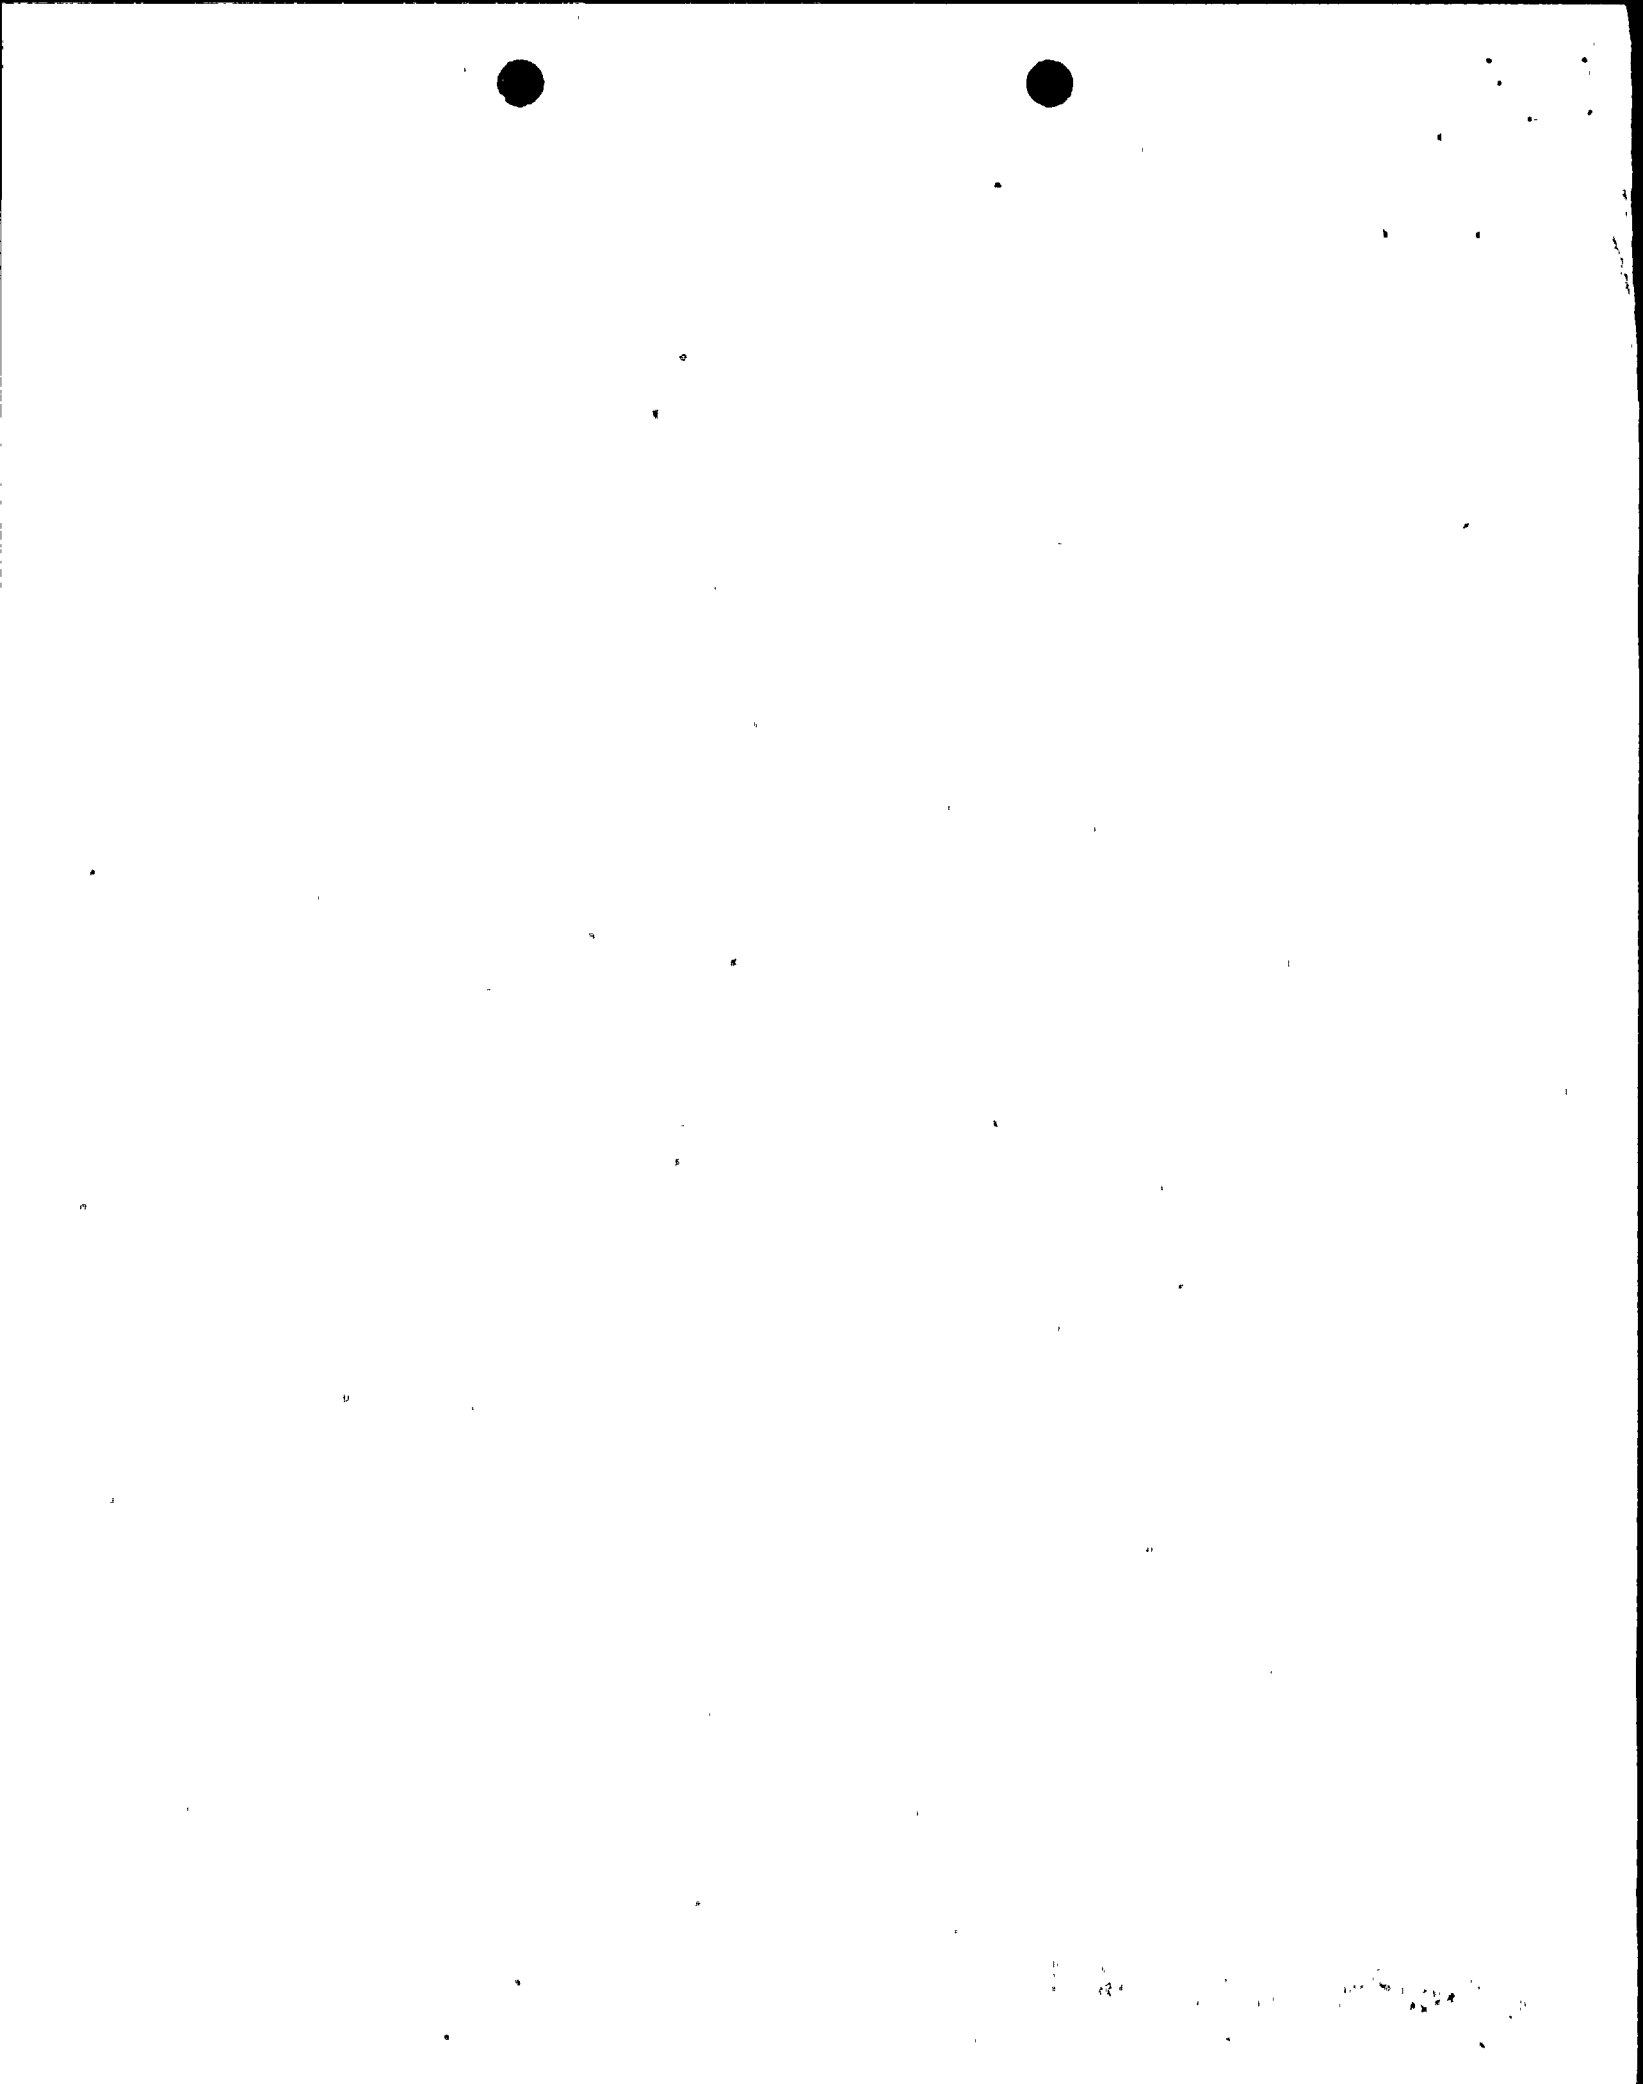

(2) Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No. 61, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.


3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION

Domenic B. Vassallo, Chief  
Operating Reactors Branch #2  
Division of Licensing

Attachment:  
Changes to the Technical  
Specifications

Date of Issuance: May 8, 1984



ATTACHMENT TO LICENSE AMENDMENT NO. 61

FACILITY OPERATING LICENSE NO. DPR-63

DOCKET NO. 50-220

Revise the Appendix A Technical Specifications by removing and inserting the following pages:

<u>Existing Page</u>	<u>Revised Page</u>
194	194
195	195

The revised areas are indicated by marginal lines.




TABLE 4.6.2a

INSTRUMENTATION THAT INITIATES SCRAMSurveillance Requirement

<u>Parameter</u>	<u>Sensor Check</u>	<u>Instrument Channel Test</u>	<u>Instrument Channel Calibration</u>
(1) Manual Scram	None	Once per 3 months	None
(2) High Reactor Pressure	None	Once per month <sup>(1)</sup>	Once per 3 months <sup>(1)</sup>
(3) High Drywell Pressure	None	Once per month <sup>(1)</sup>	Once per 3 months <sup>(1)</sup>
(4) Low Reactor Water Level	Once/day	Once per month <sup>(1)</sup>	Once per 3 months <sup>(1)</sup>
(5) High Water Level Scram Discharge Volume	None	Once per month	Once per 3 months
(6) Main-Steam-Line Isolation Valve Position	None	Once per 3 months	Once per operating cycle
(7) High Radiation Main-Steam Line	Once/shift	Once per week	Once per 3 months






TABLE 4.6.2a (Cont'd)

INSTRUMENTATION THAT INITIATES SCRAMSurveillance Requirement

<u>Parameter</u>	<u>Sensor Check</u>	<u>Instrument Channel Test</u>	<u>Instrument Channel Calibration</u>
(8) Shutdown Position of Reactor Mode Switch	None	Once during each major refueling outage	None
(9) Neutron Flux			
(a) IRM			
(i) Upscale	(f)	(f)	(f)
(ii) Inoperative	(f)	(f)	(f)
(b) APRM			
(i) Upscale	None	Once/week	Once/week
(ii) Inoperative	None	Once/week	Once/week
(iii) Downscale	None	Once/week	Once/week
(10) Turbine Stop Valve Closure	None	Once per 3 months	Once per operating cycle
(11) Generator Load Rejection	None	Once per month	Once per 3 months

