


DETAIL "A"
(NO SCALE)
TYPICAL FOR ALL SWITCHES
UNLESS OTHERWISE SPECIFIED

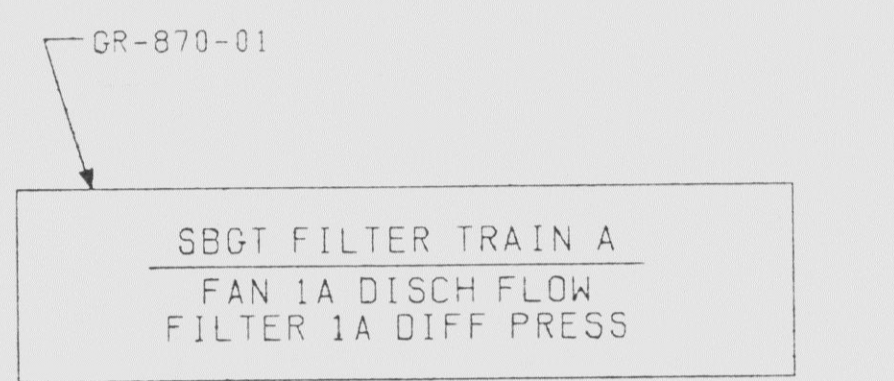

DETAIL "B"
NAMEPLATE TO BE 4.00" X 1.00" GRAVPLCY.
WHITE WITH BLACK CORE PER HERMES CO.
NO. 200-12. 1/8" HIGH CHARACTERS TO
BE ENGRAVED AS SHOWN.

- NOTES:
- UNOCCUPIED PANEL AREA (TYPICAL AS SHOWN) THAT CAN BE USED FOR ADDITION OF COMPONENTS MUST BE KEPT CLEAR OF WIRING. STIFFENERS AND ROUTING OF WIRING DONE WITH MINIMUM OF REWORK.
 - FOR PANEL P870 USE EQUIPMENT LIST ESK-4CEC119.
 - PROVIDE REAR ACCESS DOORS PER G.E. SPEC 22A2877.
 - ITEMS NOT SHOWN IN FRONT VIEW ARRANGEMENT, THAT ARE LISTED IN EQUIPMENT LIST ARE TO BE MOUNTED INSIDE CABINET.
 - TRIP SEPARATORS TO BE ADDED TO FRONT OF PANELS AS SHOWN.
 - DOTTED LINE INDICATES BARRIER THAT IS TO BE PROVIDED IN REAR OF PANEL.
 - CABINET DEPTH 36" REF.
 - ALL DIMENSIONS ARE IN INCHES, UNLESS OTHERWISE SPECIFIED.
 - SCALE: NONE
 - SEE ESK-10AN500 FOR ADDITIONAL NOTES.
 - NOT APPLICABLE.

REFERENCE DRAWINGS:
CONTROL ROOM ARRANGEMENT. 12177-EE-27A
COMMUNICATIONS PLAN. 12177-EE-50C

REDRAWN	12-21-84	BY	AKK	CHKD	AKK
HVC-036					
ARRANGEMENT HVAC DIV I PANEL P870 NINE MILE POINT NUCLEAR STATION-UNIT 2 NIAGARA MOHAWK POWER CORPORATION STONE & WEBSTER ENGINEERING CORPORATION 12177-ESK-4CEC19					

135
07-1991
NUCLEAR SAFETY RELATED
QA CAT. I & II
Duff
8601090438 E