

ATTACHMENT A

NIAGARA MOHAWK POWER CORPORATION

LICENSE NO. DPR-63

DOCKET NO. 50-220

Proposed Changes to Technical Specifications (Appendix A)


Existing pages 249 and 251 will be replaced with the attached revised pages. These pages have been retyped in their entirety with marginal markings to indicate changes to the text.


8702260253 870220
PDR ADOCK 05000220
P PDR



1957

FIGURE 6.2-2
NINE MILE POINT NUCLEAR SITE ORGANIZATION

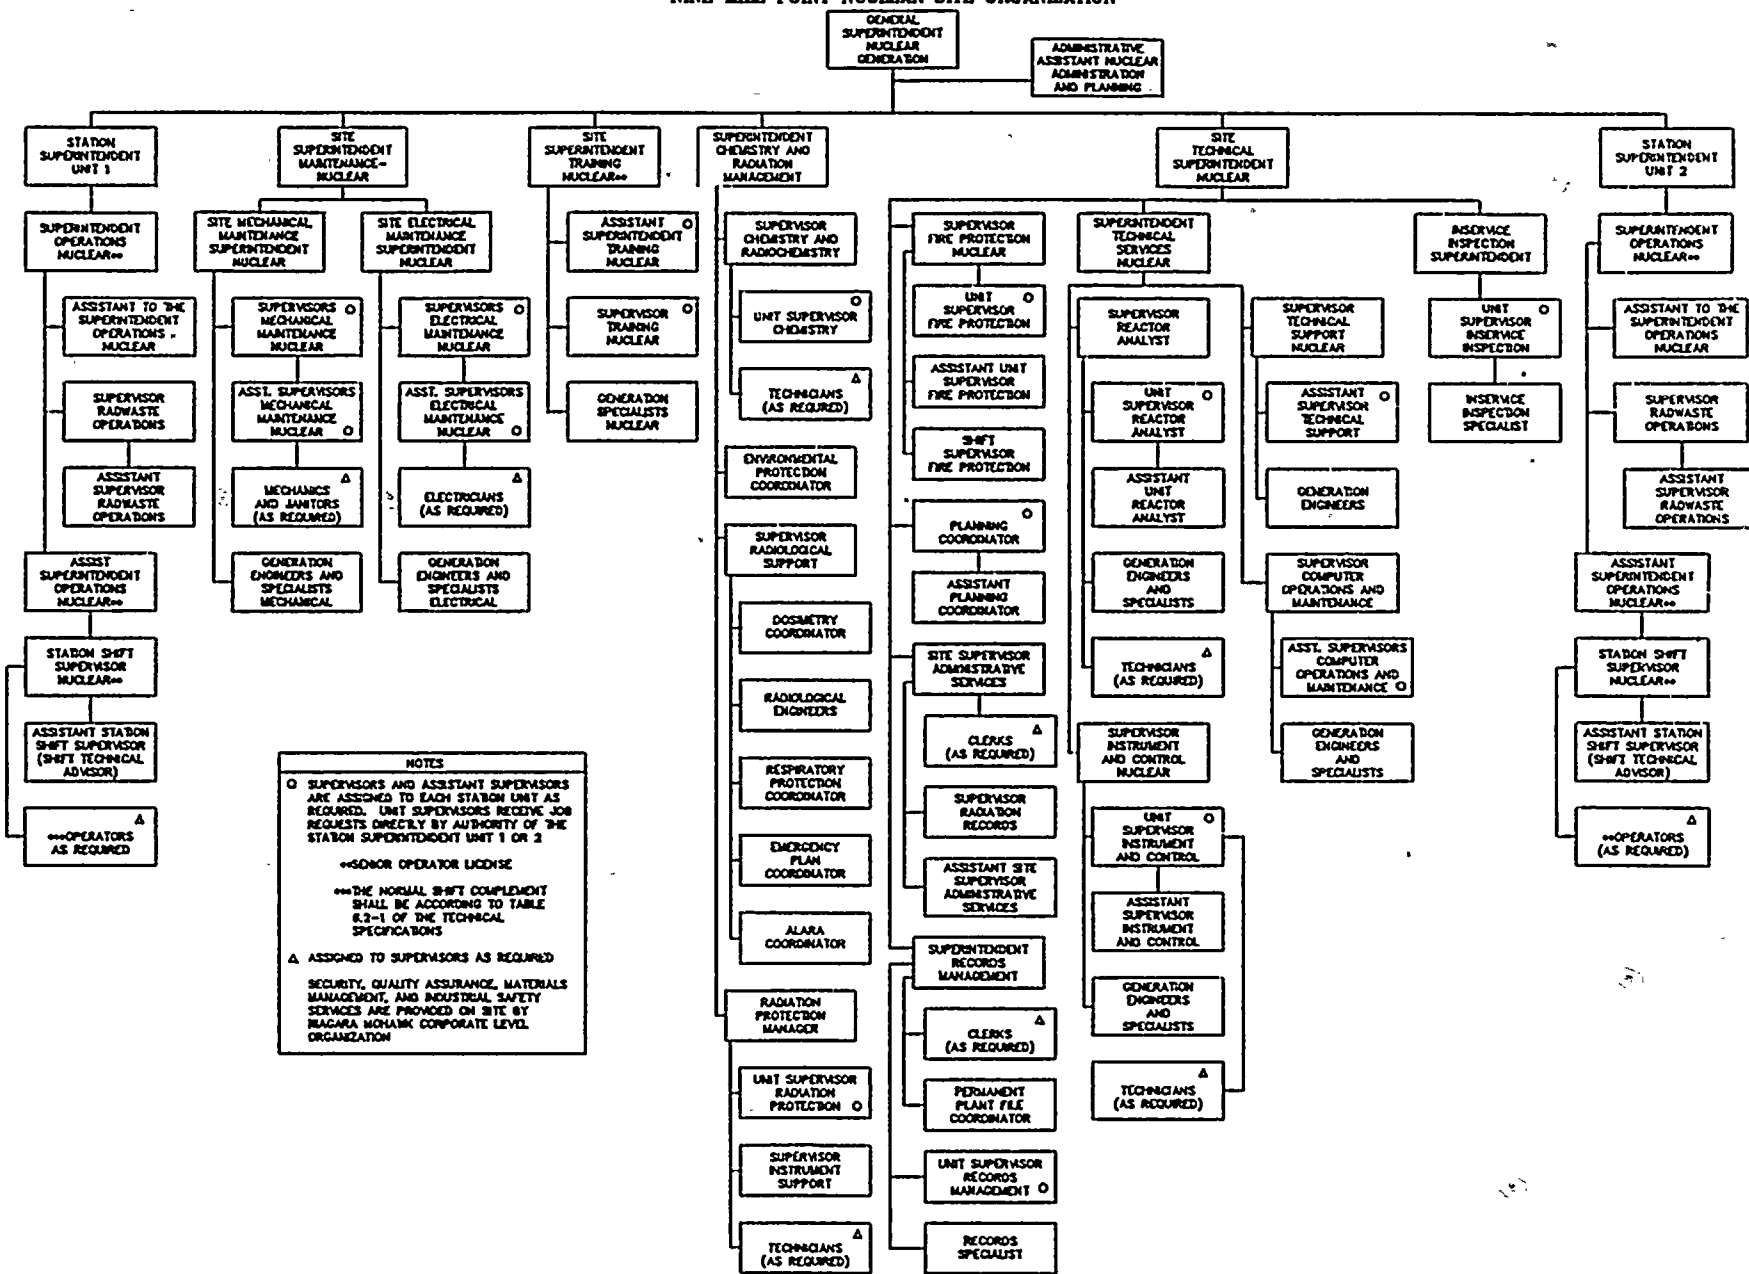



6.3 Facility Staff Qualifications

6.3.1 Each member of the unit staff shall meet or exceed the minimum qualifications of ANSI N18.1-1971 for comparable positions, except for the Radiation Protection Manager who shall meet or exceed the qualifications of Regulatory Guide 1.8, September 1975 and the Shift Technical Advisor who shall have a bachelor's degree in a physical science or engineering or a professional engineer license issued by examination and shall have received specific training in plant design, and response and analysis of the plant for transients and accidents.

6.4 Training

6.4.1 A retraining and replacement training program for the facility staff shall be maintained under the direction of the Superintendent - Training Nuclear and shall meet or exceed the requirements and recommendations of Section 5.5 of ANSI N18.1-1971 and Appendix "A" of 10CFR Part 55.

6.4.2 A training program for the Fire Brigade shall be maintained under the direction of the Superintendent - Training Nuclear and Supervisor - Fire Protection, Nuclear and shall meet or exceed the requirements of Appendix R to 10CFR50.

6.5 Review and Audit

6.5.1 Site Operations Review Committee (SORC)

Function

6.5.1.1 The Site Operations Review Committee shall function to advise the General Superintendent - Nuclear Generation on all matters related to nuclear safety.

Composition

6.5.1.2 The Site Operations Review Committee shall be composed of the:

Chairman:	General Superintendent - Nuclear Generation
Member:	Station Superintendent - Nuclear Generation
Member:	Technical Superintendent - Nuclear Generation
Member:	Superintendent Technical Services - Nuclear
Member:	Site Superintendent Maintenance - Nuclear
Member:	Supervisor Instrument and Control - Nuclear
Member:	Superintendent Chemistry and Radiation Management



... 2000

ATTACHMENT B

NIAGARA MOHAWK POWER CORPORATION

LICENSE NO. DPR-63

DOCKET NO. 50-220

Supporting Information and No Significant Hazards Considerations Analysis

The proposed amendment to Figure 6.2-2 of the Technical Specifications reflects the combined nuclear site organization for Nine Mile Point Unit 1 and Unit 2. The change also represents a restructuring of the Chemistry and Radiation Management Organization. The position of Supervisor Chemistry and Radiation Protection has been divided into two separate positions. The newly created positions are Supervisor Chemistry and Radiochemistry, and Radiation Protection Manager. This change was made to improve the efficiency and effectiveness of the Chemistry and Radiation Management Organization.

The proposed revision to Section 6.3.1 requires the Radiation Protection Manager to meet or exceed the qualifications of Regulatory Guide 1.8, September 1975. This change clarifies the qualifications for the Radiation Protection Manager and provides consistency between the Nine Mile Point Unit 1 and Unit 2 Technical Specifications.

The operation of Nine Mile Point Unit 1 in accordance with the proposed amendment will not involve a significant increase in the probability or consequences of an accident previously evaluated.

The proposed amendment incorporates a management organizational change in the Chemistry and Radiation Management Organization to improve the overall performance of Nine Mile Point Unit 1. The other proposed changes are purely administrative in nature. Therefore, the proposed amendment will not increase the probability or consequences of an accident previously evaluated.

The operation of Nine Mile Point Unit 1 in accordance with the proposed amendment will not create the possibility of a new or different kind of accident from any accident previously evaluated.

This amendment reflects a change in the site organization. The functions and responsibilities of the site organization will remain the same. Therefore, this change does not create any new or different kind of accident from any accident previously evaluated.

The operation of Nine Mile Point Unit 1 in accordance with the proposed amendment will not involve a significant reduction in a margin of safety.

The proposed changes do not affect the limiting conditions for operations as defined in the Technical Specifications. The margin of safety for Nine Mile Point Unit 1 will therefore be unaffected.

