

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8707270034 DOC. DATE: 87/07/17 NOTARIZED: NO DOCKET #
 FACIL: 50-220 Nine Mile Point Nuclear Station, Unit 1, Niagara Powe 05000220
 AUTH. NAME AUTHOR AFFILIATION
 MANGAN, C. V. Niagara Mohawk Power Corp.
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)


SUBJECT: Forwards revised emergency implementing procedures including
 Rev 5 to EPP-22, "Damage Control" & Rev 8 to EPP-15, "Health
 Physics Procedure"

Revised 8-3-87 JHS

DISTRIBUTION CODE: A045D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1
 TITLE: OR Submittal: Emergency Preparedness Plans, Implement'g Procedures, C

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD1-1 PD	1 1	BENEDICT, R	1 1
INTERNAL:	AFDD/DDA/IRB	1 1	NRR/DREP/EPB	1 1
	<u>REG FILE</u> 01	1 1	RES/DE/EIB	1 1
EXTERNAL:	LPDR	1 1	NRC PDR	1 1
	NSIC	1 1		

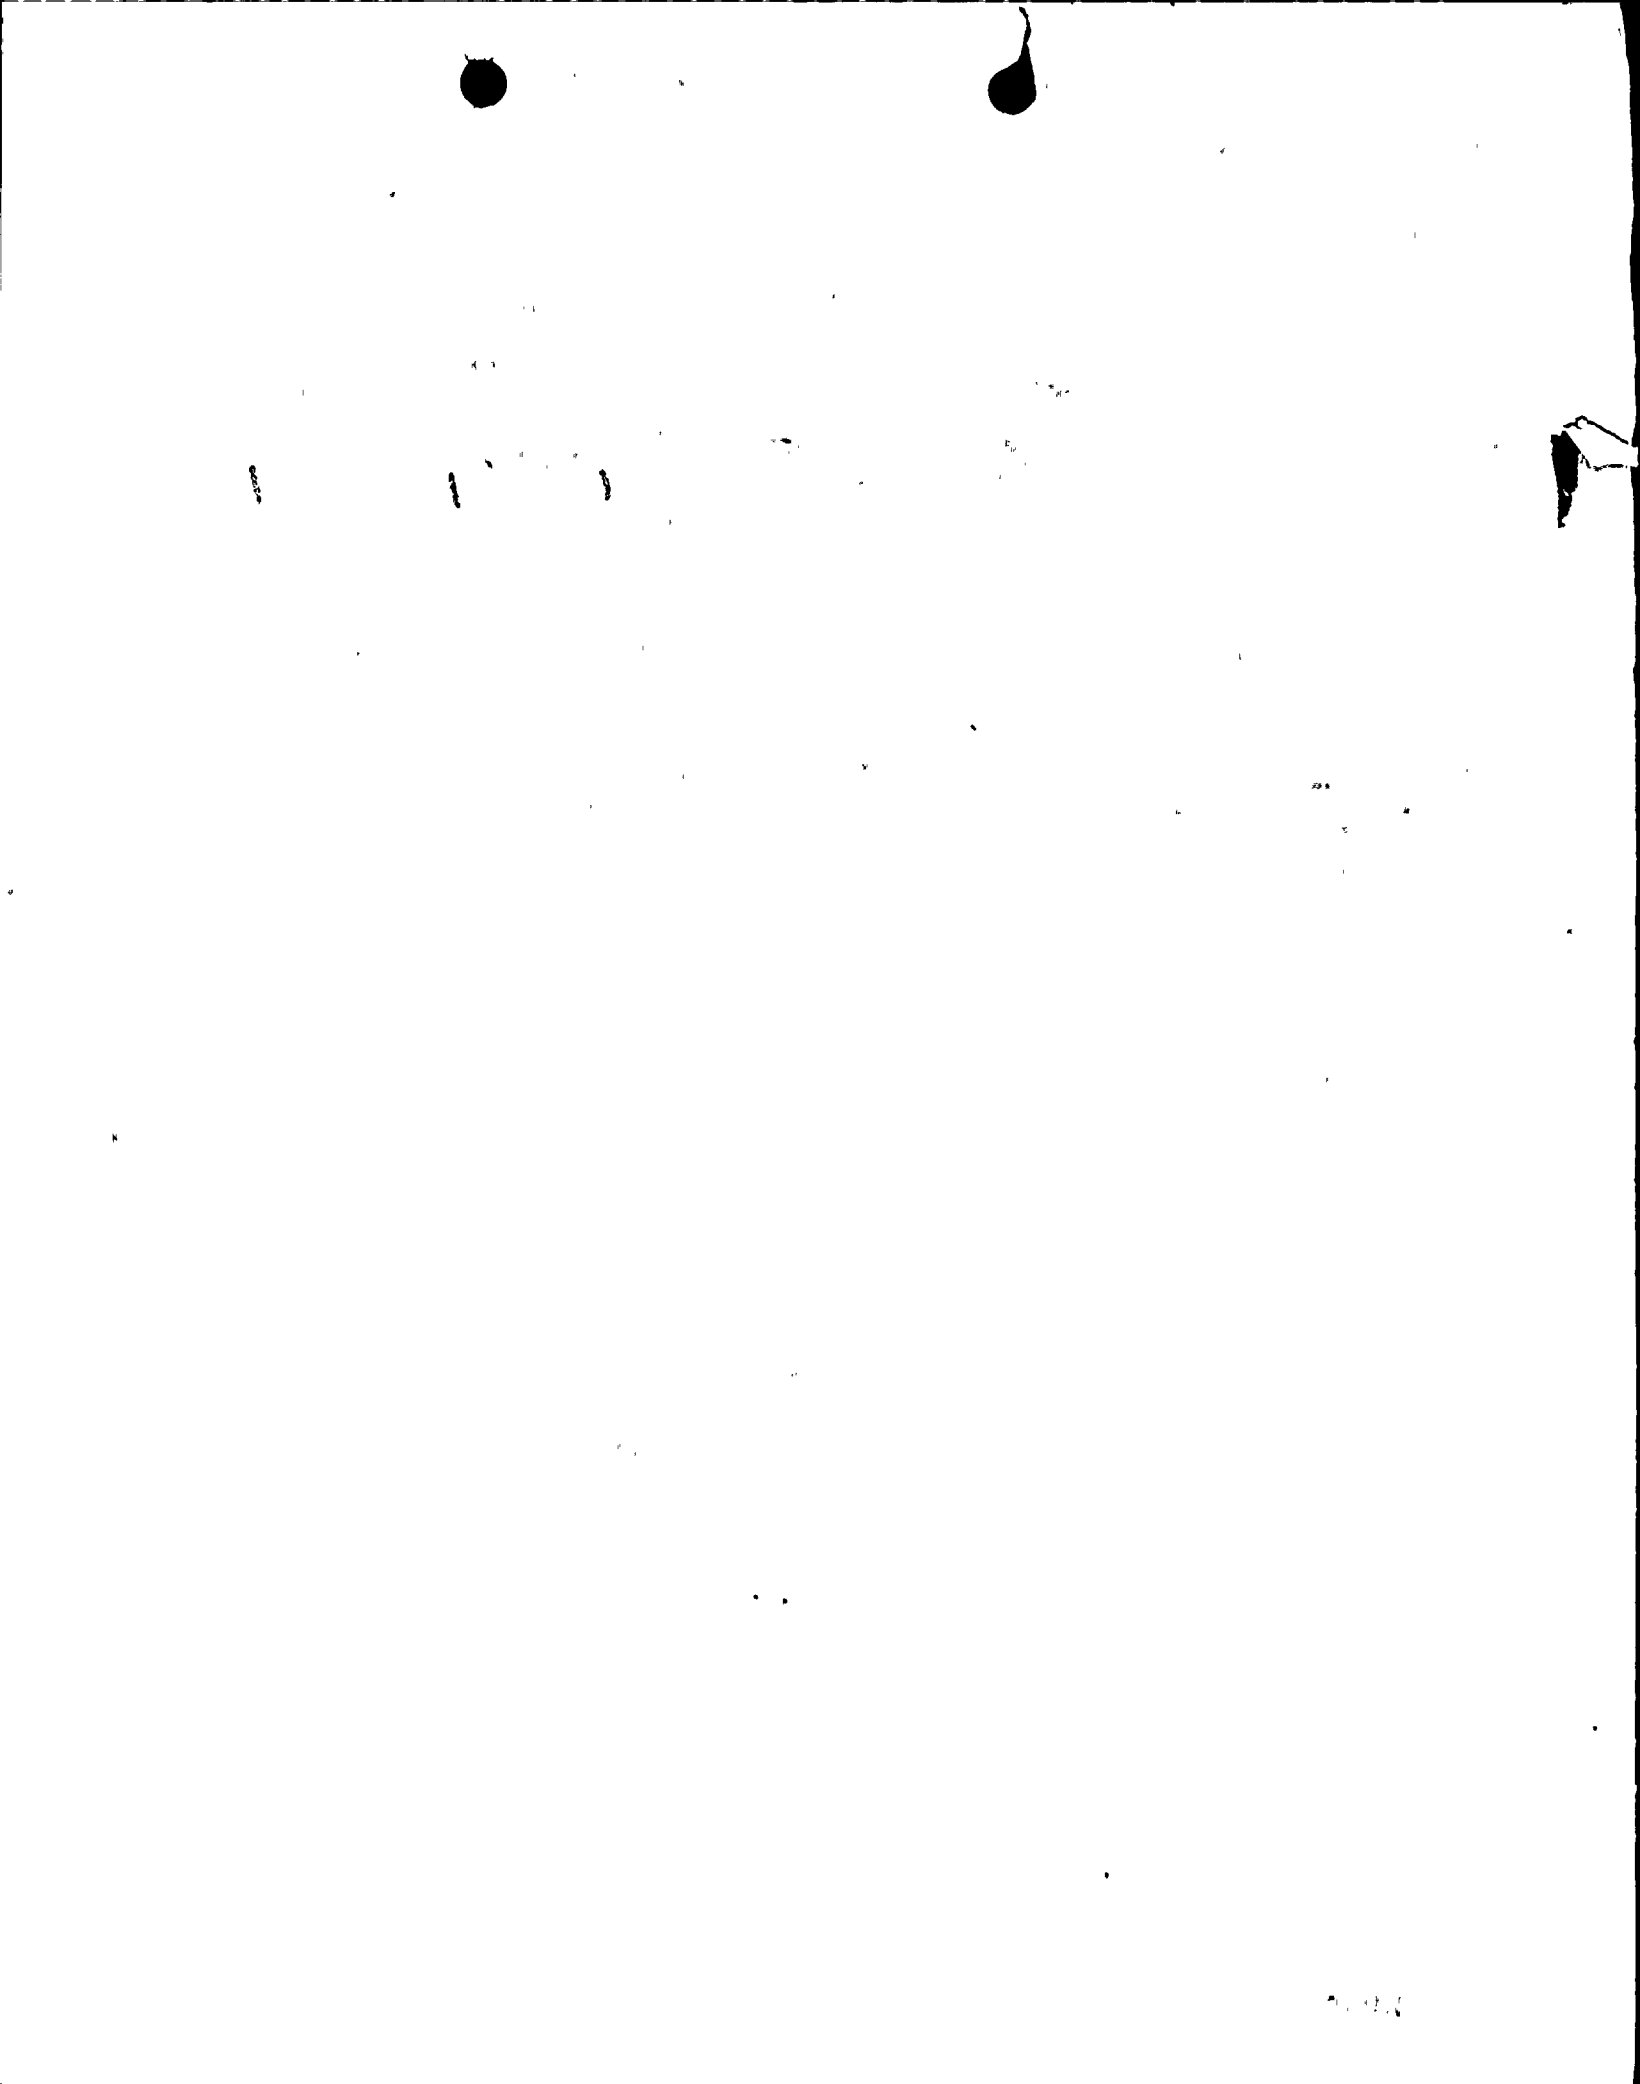

10CFR50, Appendix E, Section V

July 17, 1987
(NMP1L 0171)

U.S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, D.C. 20555

Re: Nine Mile Point Unit 1
Docket No. 50-220
DPR-63

Gentlemen:

Enclosed is an uncontrolled copy of each of the following emergency procedures relating to the Niagara Mohawk Power Corporation Nine Mile Point Nuclear Station:

- Emergency Plan Implementing Procedure 22, Revision 5
- Emergency Plan Implementing Procedure 15, Revision 8

These emergency procedure revisions are submitted as required in Section V to Appendix E of 10CFR Part 50. Two controlled copies have been provided to the Region I office and one controlled copy has been provided to the Resident Inspector under separate cover.

Very truly yours,

NIAGARA MOHAWK POWER CORPORATION

C. V. Mangon
C. V. Mangon
Senior Vice President

CDH/pns
0477b-1
Enclosure

xc: (w/out attachment)
Regional Administrator, Region I
Mr. R. A. Capra, Director
Mr. R. A. Benedict, Project Manager
Mr. W. A. Cook, Resident Inspector
Mr. T. Chwalek

8707270034 870717
PDR ADDOCK 05000220
F PDR

*A045
1/1*

