### REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8708100031 DOC. DATE: 87/07/30 NOTARIZED: NO DOCKET # FACIL: 50-220 Nine Mile Point Nuclear Station, Unit 1, Niagara Powe 05000220 50-410 Nine Mile Point Nuclear Station, Unit 2, Niagara Moha 05000410

AUTH. NAME AUTHOR AFFILIATION

GALLO, R. M. Region 1, Office of Director


RECIP. NAME RECIPIENT AFFILIATION
MANGAN, C. V. Niagara Mohawk Power Corp.

SUBJECT: Forwards Insp Repts 50-220/87-07 & 50-410/87-08 on 870420-0607. No violations identified. Licensee failed to comply w/station procedures for sys valve lineups & alarm responses.

DISTRIBUTION CODE: IEO1D COPIES RECEIVED: LTR \_ ENCL \_ SIZE: 2 + 32
TITLE: General (50 Dkt)-Insp Rept/Notice of Violation Response

# NOTES:

	RECIPIENT ID CODE/NAME PD1-1 PD NEIGHBORS, D	COPIE LTTR 1 2	ES ENCL 1 2	RECIPIENT ID CODE/NAME BENEDICT,R MINER,S	COP LTTR 2 2	
INTERNAL:	ACRS DEDRO NRR/DOEA DIR NRR/DREP/RPB NRR/PMAS/ILRB OGC/HDS1 RES DEPY GI	2 .1 1 2 1 1 1	2 1 1 2 1 1 1 1 1	AEOD NRR MORISSEAU, D NRR/DREP/EPB NRR/DRIS DIR OE LIEBERMAN, J REG FILE RGNI FILE 01	1 1 1 1 1	1 1 1 1 1 1
EXTERNAL:	LPDR NSIC	1	1 1	NRC PDR	<b>1</b>	i



# **30** JUL 1987

Docket Nos. 50-220 50-410

Niagara Mohawk Power Corporation ATTN: Mr. Charles V. Mangan Senior Vice President - Nuclear 301 Plainfield Road Syracuse, New York 13212

#### Gentlemen:

Subject: Combined Inspection Report Nos. 50-220/87-07 and 50-410/87-08

This refers to the routine inspection conducted by Messrs. W. Cook, C. Marschall, R. Nimitz and W. Schmidt of this office on April 20, 1987 to June 7, 1987 at Nine Mile Point Units 1 and 2, Scriba, New York. A summary of the findings was presented to Mr. T. Perkins and other members of your staff at the conclusion of the inspection.

Based on our review, two examples have been identified where the Unit 2 staff failed to comply with station procedures for system valve lineups and alarm responses, and as a result violated NRC requirements identified in the enclosed Notice of Violation (Appendix A). This violation has been categorized by severity level according to 10 CFR Part 2, Appendix C (Enforcement Policy). You are required to respond to this violation and in preparing your response. you should follow the instructions in Appendix A.

The response required by this letter is not subject to the clearance procedures of the Office of Management and Budget as required by the Paperwork Reduction Act of 1980, PL96-511.

Your cooperation with us is appreciated.

Sincerely,

# Original Signed By:

Robert M. Galló, Chief Projects Branch No. 2 Division of Reactor Projects

## Enclosures:

1. Appendix A, Notice of Violation


NRC Region I Combined Inspection Report Nos. 50-220/87-07 and 50-410/87-08

ICIAL RECORD COPY

8708100031 870730 PDR ADDCK 05000220

CIR NMP 87-07/08 - 0001.0.0

07/29/87 IEOI

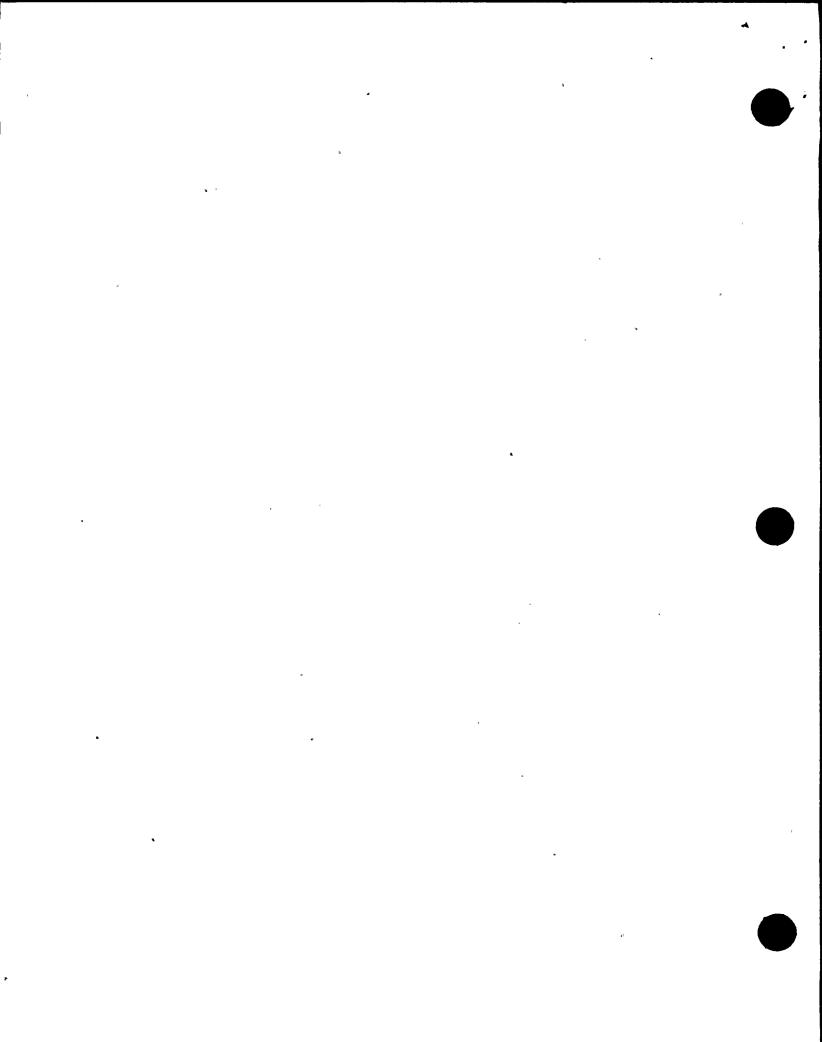



cc w/encls:

Connor & Wetterhahn

John W. Keib, Esquire

T. E. Lempges, Vice President, Nuclear Generation

T. J. Perkins, General Superintendent

T. W. Roman, Station Superintendent, Unit 1

R. B. Abbott, Station Superintendent, Unit 2 J. A. Perry, Vice President, Quality Assurance

A. Z. Pinter, NMPC Site Licensing

C. G. Beckam, Manager, QA Operations

D. Quamme, NMP-2 Project Director

W. Hansen, Manager, Quality Assurance

J. Aldrich, Supervisor, Operations

W. Drews, Technical Superintendent Troy B. Conner, Jr., Esquire

Director, Power Division

Department of Public Service, State of New York

Public Document Room (PDR)

Local Public Document Room (LPDR)

Nuclear Safety Information Center (NSIC)

NRC Resident Inspector

State of New York

bcc w/encls:

Region I Docket Room (with concurrences)

Management Assistant, DRMA (w/o encls)

J. Durr, Engineering Programs Branch Chief

J. Johnson, Section Chief, DRP

State Liaison Officer (SLO)

RI:DRP Perry

RI:DRP Johnson 744/87

RIVDRP Gallo 7*1*30/87

OFFICIAL RECORD COPY

CIR NMP 87-07/08 - 0002.0.0 07/26/87

