

UNITED STATES NUCLEAR REGULATORY COMMISSION WASHINGTON, D. C. 20555

NIAGARA MOHAWK POWER CORPORATION

DOCKET NO. 50-220

NINE MILE POINT NUCLEAR STATION, UNIT 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 112 License No. DPR-63

- 1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Niagara Mohawk Power Corporation (the licensee) dated March 16, 1989, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
- 2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C.(2) of Facility Operating License No. DPR-63 is hereby amended to read as follows:

.

(2) Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No.112, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. This license amendment is effective as of the date of its issuance.


FOR THE NUCLEAR REGULATORY COMMISSION

Robert Martin
Robert A. Capra, Director
Project Directorate I-1

Division of Reactor Projects - I/II Office of Nuclear Reactor Regulation

Attachment: Changes to the Technical Specifications

Date of Issuance: December 1, 1989

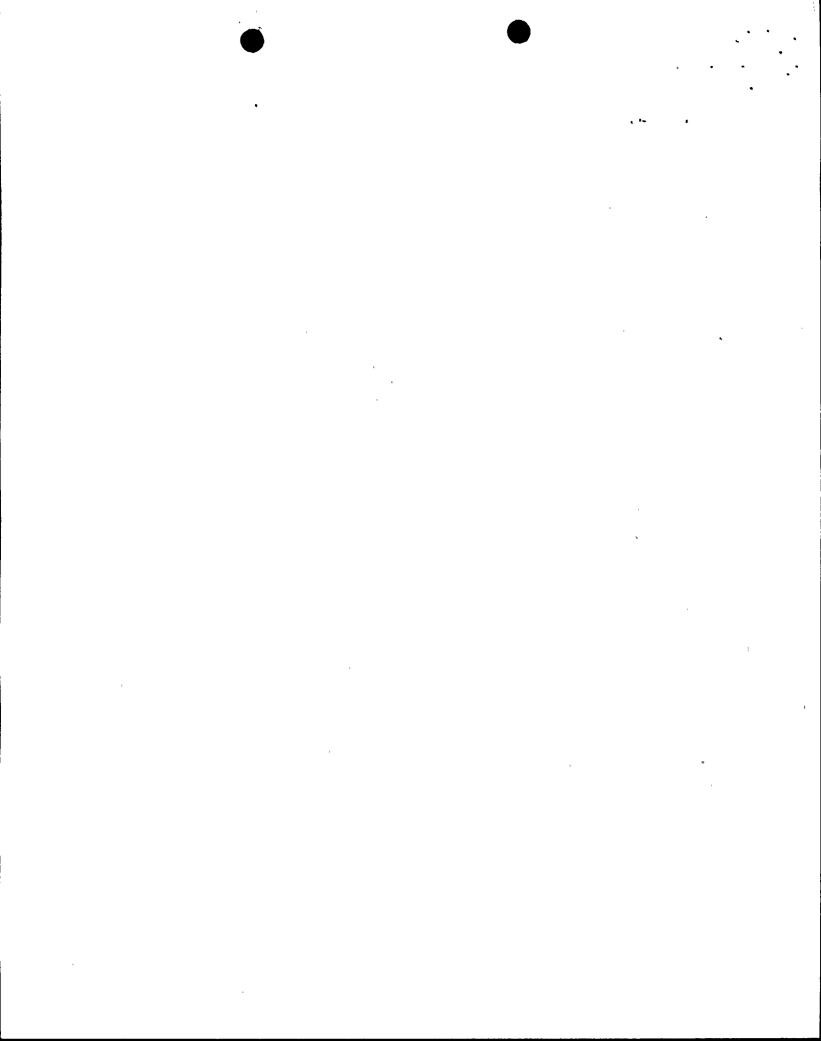

ATTACHMENT TO LICENSE AMENDMENT

AMENDMENT NO. 112 TO FACILITY OPERATING LICENSE NO. DPR-63

DOCKET NO. 50-220


Revise Appendix A as follows:

Remove Page

148

Insert Page

148



LIMITING CONDITION FOR OPERATION

Table 3.3.4 (Continued)

PRIMARY CONTAINMENT ISOLATION VALVES LINES ENTERING FREE SPACE OF THE CONTAINMENT

Line or System	No. of Valves (Each Line)	Location Relative to Primary Containment	Normal Position	<u> Motive Power</u>	Maximum Oper. Time (Sec)	Action on Initiating Signal	Initiating Signal (All Valves Have Remote Hanual Backup)
Core Spray (c) Pump Suction	•						÷
(Four Lines from Suppression Chamber)	1	Outside	Open	AC Motor	90	-	Remote manual
Pump Discharge (Two Test Lines to Suppression Chamber)	1	Outside	Closed	AC Hotor	90	Close	Reactor water level . low-low
LINES HITH A CLOSED LOOP INSIDE CONTAINHENT VESSELS							
Recir. Pump Cooling Water Supply (c) Supply Line Return Line	1	Outside Outside	Open Open	Self Act. Ck. DC Motor	30	<u>-</u>	 Remote manual
Drywell Cooler Hater Supply (c) Supply Line Return Line	1	Outside Outside	Open Open	Self Act. Ck. DC Motor	 30	Ξ	 Remote manual
LINES HITH A CLOSED LOOP OUTSIDE CONTAINMENT VESSELS							
Containment Spray (c) Drywell & Suppression Chamber Common Sup (Four Lines)	oply I	Outside	Open	Air/DC Sol.	60	<u>-</u>	Remote manual
Drywell <u>Branch</u> (Four Lines)	1	Outside		Self Act. Ck.		-	
Suppression Chamber Branch (One Branch for Each System)	2*	Outside		Self Act. Ck.		-	
Pump Suction From Suppression Chamber (four lines)	1	Outside	Open	AC Hotor	70	-	Remote manual

One valve in each separate line and one valve in each common line.(c) These are classified as not-testable valves and penetrations.

