


PRIMARY CONTAINMENT CONTROL

ENTRY CONDITIONS					
Drywell temperature above 150°F	Suppression pool water level above E: 201.5	Suppression pool water level below E: 198.5	Drywell pressure above 1.68 psig	Primary containment hydrogen concentration above 1%	Suppression pool temperature above 90°F

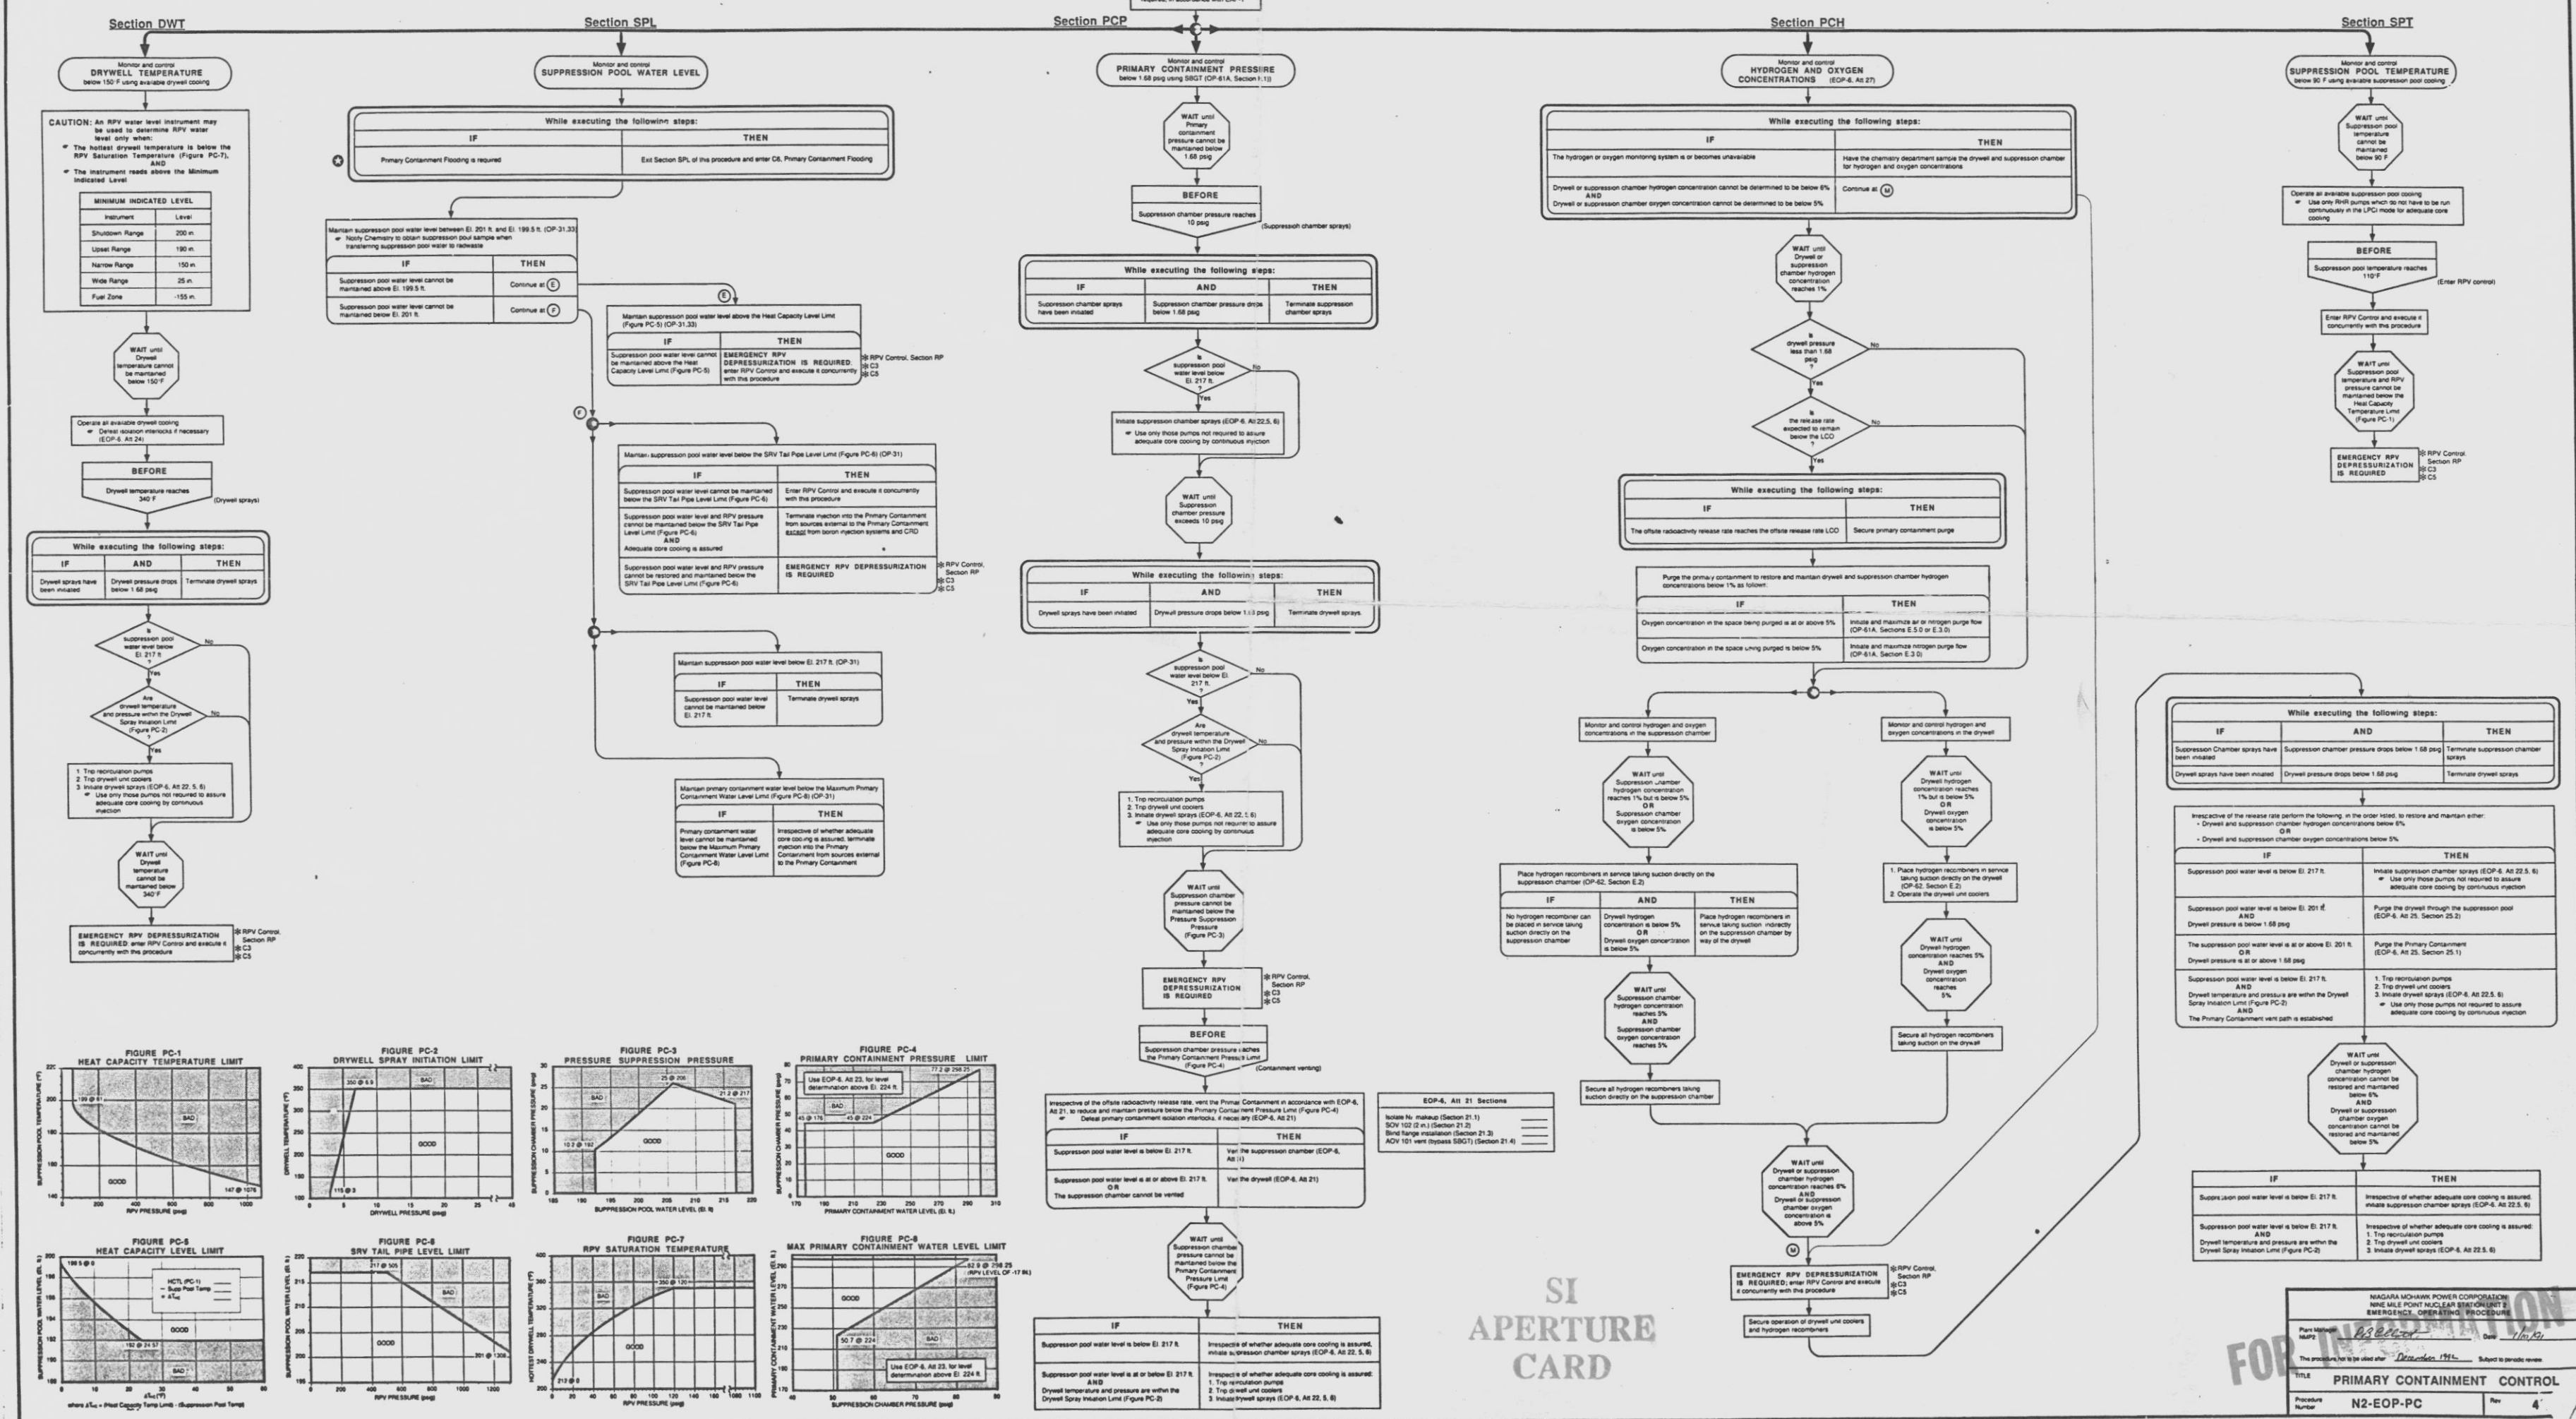

SI
APERTURE
CARD

FOR INFORMATION ONLY
MAGNANUCLEAR POWER CORPORATION
PINE BLUFF NUCLEAR REACTOR
EMERGENCY OPERATING PROCEDURES
PRIMARY CONTAINMENT CONTROL
N2-EOP-PC Rev 4

07-58-91
27

9304290135

D