
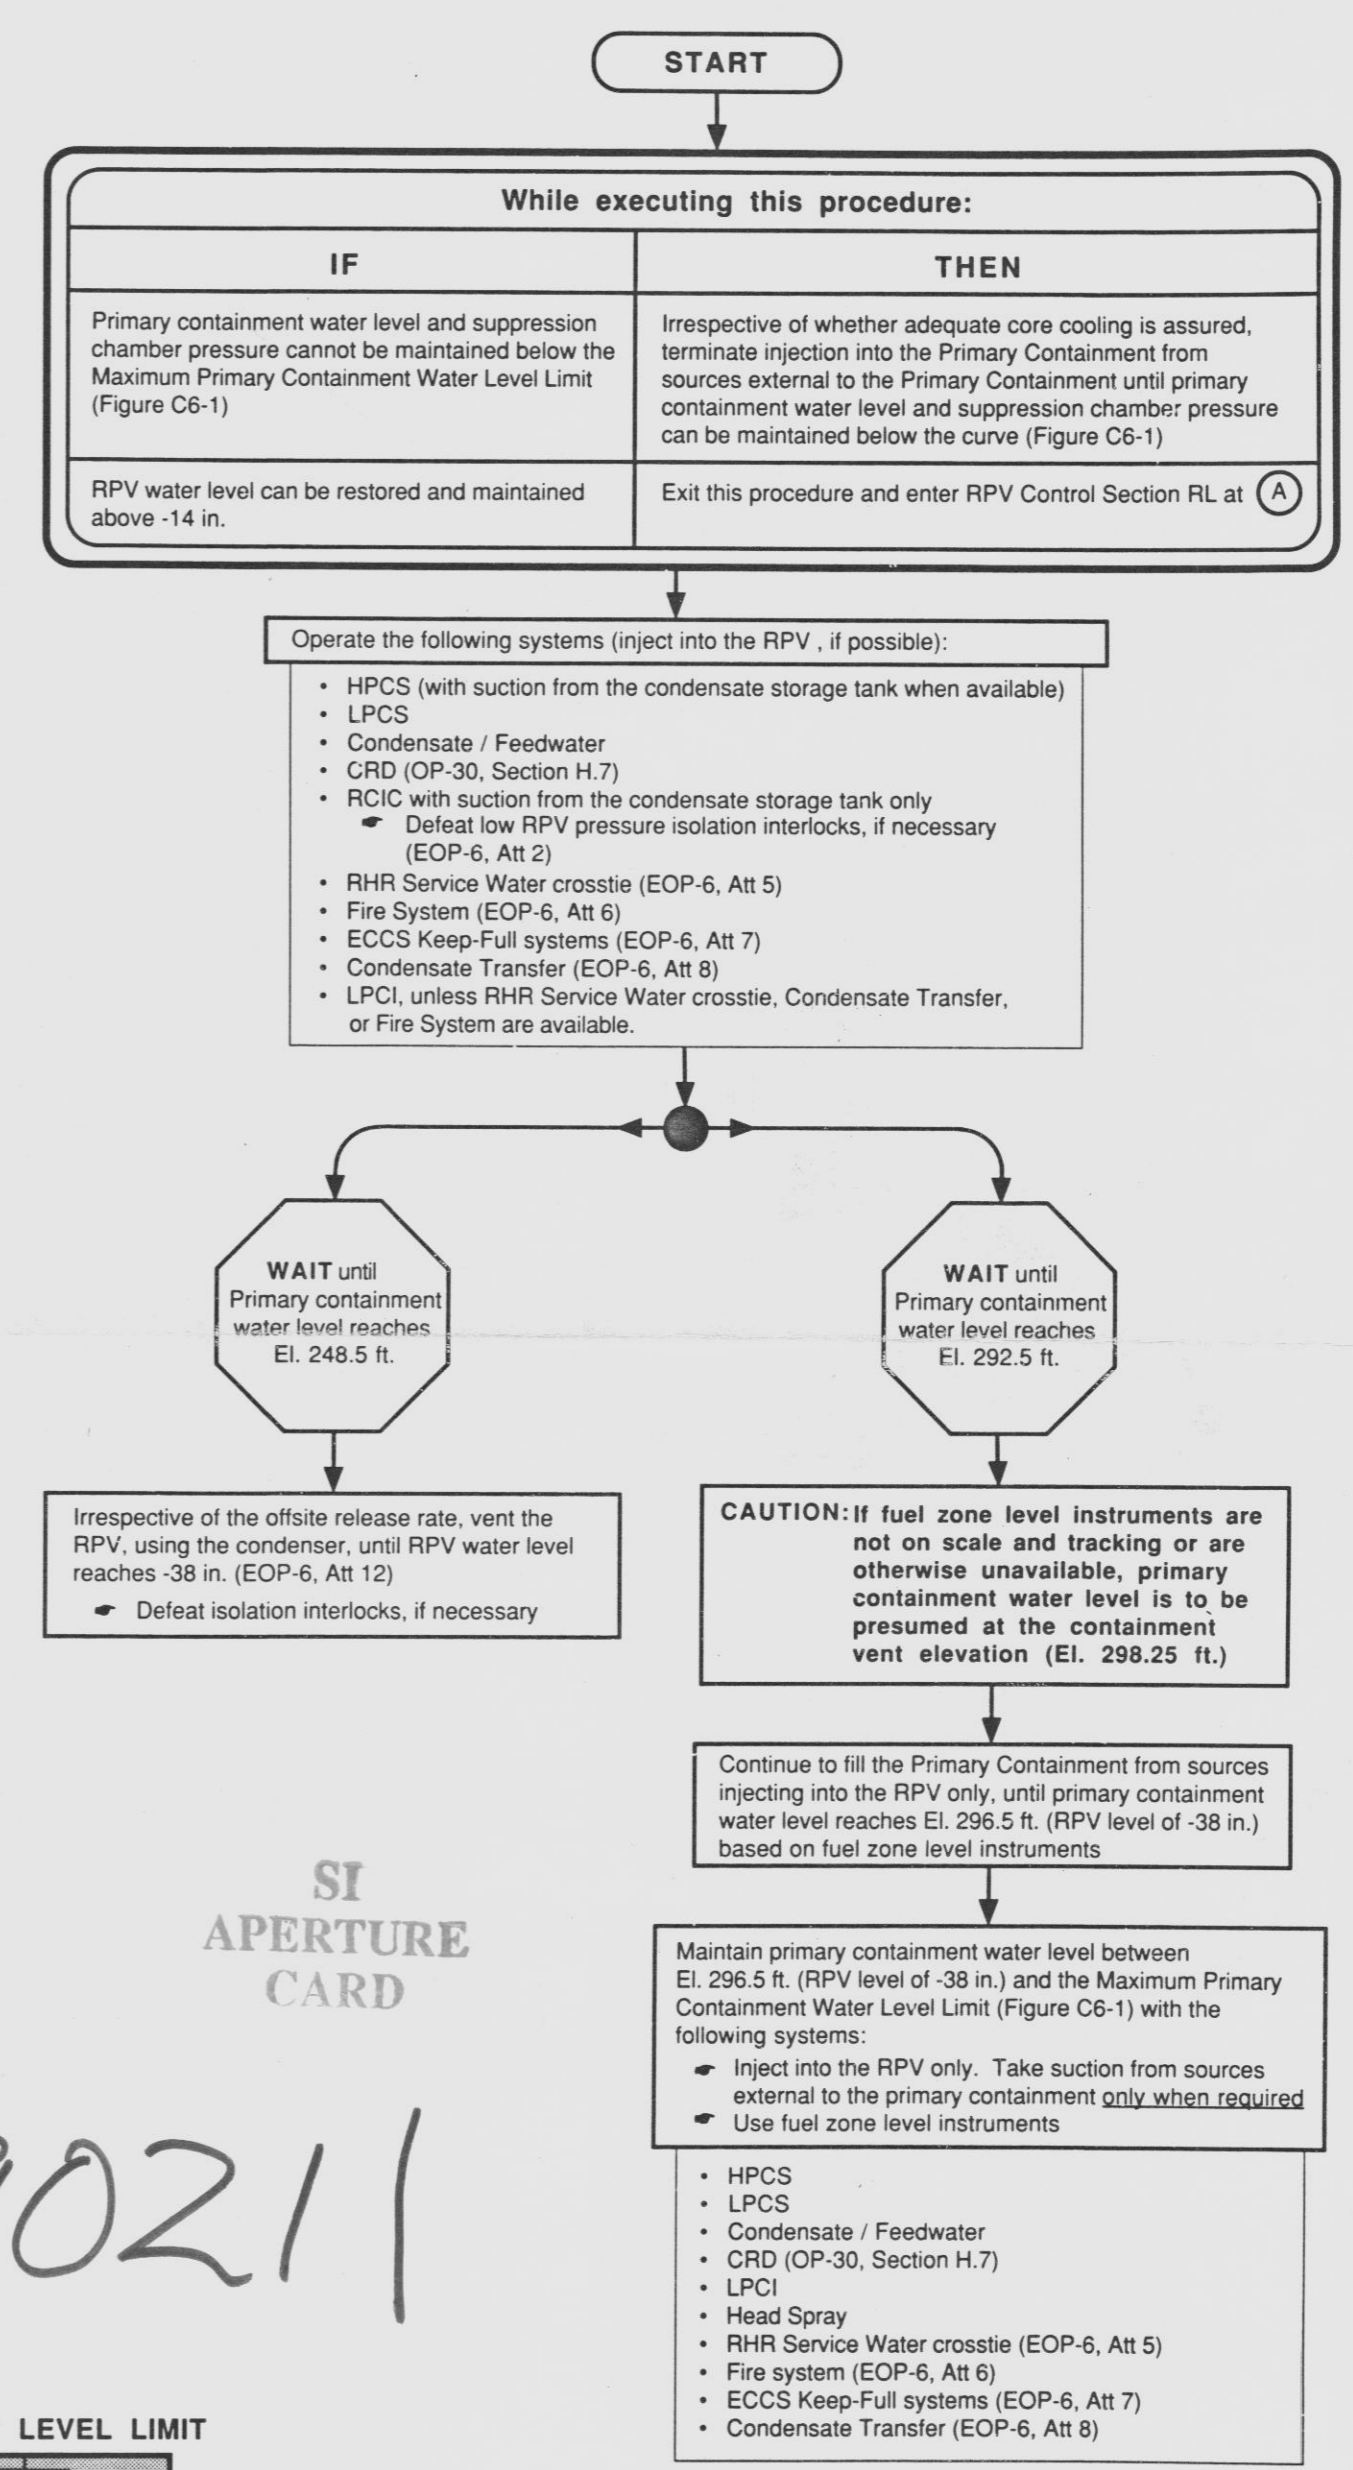
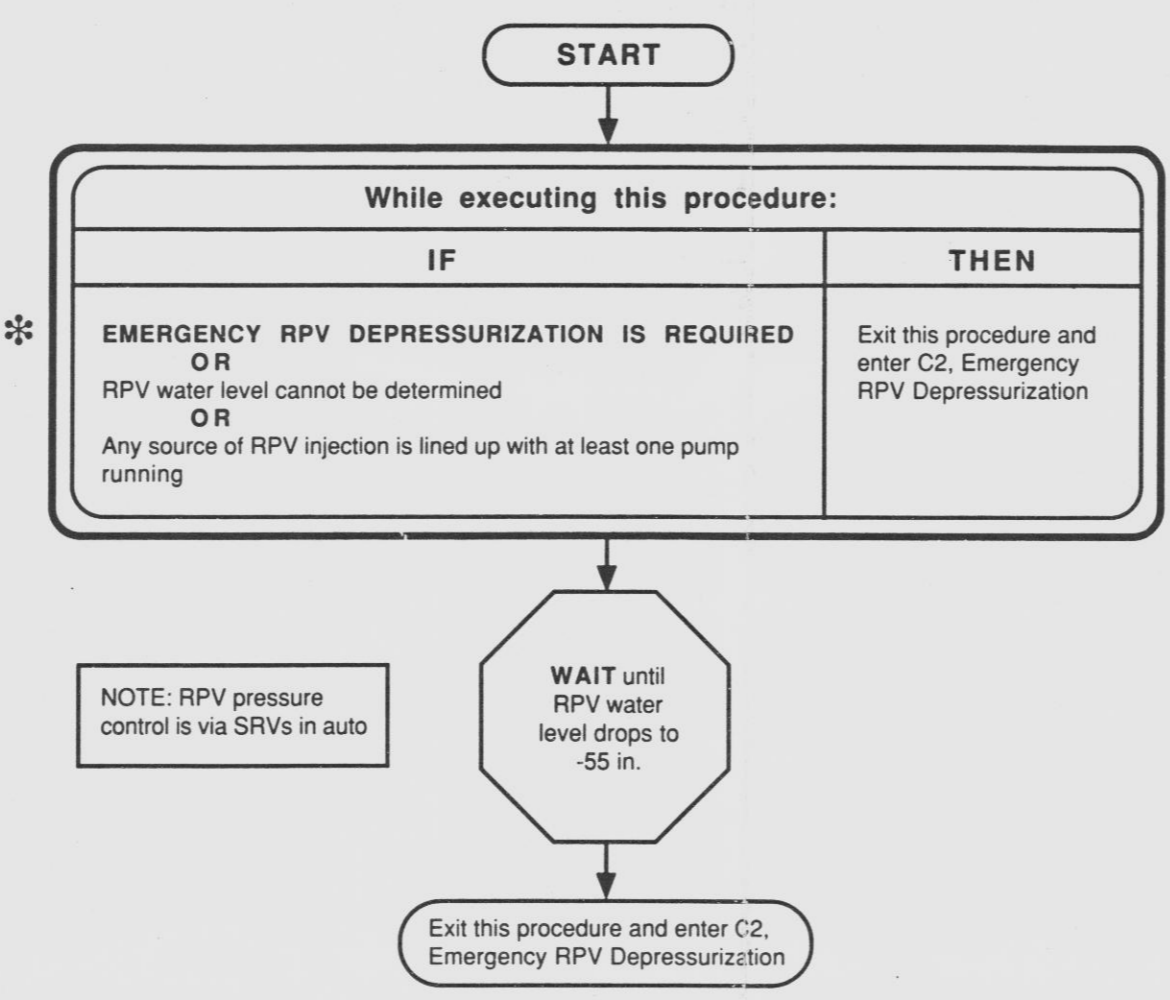


# EMERGENCY RPV DEPRESSURIZATION


# STEAM COOLING

# PRIMARY CONTAINMENT FLOODING

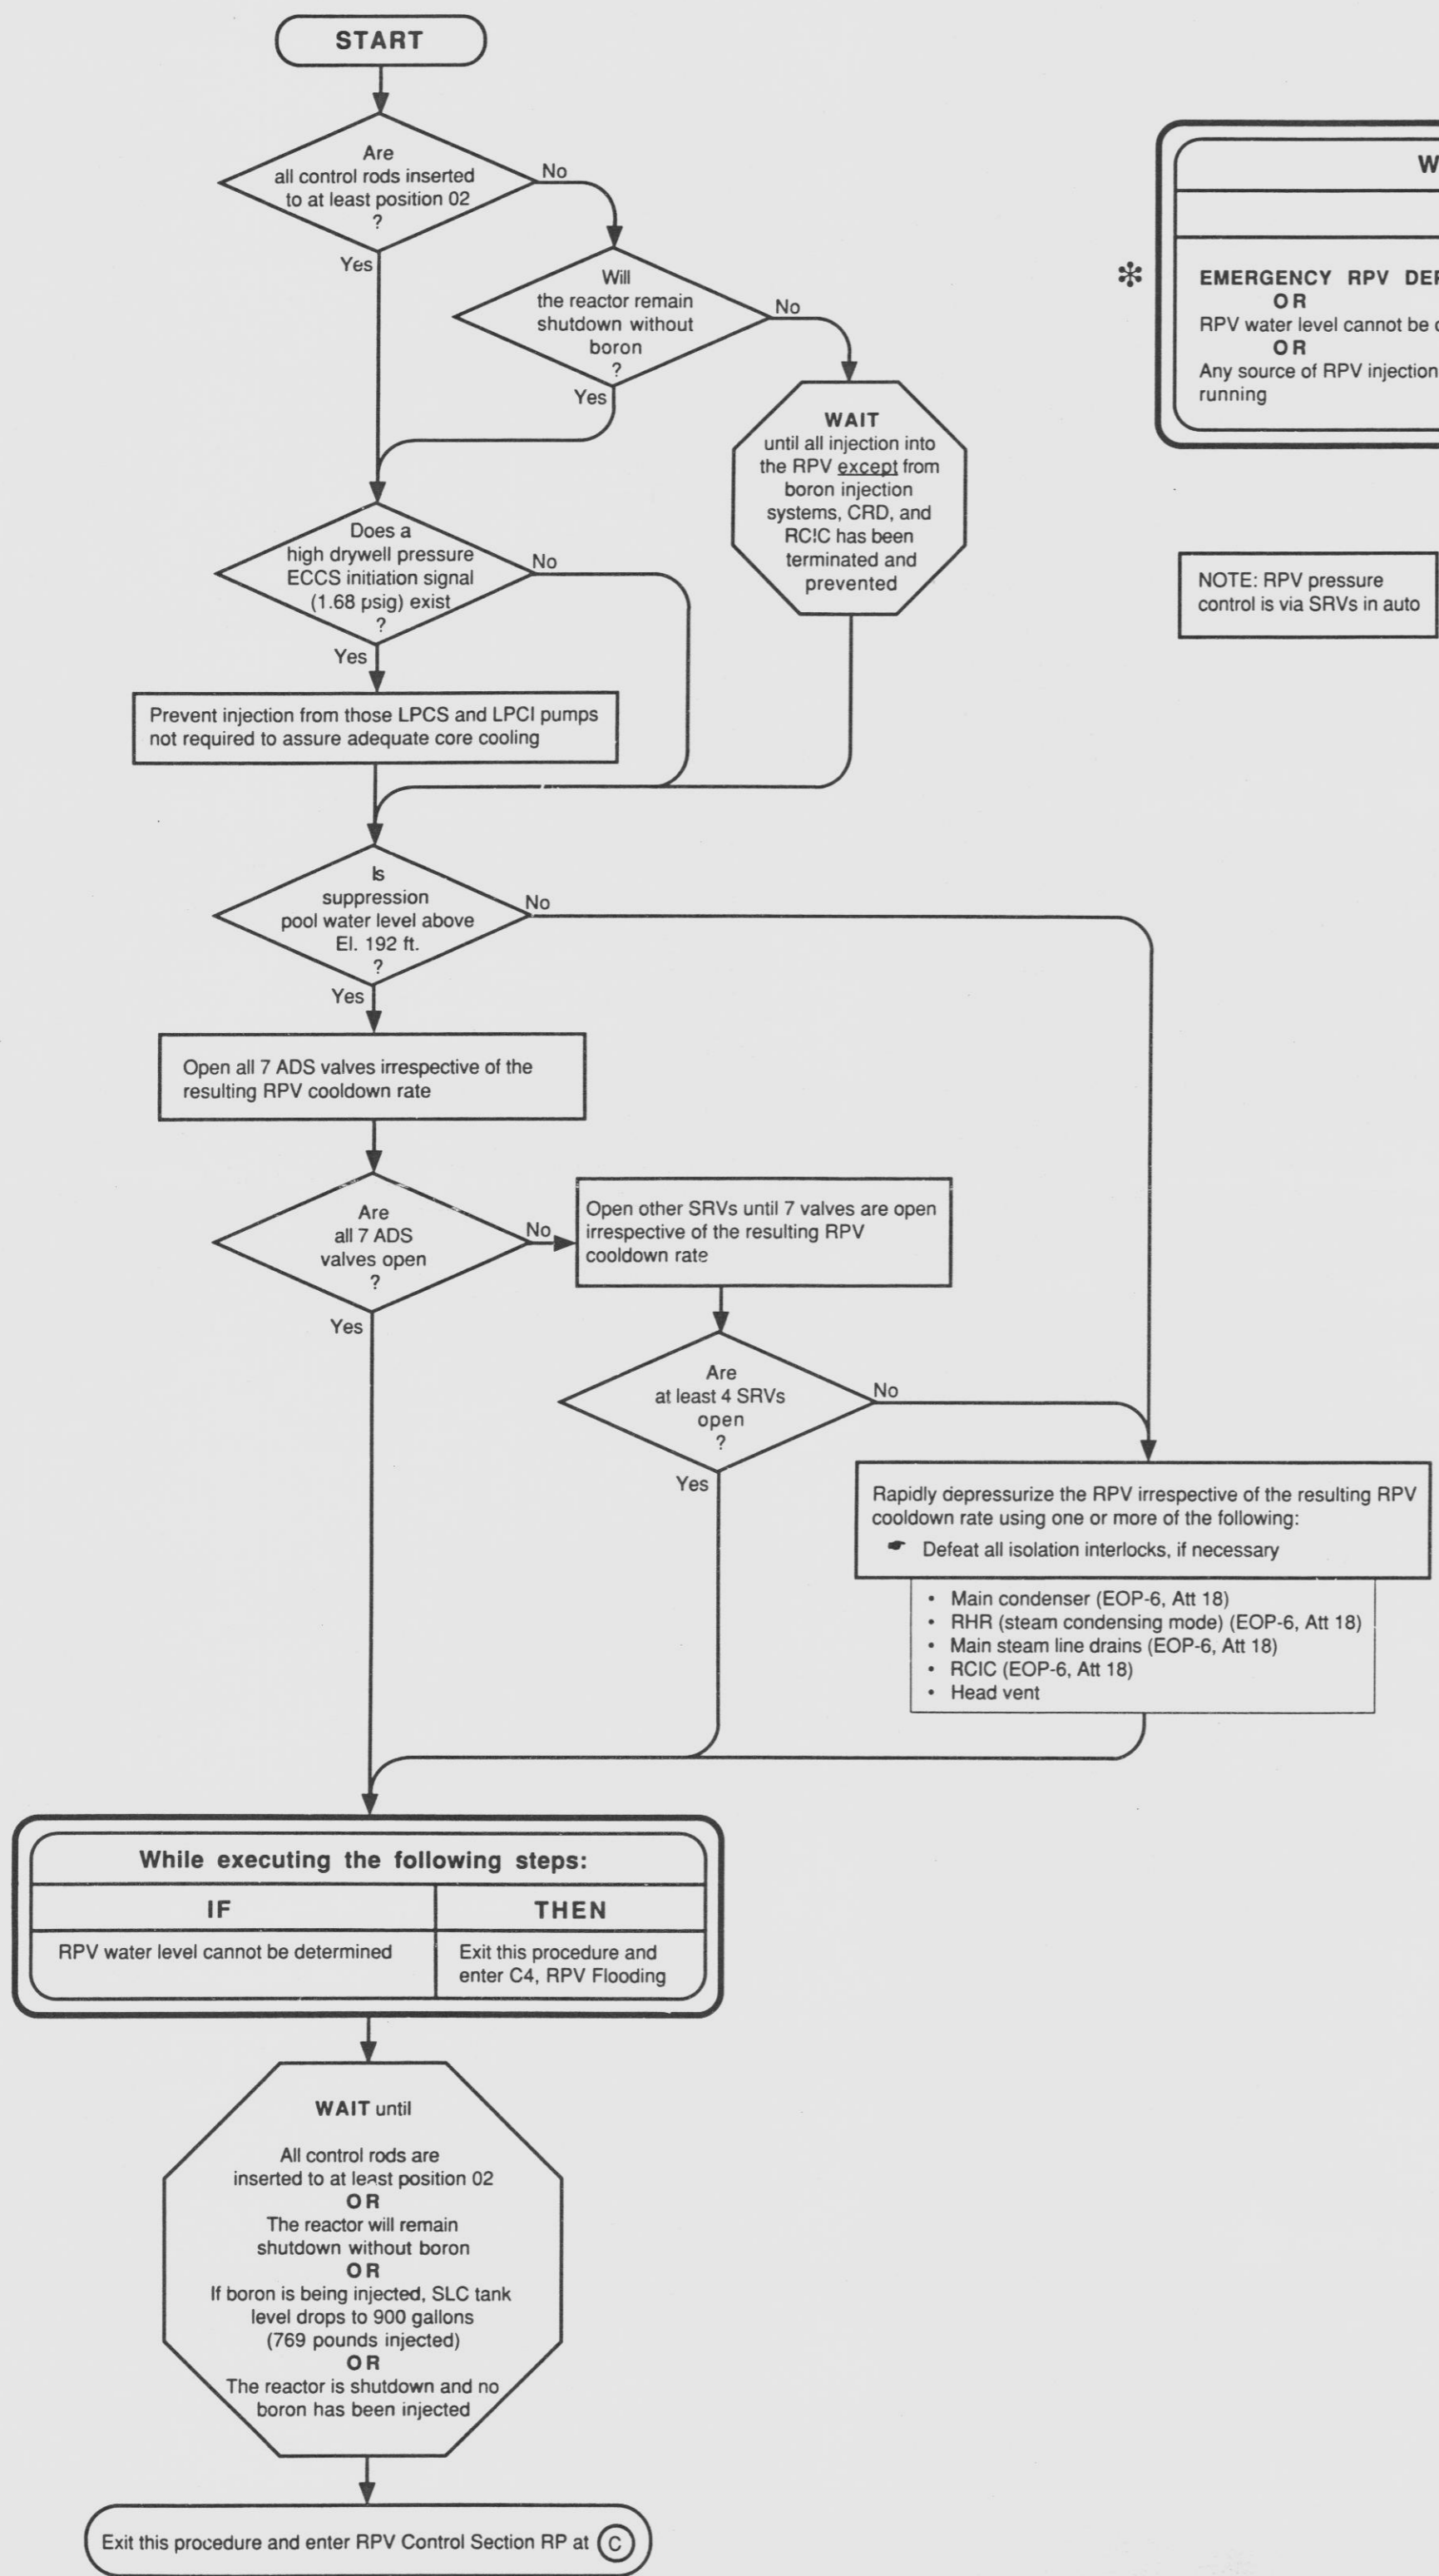

SI APERTURE CARD

9304290211

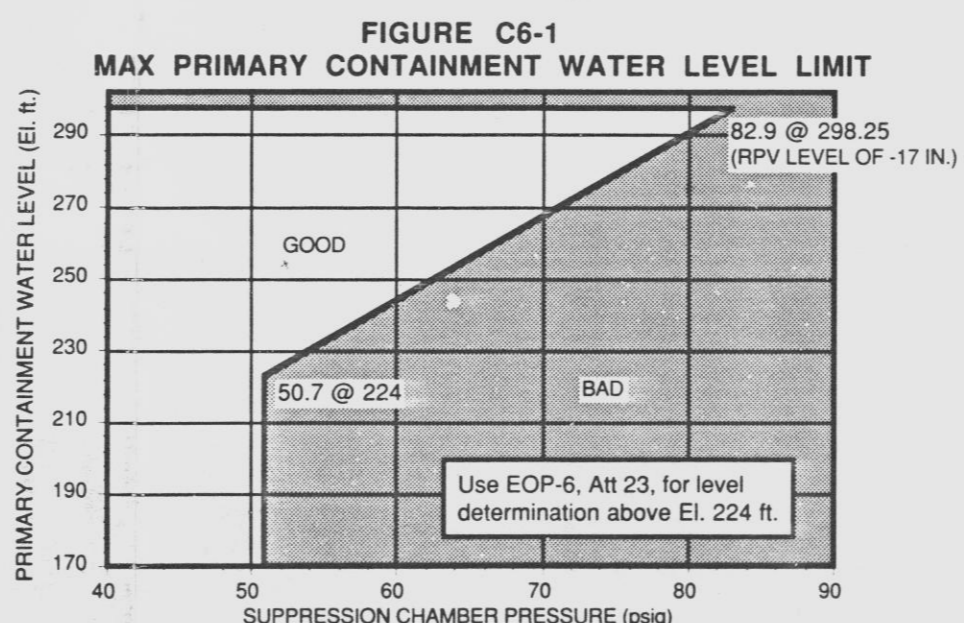

NIAGARA MOHAWK POWER CORPORATION  
NINE MILE POINT NUCLEAR STATION UNIT 2  
EMERGENCY OPERATING PROCEDURE

Plant Manager: R. B. Blissett Date: 1/10/92

This procedure not to be used after: December 1992 Subject to periodic review.

TITLE: **EMERGENCY RPV DEPRESSURIZATION  
STEAM COOLING  
PRIMARY CONTAINMENT FLOODING**

Procedure Number: **N2-EOP-C2, C3, C6** Rev: **4**

D  
1128521036  
07-10-91