


- NOTES:**
1. UNOCCUPIED PANEL AREA (TYPICAL AS SHOWN) THAT CAN BE USED FOR ADDITION OF COMPONENTS MUST BE KEPT CLEAR OF WIRING, STIFFENERS, ETC. ROUTING OF WIRING TO BE SUCH THAT ADDITION OF COMPONENTS CAN BE DONE WITH MINIMUM OF REWORK.
 2. SEE EQUIPMENT LIST ESK-4CEC122.
 3. PROVIDE ACCESS DOORS PER G.E. SPEC NO. 22A2877.
 4. UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES.
 5. TRIP SEPARATOR TO BE ADDED.
 6. DOTTED LINE INDICATES LOCATION OF BARRIER THAT IS TO BE PROVIDED IN REAR OF PANEL.
 7. SCALE NONE.
 8. CABINET DEPTH 36" REF.
 9. THIS AREA TO BE BARRIRED IN REAR OF PANEL. BEHIND TRIP SEPARATOR OUTLINE AS SHOWN.
 10. NOT APPLICABLE.

REFERENCE DRAWINGS:
 CONTROL ROOM ARROT. DWG NO. 12177-EE-274
 COMMUNICATIONS PLAN. DWG NO. 12177-EE-80C

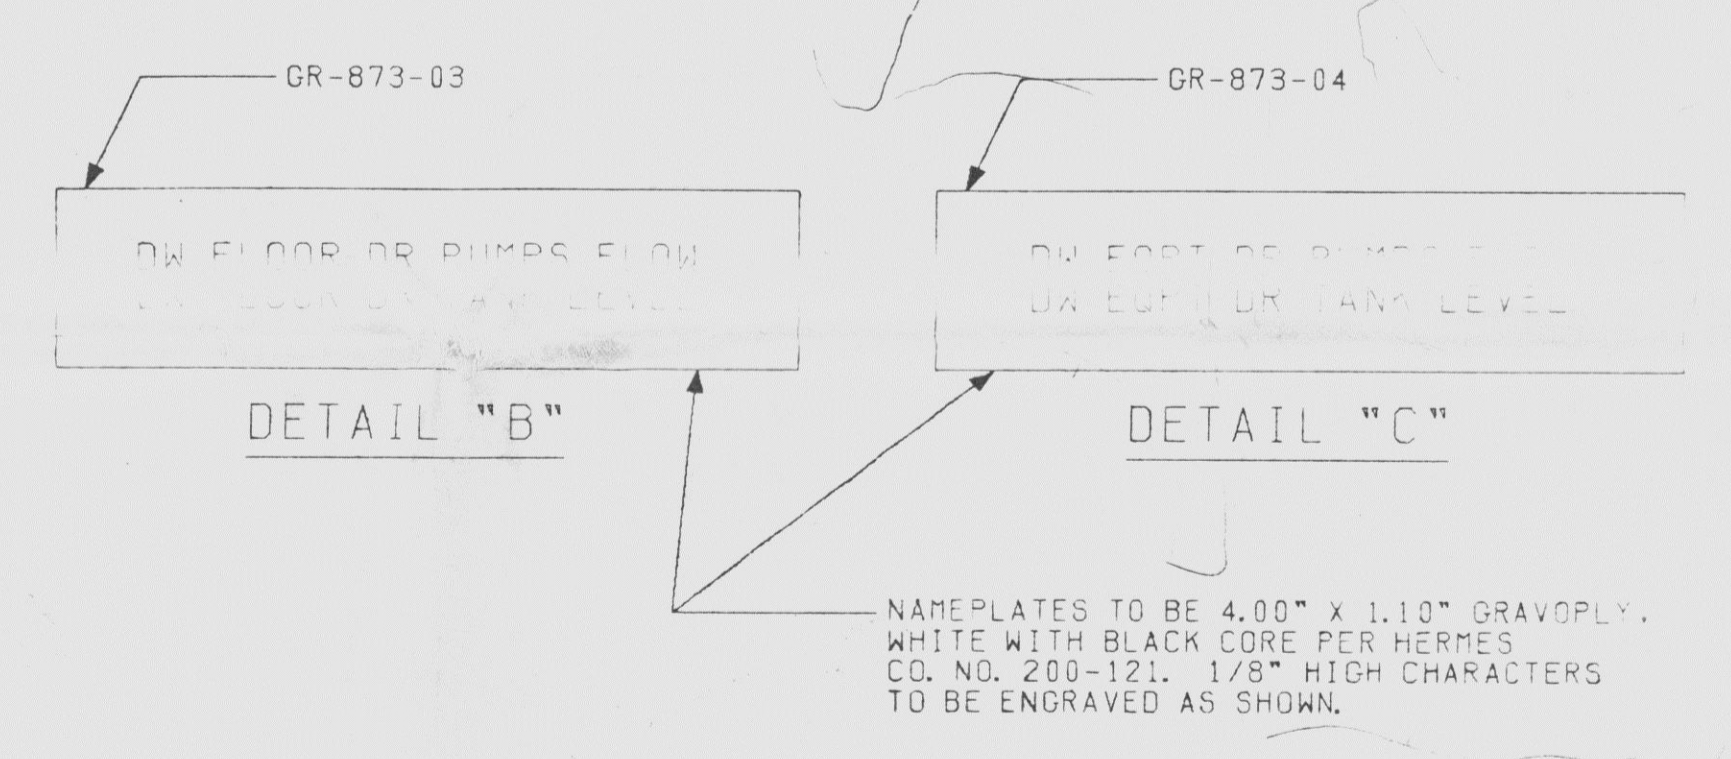

SEE NOTE "E"
 SEE NOTE "I" (TYP)

9305030177 E

NUCLEAR SAFETY RELATED
 QA CAT. I & II

SI APERTURE CARD

ARRANGEMENT DRYWELL COOLING PANEL & PRIMARY CONTM PURGE DIV I PANEL #873 2B
 NINE MILE POINT NUCLEAR STATION-UNIT 2

REDRAWN
 1-2-88
 10/20/88
 7/20/88

STONE & WEBSTER ENGINEERING CORPORATION
 12177-ESK-4CEC22

9305030177

9305030177-01