



CONTINUED FROM THIS DMG SHT-1

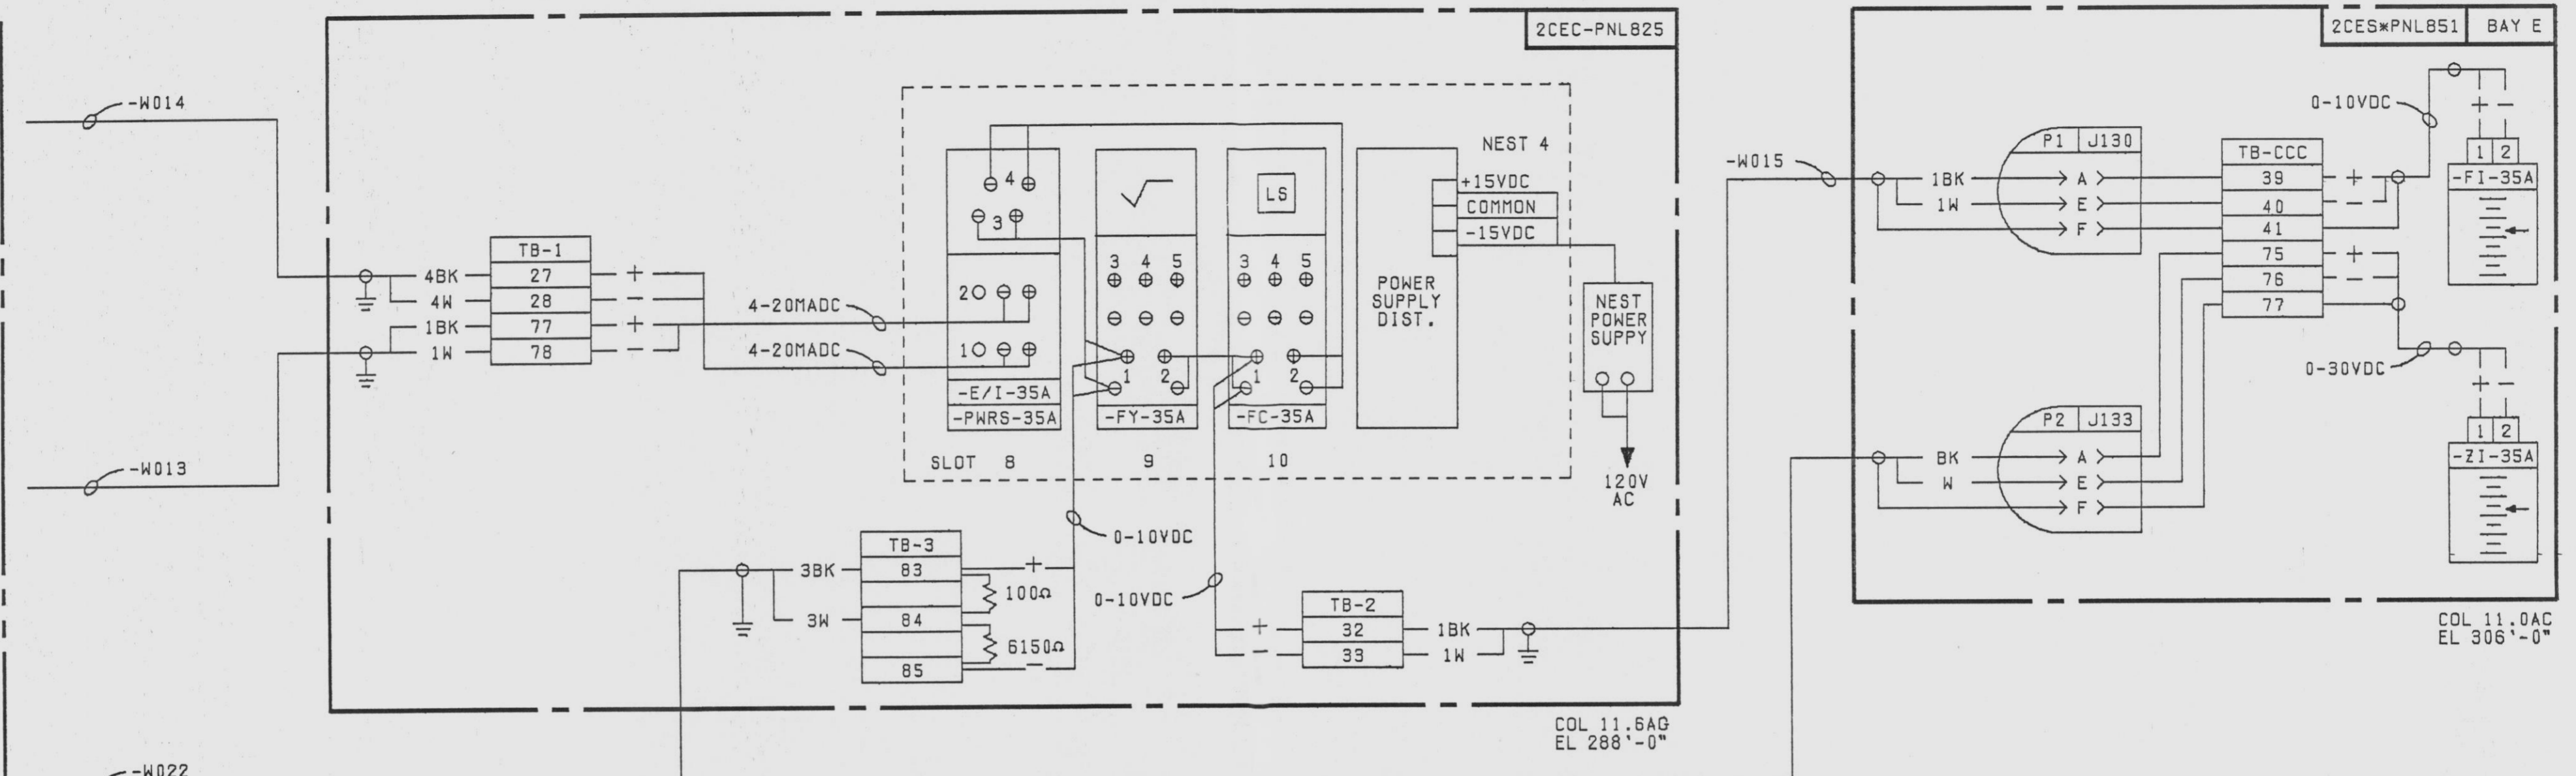


COL 11.6AG
EL 288'-0"

COL 11.0AC
EL 306'-0"

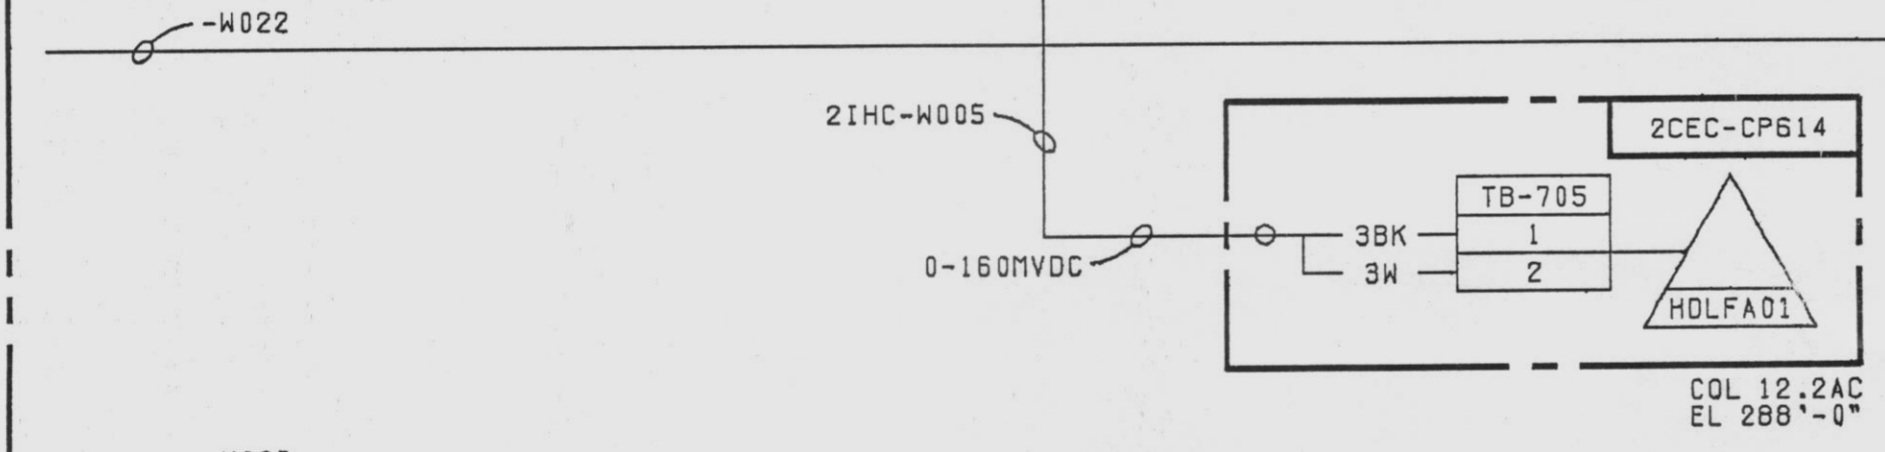

COL 12.2AC
EL 288'-0"

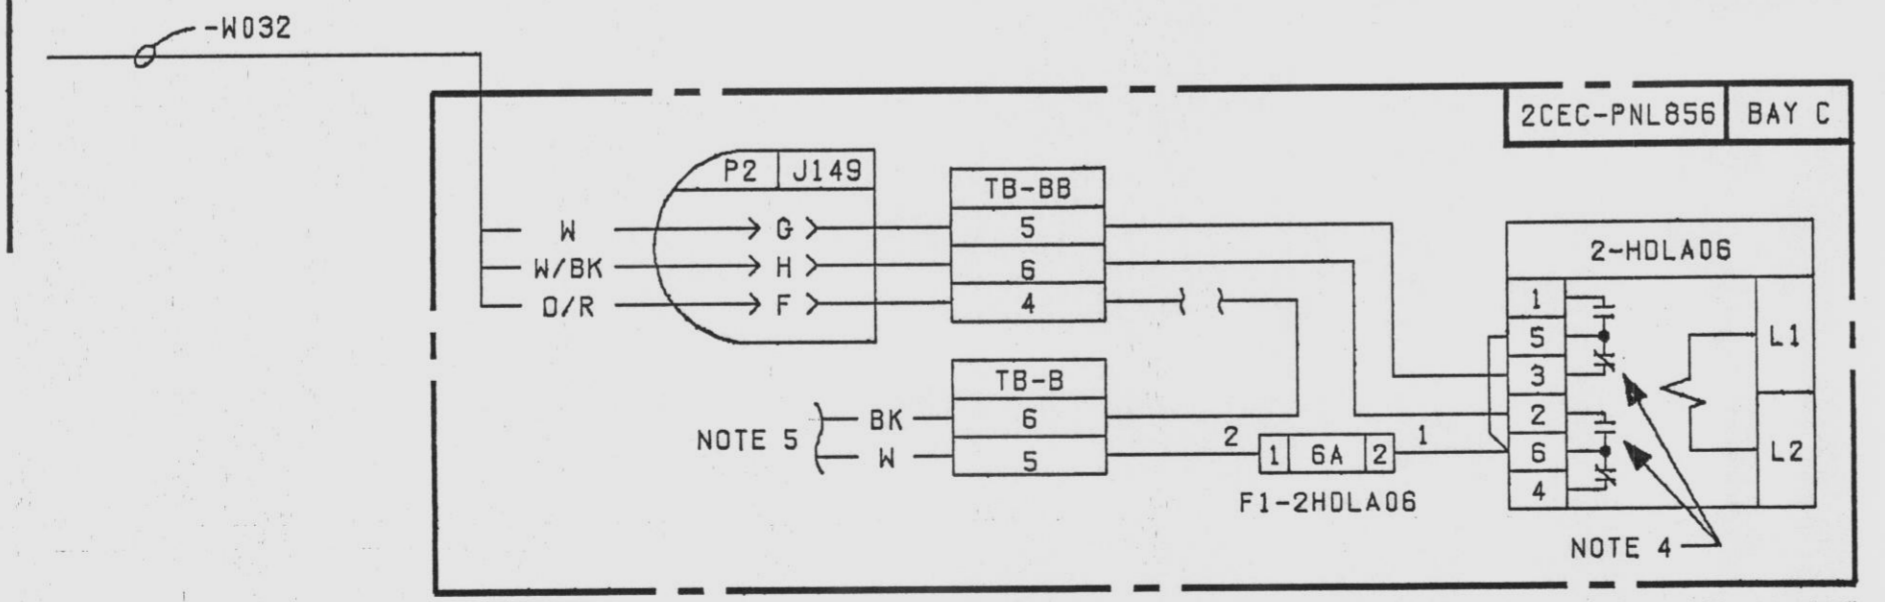

COL 11.0AE
EL 288'-0"

SI
APERTURE
CARD

9305040436 *D*

QA CAT II

TEST LOOP DIAGRAM
HEATER DRAIN PUMP P1A RECIRC CONTROL
2HDL-FT-35A
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

SHEET 2 OF 2

12177-TL2HDL-031

4	DATE PREPARED	3	DATE PREPARED	2	DATE PREPARED	1	DATE PREPARED	0	DATE PREPARED
	APPROVED		APPROVED		APPROVED		APPROVED		APPROVED



09-127-91

9305040436